

100% Clean and Renewable Wind, Water, and Sunlight (WWS) All-Sector Energy Roadmaps for 139 Countries of the World

April 7, 2017

By

Mark Z. Jacobson¹, Mark A. Delucchi², Zack A.F. Bauer¹, Savannah C. Goodman¹, William E. Chapman¹, Mary A. Cameron¹, Alphabetical: Cedric Bozonnat¹, Liat Chobadi³, Hailey A. Clonts¹, P. Enevoldsen⁴, Jenny R. Erwin¹, Simone N. Fobi¹, Owen K. Goldstrom¹, Eleanor M. Hennessy¹, Jingyi Liu¹, Jonathan Lo¹, Clayton B. Meyer¹, Sean B. Morris¹, Kevin R. Moy¹, Patrick L. O'Neill¹, Ivalin Petkov¹, Stephanie Redfern¹, Robin Schucker¹, Michael A. Sontag¹, Jingfan Wang¹, Eric Weiner¹, Alexander S. Yachanin¹

¹*Atmosphere/Energy Program, Dept. of Civil and Env. Engineering, Stanford University*

^{*}*Corresponding author. T: 650-723-6836; F: 650-723-7058; E: jacobson@stanford.edu*

²*Institute of Transportation Studies, U.C. Berkeley*

³*Technical University of Berlin, Germany*

⁴*Aarhus University, Denmark*

Abstract

We develop roadmaps to transform the all-purpose energy (electricity, transportation, heating/cooling, industry, agriculture/forestry/fishing) infrastructures of 139 countries to ones powered by wind, water, and sunlight (WWS). The roadmaps envision 80% conversion by 2030 and 100% by 2050. WWS not only replaces business-as-usual (BAU) power, but also reduces it ~42.5% because the work:energy ratio of WWS electricity exceeds that of combustion (23.0%), WWS requires no mining, transporting, or processing of fuels (12.6%), and WWS end-use efficiency exceeds BAU's (6.9%). Converting may create ~24.3 million more permanent, full-time jobs than lost. It may avoid ~4.6 million/yr premature air-pollution deaths today and ~3.5 million/yr in 2050, ~\$22.8 trillion/yr (12.7 ¢/kWh-BAU-all-energy) in 2050 air-pollution costs, and ~\$28.5 trillion/yr (15.8 ¢/kWh-BAU-all-energy) in 2050 climate costs. Transitioning may reduce and stabilize energy prices because fuel costs are zero, reduce conflict by creating energy self-sufficient countries, reduce power disruption and increase access to energy to those in energy poverty by decentralizing power, and avoid 1.5 °C global warming.

Significance Statement

Whether countries of the world can reverse global warming, eliminate air pollution mortality, and provide secure energy depends significantly on each country having a roadmap that provides an end point mix of technologies that can solve these problems. Despite laudable goals of the Paris Agreement, goals do not provide solutions. In fact, no study for multiple countries of the world has accounted for the following simultaneously: changes in future end-use power demand upon electrifying all energy sectors and providing the electricity with 100% wind, water, and sunlight (WWS); land, rooftop, and water areas required for the generators; jobs created versus lost; and energy, air pollution, and climate cost savings. Here, we develop such roadmaps for 139 countries.

Keywords

Air Pollution; Global Warming; Energy Security; Wind, Water, Solar; Solutions

1. Introduction

The seriousness of global air pollution, climate, and energy security problems requires a massive, virtually immediate transformation of the world's energy infrastructure to 100% clean, renewable energy producing zero emissions. For example, each year, 4-7 million people die prematurely and hundreds of millions become ill from air pollution prematurely^{1,2}, requiring an immediate elimination of chemical emissions that cause these mortalities and morbidities. Avoiding 1.5 C warming since preindustrial times requires no less than an 80% conversion of the energy infrastructure to zero-emitting energy by 2030 and 100% by 2050 (Sections 10 and S10). Lastly, although reasons for international conflict abound, one reason is the international competition for fossil energy resources concentrated in a few countries. In the absence of a conversion to alternative energy, as fossil fuel supplies dwindle and their prices rise, such conflicts may escalate and economic, social, and political instability may ensue.

As a response to these concerns, this study provides roadmaps for 139 countries for which raw energy data are available³. The roadmaps describe a future where all energy sectors are electrified or use heat directly with existing technology, energy demand is lower due to several factors, and the electricity is generated with 100% wind, water, and sunlight (WWS), alone. The roadmaps are not a prediction of what might happen. They are one proposal of an end-point mix of WWS generators by country and a timeline to get there that we think can largely solve the problems. The mix is not unique, since many combinations of WWS generators can result in stable, low-cost solutions⁴.

Previous studies have established that it may be possible to transition the world as a whole⁵⁻⁷ and the 50 U.S. state roadmaps⁸ to 100% WWS for all purposes – the main barriers are social and political rather than technical or economic. Other studies (e.g., for the UK⁹, Europe and North Africa¹⁰, Australia^{11,12}, Europe^{13,14}, Great Britain¹⁵, Hungary¹⁶, Ireland¹⁷, UK¹⁸, Denmark¹⁹, France²⁰, several world regions²¹, and 16 countries²²) have looked at similar issues, but either for individual countries or regions, selected sectors, partial carbon emission reductions, or carbon emission reductions only rather than air pollutant and carbon emission reductions. This study uses a unified methodology (Methods and Supplemental Information, *SI*) to examine the question of whether it is technically and economically possible to transition 139 countries to 100% WWS in all energy sectors, thereby eliminating the maximum possible air pollution and carbon emissions in those countries.

Each 100% WWS roadmap developed here provides an example of what a 2050 100% WWS versus BAU all-sector energy infrastructure can look like in terms of

- (1) Future end-use demand (load) in each energy sector in the WWS and BAU cases;
- (2) Needed numbers of WWS generators and their footprint and spacing areas;
- (3) WWS raw resources and potential, including solar photovoltaic (PV) rooftop potential;
- (4) Costs of energy, transmission, and distribution in the BAU and WWS cases;
- (5) Avoided air-pollution mortality and morbidity and their costs due to WWS;
- (6) Avoided carbon emissions and global-warming costs due to WWS;
- (7) Changes in job numbers and earnings due to WWS; and
- (8) Policy measures to implement the roadmaps and a transition timeline.

While some suggest that energy options aside from WWS, such as nuclear power, coal with carbon capture and sequestration (coal-CCS), biofuels, and bioenergy, can play major roles in solving these problems, all four technologies may represent opportunity costs in terms of carbon and health-affecting air pollution emissions^{6,23}. Nuclear and coal-CCS may also represent opportunity costs in terms of their direct energy costs and in terms of their time lag between planning and operation relative to WWS^{6,23-26}.

In addition, the Intergovernmental Panel on Climate Change (IPCC²⁵, p. 517) concludes that there is “*robust evidence*” and “*high agreement*” that “*Barriers to and risks associated with an increasing use of nuclear energy include operational risks and the associated safety concerns, uranium mining risks, financial and regulatory risks, unresolved waste management issues, nuclear weapons proliferation concerns, and adverse public opinion.*” As such, expanding the use of nuclear to countries where it doesn’t exist may increase

weapons proliferation and meltdown risks. Wind, water, and solar power have none of these risks. More advanced nuclear cannot be evaluated until it is commercialized but does not exist today. In sum, we focus on WWS technologies, which at least appear possible to solve the problems listed in a timely manner. Whether the roadmaps are implemented rapidly, however, likely depends on social and political factors.

2. Demand Reduction upon Conversion to WWS

Tables 1 and S6 (for all countries) provide one possible scenario of 139-country BAU and WWS end-use power demand (load) in 2050. End-use load is the power in delivered electricity or fuel that is actually used to provide services such as heating, cooling, lighting, and transportation. It excludes losses during electricity or fuel production and transmission but includes industry self-energy-use for mining, transporting, and refining fossil fuels. All end uses that can be electrified use WWS power directly; however, some transportation is run on hydrogen produced from WWS electricity (Methods).

Table 1. 2012 BAU, 2050 BAU, and 2050 100% WWS end-use loads (GW) by sector, summed among 139 countries. The last column shows the total percent reduction in 2050 BAU end-use load due to switching to WWS, including the effects of reduced energy use due to (a) the higher work to energy ratio of electricity over combustion, (b) eliminating energy industry self-use for the upstream mining, transporting, and/or refining of coal, oil, gas, biofuels, bioenergy, and uranium, and (c) policy-driven increases in end-use energy efficiency beyond those in the BAU case.

Scenario	Total end-use load (GW)	Residential % of total	Commercial % of total	Industrial % of total	Transport % of total	Ag/forestry/fishing % of total	Other % of total	(a) 2050 change in load (%) due to higher work: energy ratio of WWS	(b) 2050 change in load (%) due to eliminating upstream w/WWS	(c) 2050 change in load (%) due to efficiency beyond BAU w/WWS	Total 2050 change in load (%) w/WWS
BAU 2012	12,100	22.4	8.10	38.7	27.4	2.13	1.37				
BAU 2050	20,600	20.4	8.08	37.3	31.0	1.87	1.34				
WWS 2050	11,800	25.7	11.2	42.1	16.0	2.85	2.15	-23.0	-12.7	-6.89	-42.5

SI Section S3 describes the methodology; Table S6 contains individual country values.

In 2012, the 139-country all-purpose, end-use load was ~12.1 TW. Of this, 2.4 TW (19.6%) was electricity demand. Under BAU, all-purpose end-use load may grow to 20.6 TW in 2050. Transitioning to 100% WWS by 2050 reduces the 139-country load by ~42.5%, to 11.8 TW (Table 1), with the greatest percentage reduction in transportation. While electricity use increases with WWS, conventional fuel use decreases to zero. The increase in electric energy is much less than the decrease in energy in the gas, liquid, and solid fuels that the electricity replaces for three major reasons:

(a) The higher energy-to-work conversion efficiency of electricity used for heating, heat pumps, and electric motors and of electrolytic hydrogen in hydrogen fuel cells for transportation, than of fossil fuels (Table S4);

(b) The elimination of energy needed to mine, transport, and refine coal, oil, gas, biofuels, bioenergy, and uranium;

(c) Modest additional policy-driven energy efficiency measures beyond those under BAU.

These factors decrease average demand ~23.0%, 12.6%, and 6.9%, respectively, for a total of 42.5%. Thus, WWS not only replaces fossil-fuel electricity directly but is also an energy efficiency measure, reducing demand.

3. Numbers of Electric Power Generators, Land Required, and Resources Available

Table 2 summarizes the numbers of WWS generators needed to power all 139 countries in 2050 for all energy purposes assuming the end-use loads by country in Table S6 and the percent of each country's load met by each generator in Table S8. Table 2 accounts for power loss during energy transmission and distribution, generator maintenance, and competition among wind turbines for limited kinetic energy (array losses). The table also assumes all power for a country is generated and used in the country thus ignores cross-border transfers of energy that will occur in reality.

Table 2. Number, capacity, footprint area, and spacing area of WWS power plants or devices needed to meet total annually averaged end-use all-purpose load, summed over 139 countries.

Energy Technology	Rated power of one plant or device (MW)	^a Percent of 2050 all-purpose load met by plant/device	Name-plate capacity, existing plus new plants or devices (GW)	Percent name-plate capacity already installed 2015	Number of new plants or devices needed for 139 countries	^b Percent of 139-country land or roof area for footprint of new plants or devices	Percent of 139-country area for spacing of new plants or devices
Annual average power							
Onshore wind	5	23.50	8,330	5.04	1,580,000	0.00002	0.9240
Offshore wind	5	13.60	4,690	0.26	935,000	0.00001	0.5460
Wave device	0.75	0.58	307	0.00	410,000	0.00018	0.0086
Geothermal plant	100	0.67	96	13.05	839	0.00023	0.0000
Hydropower plant ^c	1300	4.00	1,060	100.00	0	0.00000	0.0000
Tidal turbine	1	0.06	31	1.79	30,100	0.00001	0.00009
Res. roof PV	0.005	14.90	9,280	0.76	1,840,000,000	0.04030	0.0000
Com/gov roof PV ^d	0.1	11.60	7,590	1.16	75,000,000	0.03280	0.0000
Solar PV plant ^d	50	21.40	12,630	0.53	251,000	0.12800	0.0000
Utility CSP plant ^d	100	9.72	2,150	0.23	21,000	0.05270	0.0000
Total for average power		100	46,200	3.76	1,920,000,000	0.255	1.480
New land average power^e						0.181	0.924
For peaking/storage							
Additional CSP ^f	100	5.83	1,290	0.00	12,900	0.032	0.000
Solar thermal ^f	50		4,640	8.98	84,400	0.005	0.000
Geothermal heat ^f	50		70	100.00	0	0.000	0.000
Total peaking/storage		5	6,000	8.11	97,300	0.037	0.000
Total all			52,200	4.26	1,920,000,000	0.291	1.480
Total new land^e						0.218	0.924

All values are summed over 139 countries. Ref. (27) provides values for individual countries. Annual average power is annual average energy divided by the number of hours per year.

^aTotal end-use load in 2050 with 100% WWS is from Table 1.

^bTotal land area for each country is given in Ref. (27). 139-country land area is 119,651,632 km².

^cThe average capacity factors of hydropower plants are assumed to increase from their current world average values of ~42% to 50.0%.

^dThe solar PV panels used for this calculation are Sun Power E20 panels. For footprint calculations alone, the CSP mirror sizes are set to those at Ivanpah. CSP is assumed to have storage with a maximum charge to discharge rate (storage size to generator size ratio) of 2.62:1. See Table S7 footnote for more details.

^eThe footprint area requiring new land equals the sum of footprints for new onshore wind, geothermal, hydropower, and utility solar PV. Offshore wind, wave and tidal generators are in water, thus do not require new land. Similarly, rooftop solar PV does not use new land so has zero new land footprint. Only onshore wind requires new land for spacing area. See Table S7 footnote for more details.

^fThe installed capacities for peaking power/storage are estimated from Ref. (4). Additional CSP is CSP plus storage needed beyond that for annual average power generation to firm the grid across all countries. Additional solar thermal and geothermal are used for direct heat or heat storage in soil. Ref. (4) also uses other types of storage.

Table S22 summarizes 2050 rooftop areas, supportable PV capacity, and installed rooftop PV used by country among the roadmaps developed here. Rooftop PV will go on rooftops or elevated canopies above parking lots, highways, and structures without requiring additional land. In 2050, residential rooftops (including garages and carports) among the 139 countries may support up to 26.6 TW_{dc-peak} of installed power, of which 34.9% is proposed for use. Commercial/government rooftops (including parking lots and parking structures) may support 11.1 TW_{dc-peak}, of which 68.2% is proposed for use. Low-latitude and high GDP-per-capita countries are hypothesized to adopt proportionately more PV than high-latitude, low GDP-per-capita countries.

While utility-scale PV can operate in any country because it can use direct and diffuse sunlight, CSP is viable only where significant direct sunlight exists. Thus, CSP penetration in several countries is limited (Section S5.2).

Onshore wind is available in every country but assumed to be viable in high penetrations primarily in countries with good wind resources and sufficient land (Section S5.1). Offshore wind is assumed viable in the 108 out of 139 countries with ocean or lake coastline (Section S5.1). In most of these countries, the technical potential installed capacity is determined from the area of coastal water less than 60 m depth and with a capacity factor of at least 34% in the annual average.


The 2050 nameplate capacity of hydropower is assumed to be the same as in 2015. However, existing hydropower is assumed to run at slightly higher capacity factor (Section S5.4). This assumption is justified by the fact that in many places, hydropower use is currently suppressed by the availability and use of gas and coal, which will be eliminated here. If current capacity factors are limited by low rainfall, it may also be possible to make up for the deficit with additional run-of-the-river hydro and pumped hydro. Geothermal, tidal, and wave power are limited by each country's technical potentials (Sections S5.3, S5.5, S5.6).

Table 2 also lists needed installed capacities of additional CSP with storage, solar thermal collectors, and existing geothermal. These collectors are needed to provide electricity or heat that is stored then used later to provide peaking power and to account for power losses into and out of such storage (Section S6).

Table 2 indicates that 4.26% of the 2050 nameplate capacity required for a 100% all-purpose WWS system among the 139 countries was already installed as of the end of 2015. The countries closest to 100% installation are Tajikistan (76.0%), Paraguay (58.9%), Norway (35.8%), Sweden (20.7%), Costa Rica (19.1%), Switzerland (19.0%), Georgia (18.7%), Montenegro (18.4%), and Iceland (17.3%). China (5.8%) ranks 39th and the United States (4.2%) ranks 52nd (Figure S2).

Footprint is the physical area on the top surface of soil or water needed for each energy device. It does not include areas of underground structures. Spacing is the area between some devices, such as wind, tidal, and wave turbines, needed to minimize interference of the wake of one turbine with others downwind. The total new land footprint required for the 139 countries is ~0.22% of the 139-country land area (Table 2), mostly for utility PV. This does not account for the decrease in footprint from eliminating the current energy infrastructure, which includes footprints for continuous mining, transporting, and refining fossil fuels and uranium and for growing, transporting, and refining biocrops. WWS has no footprint associated with mining fuels, but both WWS and BAU energy infrastructures require one-time mining for primary plus repaired equipment construction. The only spacing over land needed is between onshore wind turbines and requires ~0.92% of the 139-country land area (Figure 1).

Figure 1. Footprint plus spacing areas (km²) required from Table 2, beyond existing 2015 installations, to repower the 139 countries for all purposes in 2050 with WWS. For hydropower, the new footprint plus spacing area is zero since no new installations are proposed. For rooftop PV, the circle represents the additional area of 2050 rooftops that needs to be covered (thus does not represent new land).

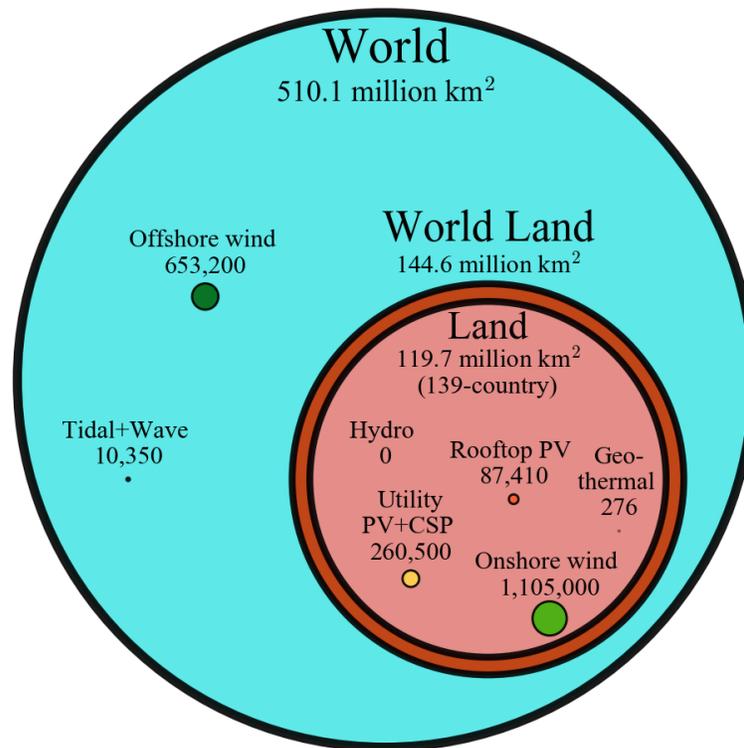

5. Energy Costs

Here, current and future full social costs (including capital, land, operating, maintenance, storage, fuel, transmission, and externalities) of WWS electric power generators versus non-WWS conventional fuel generators are estimated. These costs include the costs of CSP storage, solar collectors for heat storage, and all transmission/distribution costs, including additional transmission lines needed to wield more power and long distance high-voltage direct current lines. They do not include costs of pumped hydro storage, underground storage in rocks, heat and cold storage in water and ice, or the costs of hydrogen fuel cells. However, Section S7 accounts for these costs in providing the full costs of energy to keep the grid stable.

The total up-front capital cost of the 2050 WWS system (for annual average power plus peaking power and storage in Table 2) for the 139 countries is ~\$124.7 trillion for the 49.9 TW of new installed capacity needed (~\$2.5 million/MW). This compares with ~\$2.7 million/MW for the BAU case. In addition, WWS has zero fuel costs, whereas BAU has non-zero fuel cost. To account for these factors plus operation/maintenance, transmission/distribution, and storage costs, the levelized cost of energy (LCOE) is needed.

The 2050 LCOEs, weighted among all electricity generators and countries in the BAU and WWS cases, are 9.73 ¢/kWh-BAU-electricity and 8.86 ¢/kWh-WWS-all-energy, respectively (Table S34). Taking the product of the first number and the kWh-BAU in the retail electricity sector, subtracting the product of the second number and the kWh-WWS-electricity replacing BAU retail electricity, and subtracting the amortized cost of energy efficiency improvements beyond BAU improvements in the WWS case, gives a 2050 business cost savings due to switching from BAU to WWS electricity of ~\$113/yr per capita (\$2013 USD). Estimating an additional 0.8 ¢/kWh-WWS-all-energy for additional storage for just electric power from (4) and (28) gives a WWS business cost of ~9.66 ¢/kWh-WWS-all-energy, still providing ~\$85/yr per capita savings for WWS relative to just BAU's retail electricity sector..

6. Matching Electric Power Supply with Demand

First, we calculate the baseline numbers of generators of each type needed to power each country based on the 2050 annually-averaged WWS load in the country after all sectors have been electrified but before considering grid reliability and neglecting energy imports and exports. We then use results from a grid reliability study⁴ for the continental U.S. as a first guess of the additional electricity and heat generators needed in each country to ensure a reliable electric power grid by region (Table 2, bottom). Each of the 139 countries and the number of generators in each country is then allocated to one of 20 world regions. The same grid model used in Ref. (4) is then used to obtain low-cost, zero-load loss grid solutions for each grid region²⁸ following some minor updates to the numbers of generators.

The model estimates the quantities and costs of storage devices needed to ensure that a 100% WWS system, when integrated across a region, matches load every 30 s for several years while accounting for the variability and uncertainty of WWS resources. It uses wind and solar time-series at 30-s resolution from global model simulations that account for extreme events, competition among wind turbines for kinetic energy, and the feedback of

extracted solar radiation to roof and surface temperatures. It also uses 1-hour load data for 128 countries and derived data for 11 countries but load shifts at 30-s intervals during the demand response calculation. Options for balancing supply and demand include the use of demand response to shave periods of excess demand over supply, storage for low-temperature heat (in rocks and water), cold (in ice and water), and electricity (in phase-change material tied to CSP, pumped hydro, hydropower, and hydrogen)⁴. All proposed storage options are existing technologies. In the application to 20 world regions, no stationary storage batteries, biomass, nuclear power, carbon capture, or natural gas were needed. Stationary batteries could be used but at a higher cost than other storage types.

The resulting total costs of delivered 100% WWS energy, including generation, storage, short- and long-distance transmission, distribution, and maintenance, are 10.7 (6.5-14) ¢/kWh-all-energy (USD 2013) and 9.8 (6.3-12.2) ¢/kWh-WWS-electricity across all 139 countries in all 20 regions²⁸.

7. Air Pollution Cost Reductions due to WWS

The avoided costs due to reducing air pollution mortality in each country are quantified as follows. Global 3-D modeled concentrations of PM_{2.5} and O₃ in each of 139 countries are combined with the relative risk of mortality as a function of concentration and population in a health-effects equation²⁹. Results are then extrapolated to 2050 accounting for increasing population, emission sources, emission controls, and a nonlinear relationship between exposure and population (Section S8.1).

Resulting contemporary worldwide outdoor plus indoor premature mortalities over the 139 countries are ~4.28 (1.2-7.6) million/yr for PM_{2.5}, ~0.28 (0.14-0.42) million/yr for O₃, and ~4.56 (1.33-7.98) million/yr for both; over the world are ~4.97 (1.45-8.65) million/yr for both (Figure S12), which compares with 4-7 million/yr (outdoor plus indoor) worldwide from other studies^{1,2,30-32}. Premature mortalities derived for 2050 here are ~3.5 (0.84-7.4) million/yr (Table S36).

The air pollution damage cost due to fossil fuel and biofuel combustion and evaporative emissions in a country is the sum of mortality, morbidity, and non-health costs such as lost visibility and agricultural output. Mortality cost equals mortalities multiplied by the value of statistical life (VSL). Morbidity plus non-health costs are estimated as in Section S8.1. The resulting 139-country 2050 cost of air pollution is ~\$23 (\$4.1-\$69) trillion/yr, or ~12.7 (2.3-38) ¢/kWh-BAU-all-energy, ~7.6 (1.4-23)% of the 2050 global annual GDP on a purchasing power parity (PPP) basis, and \$2,600/yr per person (in 2013 USD). Our air pollution mean cost, which applies across all BAU sectors, is well within the 1.4-17 ¢/kWh-BAU-electricity range of another study for the retail electricity sector²².

8. Global-Warming Damage Costs Eliminated

Global warming costs include costs due to coastal flooding and real estate damage; agricultural loss; water shortages and flooding; health problems due to heat stress and stroke, influenza, malaria, and dengue fever; famine; ocean acidification; drought and wildfires; severe weather; and increased air pollution damage. In some regions, these costs are partly offset by fewer extreme cold events, associated reductions in illness and mortality,

and gains in agriculture. Net costs due to global-warming-relevant emissions are embodied in the social cost of carbon dioxide, which is estimated for 2050 from recent studies as \$500 (282-1,063)/metric tonne-CO₂e in 2013 USD¹³. Applying this range to estimated 2050 CO₂e emissions suggests that 139-country emissions may cause \$28.5 (16.1-60.7) trillion/yr in climate damage to the world by 2050, or 15.8 (8.9-34) ¢/kWh-BAU-all-energy and ~\$3,200/yr per person (in 2013 USD) (Tables S34 and S40).

9. Impacts of WWS on Jobs and Earnings in the Power Generation Sector

Changes in job numbers and earnings resulting from building out 100% of the WWS electricity generation and transmission system needed by 2050 are estimated with NREL's Jobs and Economic Development Impact (JEDI) models³³. The models accounts for onsite "direct" jobs, local revenue and supply chain "indirect" jobs, and "induced" jobs from the spending and reinvestment of earnings from direct and indirect jobs.

The build-out of the WWS generation and transmission infrastructure produces jobs during the construction and operation phases. All job numbers provided here are permanent, full-time (2080 hours/yr) positions. For example, permanent direct, indirect, and induced construction jobs are calculated assuming that $1/L$ of total installed capacity is built or replaced every year, where L is the average facility life (Section S9.1). Upon replacement of each facility, new construction jobs are needed. As such, construction jobs continue permanently. Job estimates do not include job changes in industries outside of electric power generation (e.g., the manufacture of electric vehicles, fuel cells or electricity storage), as it is uncertain where those jobs will be located and the extent to which they will be offset by losses in BAU-equivalent industries.

Results indicate that 100% conversion to WWS across 139 countries can create ~25.4 million new ongoing full-time construction-related jobs and ~26.6 million new full-time, ongoing operation- and maintenance-related jobs, totaling 52.0 million new ongoing jobs for WWS generators and transmission (Table S42).

Tables S42 and S45 summarize the resulting 139-country job loss in the oil, gas, coal, nuclear, and bioenergy industries. Because WWS plants replace BAU fossil, nuclear, WWS, and biopower, plants, jobs lost from the non-construction of BAU plants are included. Jobs lost from the construction of petroleum refineries and oil and gas pipelines are also counted. Shifting to WWS is estimated to result in ~27.7 million jobs lost in the current fossil fuel, biofuel, and nuclear industries, representing ~0.97% of the 2.86 billion 139-country workforce.

In sum, WWS may create a *net* of ~24.3 million permanent, full-time jobs across the 139 countries. Whereas, the number of operation jobs declines slightly, the number of permanent, continuous construction jobs far more than makes up for the loss (Table S42). Individually, countries that currently extract significant fossil fuels (e.g., Algeria, Angola, Iraq, Kuwait, Libya, Nigeria, Qatar, and Saudi Arabia) may experience net job loss in the energy production sector. Though not included here, these losses can be offset by the manufacture, service, and export of technologies associated with WWS energy (e.g., liquid hydrogen production and storage, electric vehicles, electric heating and cooling, etc.).

Collectively, the direct and indirect earnings from producing WWS electricity/transmission across 139 countries amount to ~\$1.86 trillion/yr during construction and ~\$2.06 trillion/yr during operation. The annual fossil-fuel earnings loss totals ~\$2.06 trillion/yr yielding a net ~\$1.86 trillion/yr gain.


10. Timeline

Figure 2 is a proposed WWS transformation timeline for the 139 countries. It assumes 80% conversion to WWS by 2030 and 100% by 2050. The rate of transformation is based on what is necessary to eliminate air pollution mortality as soon as possible, what is needed to avoid 1.5 C net global warming, and what we estimate is technically and economically feasible.

Friedlingstein et al.³⁴ estimate that, for the globally-averaged temperature change since 1870 to increase by less than 2 °C with a 67% or 50% probability, cumulative CO₂ emissions since 1870 must stay below 3,200 (2,900-3,600) Gt-CO₂ or 3500 (3100-3900) Gt-CO₂, respectively. This accounts for non-CO₂ forcing agents affecting the temperature response as well. Matthews³⁵ further estimates the emission limits to keeping temperature increases under 1.5 °C with probabilities of 67% and 50% as 2400 Gt-CO₂ and 2625 Gt-CO₂, respectively. As of 2015 end, ~2050 Gt-CO₂ from fossil-fuel combustion, cement manufacturing, and land use change had been emitted cumulatively since 1870³⁵, suggesting no more than 350-575 Gt-CO₂ can be emitted for a 67-50% probability of keeping post-1870 warming under 1.5°C. Given the current and project global emission rate of CO₂, it is necessary to cut energy- and land-use change emissions yearly until emission cuts reach 80% by 2030 and 100% by 2050 to limit warming to 1.5 °C with a probability of between 50% and 67% (Section S10).

Section S12 lists proposed timeline milestones by energy sector, and Section S11 identifies some of many potential transition policies to select from. Whereas, much new WWS infrastructure can be installed upon natural retirement of BAU infrastructure, new policies are needed to force remaining existing infrastructure to retire early to allow the complete conversion to WWS. Because the air-pollution and climate-impact benefits (avoided costs), as quantified here (28.5 (11.2-72) ¢/kWh-BAU-all-energy) resulting from closing BAU plants early far exceed the annualized remaining *net* asset value of such plants (the difference between the annualized capital cost and the annualized salvage or re-use value) divided by annual energy produced, and because net jobs increase upon replacing BAU plants, shuttering them early results in large net health and climate benefits to society.

Figure 2. Mean change in 139-country end-use power demand for all purposes (electricity, transportation, heating/cooling, industry, agriculture/fishing/forestry, and other) and its supply by conventional fuels and WWS generators over time based on the 139-country roadmaps. Total power demand decreases upon converting to WWS. The percentages next to each WWS source are final (2050) estimated percent supply of end-use power by the source. The 100% demarcation in 2050 indicates that 100% of all-purpose power is provided by WWS technologies by 2050, and the power demand by that time has decreased.

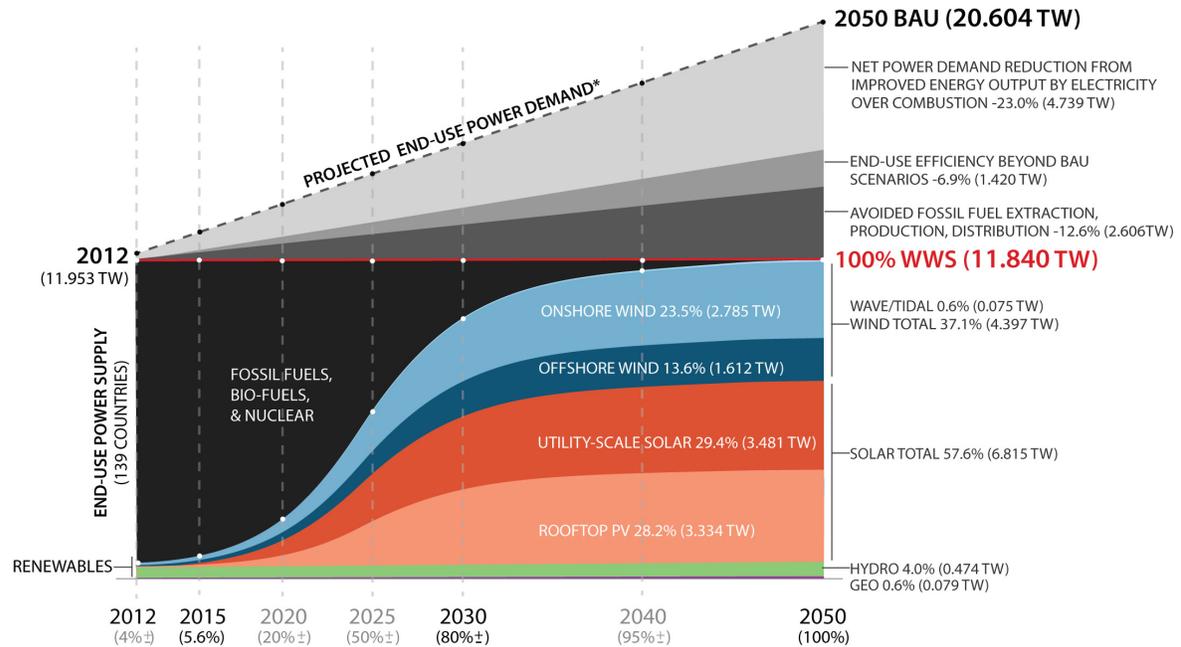

11. Conclusion

Transitioning 139 countries to 100% WWS has the potential to (1) avoid ~4.6 (1.3-8.0) million premature air pollution mortalities/yr today and 3.5 (0.84-7.4) million/yr in 2050, thus avoid ~\$23 (\$4.1-\$69) trillion/yr in 2050 air-pollution damage costs (2013 USD), (2) avoid ~\$28.5 (16.1-60.7) trillion/yr in 2050 global warming costs (2013 USD), (3) save ~\$85/person/yr in BAU-electricity-sector fuel costs, ~2,600/person/yr in all-sector air-pollution-damage cost, and ~\$3,200/person/yr in all-sector climate costs in 2050 (2013 USD), The total health plus climate cost savings translates to ~28.5 (11.2-72) ¢/kWh-BAU-all-energy, or \$5,800/yr per person, over 139 countries. (4) create ~24.3 million net new permanent, full-time jobs, (5) stabilize energy prices, (6) use minimal new land (0.22% of 139-country land for new footprint and 0.92% for new spacing), (7) enable countries to become largely energy self-sufficient thus possibly reducing international conflict over energy resources, (8) increase access to distributed energy by up to 4 billion people worldwide currently in energy poverty, and (9) decentralize much of the world power supply, thereby reducing the risk of large-scale system disruptions from power outages or terrorism. Finally, the aggressive worldwide conversion to WWS proposed here may help avoid global temperature rising more than 1.5 °C since 1870. While social and political barriers exist, converting to 100% WWS using existing technologies is technically and economically feasible. Reducing the barriers requires disseminating information to make people aware about what is possible, effective policies (Section S11), and individuals taking actions to transition their own homes and lives.

Methods

Quantifying the number of WWS generators in each country begins with 2012 energy-use data³ in each energy sector of 139 countries for which data are available. Energy use in each sector of each country is then estimated for 2050 in a BAU scenario (SI, Section S3.2). The

estimates account for increasing demand; modest shifts from coal to natural gas, biofuels, bioenergy, and some WWS; and some end-use energy efficiency improvements.

All energy-consuming processes in each sector are then electrified, and the resulting end-use energy required for a fully electrified all-purpose energy infrastructure is estimated (Section S3.3). Some end-use electricity is used to produce hydrogen for long-distance ground, ship, and air transportation. Modest additional end-use energy efficiency improvements are then applied. The remaining power demand is supplied with a combination of different WWS technologies determined by available natural resources and the rooftop, land, and water areas in that country.

The WWS electricity generation technologies include onshore and offshore wind turbines, concentrated solar power (CSP), geothermal heat and electricity, rooftop and utility-scale solar photovoltaics, tidal and wave power devices, and hydropower. These are existing technologies found to minimize health and climate impacts compared with other technologies, while also minimizing land and water use²³.

Technologies for ground transportation include battery electric vehicles (BEVs) and BEV-hydrogen fuel cell (HFC) hybrids, where the hydrogen is electrolytic (produced by electrolysis, or passing electricity through water). BEVs with fast charging (an existing commercial technology) dominate short- and long-distance, light-duty ground transportation, construction machines, agricultural equipment, short- and moderate-distance trains, short-distance boats and ships (e.g., ferries, speedboats), and aircraft traveling less than 1000 km. BEV-HFCV hybrids dominate medium- and heavy-duty trucks and long-distance trains, ships, and aircraft. HFCs are not used to generate electricity due to the relative inefficiency and associated costs of this application. In this study, ~7.0% of all 2050 WWS electricity (43.6% of the transportation load) is for producing, storing, and using hydrogen. Whereas hydrogen fuel cells are already commercially available in passenger cars and buses, they are not in many other forms of transport. Their accelerated adoption together with batteries in aircraft and long-distance ships may require policy incentives and will require manufacturing and fueling infrastructure changes.

Air heating and cooling are powered by ground-, air-, or water-source electric heat pumps. Water heat is generated by heat pumps with an electric resistance element for low temperatures and/or solar hot water preheating. Cook stoves are electric induction.

Electric arc furnaces, induction furnaces, and dielectric heaters are used to power directly high-temperature industrial processes.

The roadmaps assume the adoption of new energy-efficiency measures but exclude the use of nuclear power, carbon capture, liquid and solid biofuels, and natural gas primarily because they all increase air pollution and climate-warming emissions more than do WWS technologies².

References

1. WHO (World Health Organization) (2014) *7 million premature deaths annually linked to air pollution*, <http://www.who.int/mediacentre/news/releases/2014/air-pollution/en/>, Accessed January 26, 2017.
2. Forouzanfar MH *et al.* (2015) Global, regional, and national comparative risk assessment of 79 behavioral, environmental and occupational, and metabolic risks or clusters of risks in 188 countries, 1990-2013: a systematic analysis for the Global Burden of Disease Study 2013. *Lancet* 386: 2287-323.
3. IEA (International Energy Agency) (2015) *Statistics*, <http://www.iea.org/statistics/statisticsearch/>, Accessed June 10, 2015
4. Jacobson MZ, Delucchi MA, Cameron MA, Frew BA (2015) A low-cost solution to the grid reliability problem with 100% penetration of intermittent wind, water, and solar for all purposes. *Proc. Nat. Acad. Sci.* 112: 15,060-15,065. Jacobson MZ, Delucchi MA (2009) A path to sustainable energy by 2030. *Scientific American*, November.
5. Jacobson MZ, Delucchi MA (2011) Providing all Global Energy with Wind, Water, and Solar Power. Part I: Technologies, Energy Resources, Quantities and Areas of Infrastructure, and Materials. *Energy Policy* 39: 1154-1169.
6. Delucchi MA, Jacobson MZ (2011) Providing all global energy with wind, water, and solar power, Part II: Reliability, System and Transmission Costs, and Policies. *Energy Policy* 39: 1170-1190.
7. Jacobson MZ, Delucchi MA *et al.* (2015) 100% clean and renewable wind, water, sunlight (WWS) all-sector energy roadmaps for the 50 United States. *Energy and Environmental Sciences* 8: 2093-2117.
8. Parsons-Brinckerhoff (2009) *Powering the Future: Mapping our Low-Carbon Path to 2050*, https://www.pbworld.com/pdfs/powering_the_future/pb_ptf_full_report.pdf, Accessed May 2, 2015.
9. Price-Waterhouse-Coopers (2010) *100% Renewable Electricity: A roadmap to 2050 for Europe and North Africa*, www.pwcwebcast.co.uk/dpliv_mu/100_percent_renewable_electricity.pdf, Accessed May 2, 2015.
10. Beyond Zero Emissions (2010) *Zero Carbon Australia Stationary Energy Plan*, http://media.bze.org.au/ZCA2020_Stationary_Energy_Report_v1.pdf, Accessed May 2, 2015.
11. Denis A, Hatfield-Dodds S, Graham P, Jotso F (2014) Pathways to Deep Decarbonization in 2050: How Australia can prosper in a low-carbon world, http://climateworks.com.au/sites/default/files/documents/publications/climateworks_pdd2050_technicalreport_20140923.pdf, Accessed April 1, 2017.
12. ECF (European Climate Foundation) (2010) *Roadmap 2050: A Practical Guide to a Prosperous, Low-Carbon Europe*, <http://www.roadmap2050.eu/project/roadmap-2050>, Accessed May 2, 2015.
13. EREC (European Renewable Energy Council) (2010) *RE-Thinking 2050: A 100% Renewable Energy Vision for the European Union*, http://www.erec.org/fileadmin/erec_docs/Documents/Publications/ReThinking2050_full%20version_final.pdf, Accessed May 2, 2015.
14. Zero Carbon Britain (2013) *Zero Carbon Britain: Rethinking the future*, <http://zerocarbonbritain.org/images/pdfs/ZCBrtflo-res.pdf>, Accessed May 2, 2015.
15. ELTE/EENA (ELTE University sustainable energy research group/Environmental education network association) (2014) *Hungarian sustainable energy vision*, <http://inforse.dk/europe/VisionHU.htm>, Accessed May 2, 2015.
16. Connolly D, Mathiesen BV (2014) A technical and economic analysis of one potential pathway to a 100% renewable energy system. *Intl. J. Sustainable Energy Planning & Management* 1: 7-28.
17. Hooker-Stroud A., *et al.* (2015) Understanding the challenges and opportunities in managing hourly variability in a 100% renewable energy system for the UK. *Carbon Management* 5: 373-384.
18. Mathiesen BV *et al.* (2015) Smart energy systems for coherent 100% renewable energy and transport solutions. *Applied Energy* 145, 139-154 (2015).
19. Negawatt Association (2015) *The Negawatt 2050 scenario*, <http://www.negawatt.org/english-presentation-p149.html>, Accessed July 31, 2015.
20. Teske S, *et al.* (2015) *Energy revolution. A sustainable world energy outlook 2015*, <http://www.greenpeace.org/international/Global/international/publications/climate/2015/Energy-Revolution-2015-Full.pdf>, Accessed December 13, 2015.
21. DDDP (Deep Decarbonization Pathways Project) (2015) *Pathways to deep decarbonization*, http://deepdecarbonization.org/wp-content/uploads/2015/12/DDPP_2015_REPORT.pdf, Accessed December 13, 2015.
22. Jacobson MZ (2009) Review of solutions to global warming, air pollution, and energy security, *Energy & Environmental Science* 2: 148-173.
23. Lazard (2016) *Lazard's levelized cost of energy analysis - Version 10.0*, <https://www.lazard.com/media/438038/levelized-cost-of-energy-v100.pdf>, Accessed January 21, 2017.
24. IPCC (Intergovernmental Panel on Climate Change) full citation: Bruckner T., I.A. Bashmakov, Y. Mulugetta, H. Chum, A. de la Vega Navarro, J. Edmonds, A. Faaij, B. Fungtammasan, A. Garg, E. Hertwich, D. Honnery, D. Infield, M. Kainuma, S. Khennas, S. Kim, H.B. Nimir, K. Riahi, N. Strachan, R. Wisner, and X. Zhang (2014): Energy Systems. In: *Climate Change 2014: Mitigation of Climate Change. Contribution of Working Group III to the Fifth Assessment Report of the Intergovernmental Panel on Climate Change* [Edenhofer, O., R. Pichs-Madruga, Y. Sokona, E. Farahani, S. Kadner, K. Seyboth, A. Adler, I. Baum, S. Brunner, P. Eickemeier, B. Kriemann, J. Savolainen, S. Schlömer, C. von

- Stechow, T.Zwickel and J.C. Minx (eds.)]. Cambridge University Press, Cambridge, United Kingdom and New York, NY, USA.
25. Cooper, M. (2016) The economic and institutional foundations of the Paris Agreement on climate change: The political economy of roadmaps to a sustainable electricity future, doi:10.13140/RG.2.1.3384.6805, https://papers.ssrn.com/sol3/papers.cfm?abstract_id=2722880, Accessed January 23, 2017
 26. Delucchi MA, Jacobson MZ, Bauer.ZAF. Goodman, S & Chapman W (2015) *Spreadsheets for 139-country 100% wind, water, and solar roadmaps*, <http://web.stanford.edu/group/efmh/jacobson/Articles/I/WWS-50-USState-plans.html>. Accessed April 18, 2016.
 27. Jacobson, MZ, Delucchi, MA, Cameron, MA, Mathiesen, BV (2017) Maintaining grid reliability at low cost among 139 countries within 20 world regions with 100% intermittent wind, water, and solar power for all purposes, in review (2017).
 28. Jacobson MZ (2010) Enhancement of local air pollution by urban CO₂ domes. *Environmental Science, and Technology* 44: 2497-2502.
 29. Buonocore JJ et al. (2016) Health and climate benefits of different energy efficiency and renewable energy choices. *Nat. Clim. Change* 6: 100-106.
 30. Shindell D et al. (2012) Simultaneously mitigating near-term climate change and improving human health and food security. *Science* 335: 183-189.
 31. Anenberg et al. (2012) Global air quality and health co-benefits of mitigating near-term climate change through methane and black carbon emission controls. *Environmental Health Perspectives* 120: 831-839.
 32. NREL (National Renewable Energy Laboratory) (2013) *Jobs and Economic Development Impact Models (JEDI)*, <http://www.nrel.gov/analysis/jedi/download.html>. Accessed October 27, 2013.
 33. Friedlingstein P et al. (2014) Persistent growth of CO₂ emissions and implications for reaching climate targets. *Nature Geoscience* 7: 709–715.
 34. Matthews HD (2016) *Montreal's emissions targets for 1.5 °C and 2°C global warming*, http://ocpm.qc.ca/sites/ocpm.qc.ca/files/pdf/P80/7.2.19_damon_matthews.pdf. Accessed Sept. 22, 2016.

Acknowledgments

We would like to thank The Solutions Project for partial funding of three students. We would like to thank Karl Burkart for developing the timeline graphic for this paper.

Supplemental Information for

100% Clean and Renewable Wind, Water, and Sunlight (WWS) All-Sector Energy Roadmaps for 139 Countries of the World

April 7, 2017

By

Mark Z. Jacobson¹, Mark A. Delucchi², Zack A.F. Bauer¹, Savannah C. Goodman¹, William E. Chapman¹, Mary A. Cameron¹, Alphabetical: Cedric Bozonnat¹, Liat Chobadi³, Hailey A. Clonts¹, P. Enevoldsen⁴, Jenny R. Erwin¹, Simone N. Fobi¹, Owen K. Goldstrom¹, Eleanor M. Hennessy¹, Jingyi Liu¹, Jonathan Lo¹, Clayton B. Meyer¹, Sean B. Morris¹, Kevin R. Moy¹, Patrick L. O'Neill¹, Ivalin Petkov¹, Stephanie Redfern¹, Robin Schucker¹, Michael A. Sontag¹, Jingfan Wang¹, Eric Weiner¹, Alexander S. Yachanin¹

¹*Atmosphere/Energy Program, Dept. of Civil and Env. Engineering, Stanford University*

^{*}*Corresponding author. T: 650-723-6836; F: 650-723-7058; E: jacobson@stanford.edu*

²*Institute of Transportation Studies, U.C. Berkeley*

³*Technical University of Berlin, Germany*

⁴*Aarhus University, Denmark*

Introduction

This document provides additional descriptions and data by country supporting the 100% clean, renewable all-sector energy roadmaps described in the main paper. Our general objective in this document is to examine what a 100% wind, water, and solar (WWS) all-sector energy system in each of 139 countries can look like in 2050 and the costs and benefits of a “business-as-usual” (BAU) infrastructure compared with the WWS infrastructure. The spreadsheets containing all the derivations of the numbers for this analysis can be found in Delucchi et al. (2016).

The topics covered in this document include the following:

P3. Section S1. Defining low and high cost scenarios

P3. Section S2. WWS technologies considered for each energy sector

P4. Section S3. Reduction in load upon conversion to WWS

P5. S3.1. End-use energy consumption by country, sector, and fuel in 2012

P8. S3.2. Projected end-use energy consumption by country, sector, and fuel in 2050, BAU

- P17. S3.3. Projected end-use energy consumption by country, sector, and fuel in 2050, WWS
- P24. S3.4. Summary of 2050 BAU and WWS loads for each of 139 countries
- P30. Section S4. Numbers of WWS generators, footprint areas, and spacing areas
- P38. Section S5. WWS resource availability and technical potential
 - P38. S5.1. Onshore and Offshore Wind
 - P49. S5.2. Rooftop and Utility-Scale Solar PV and CSP
 - P88. S5.3. Geothermal
 - P90. S5.4. Hydropower
 - P92. S5.5. Tidal
 - P94. S5.6. Wave
- P101. Section S6. Cost of BAU and WWS energy
 - P102. S6.1. Levelized cost of electricity from IRENA and Lazard
 - P105. S6.2. Levelized cost of electricity from other studies
 - P106. S6.3. Levelized cost of transmission and distribution
 - P116. S6.4. Transmission and distribution efficiency in the BAU scenario
 - P119. S6.5. Transmission and distribution efficiency in the 100% WWS scenario
 - P119. S6.6. Overall energy, health, and climate costs in the BAU versus WWS cases
- P125. Section S7. Cost of matching electrical power supply with demand
- P126. Section S8. Air pollution and global warming damage costs avoided by WWS
 - P126. S8.1. Air pollution cost reductions due to WWS
 - P133. S8.2. Global-warming damage costs avoided with 100% WWS in each country
- P143. Section S9. Impacts of WWS on jobs and earnings in the energy power sector
 - P144. S9.1. Jobs created and changes in earnings in the 100% WWS scenario
 - P153. S9.2. BAU jobs foregone (lost) in the 100% WWS scenario
 - P167. S9.3. Net change in permanent, full-time jobs by country due to 100% WWS
- P167. Section S10. Timeline for transitioning and impacts on global temperatures
- P170. Section S11. Recommended first steps and possible policies
 - P170. S11.1. Energy efficiency measures
 - P170. S11.2. Energy supply measures
 - P171. S11.3. Utility planning and incentive structures
 - P171. S11.4. Transportation
 - P172. S11.5. Industrial processes
- P172. Section S12. Summary
- P174. Appendices
 - P174. Appendix S1. Projection of GDP per capita
 - P176. Appendix S2. Annual social discount rate
 - P177. Appendix S3. Urban population share
- P178. References

Section S1. Defining “Low” and “High” Cost Scenarios

In order to unify our presentation, we report costs and other results for two general cases: one based on low costs and high benefits (i.e., low net costs or high net benefits) for the 100% WWS scenario, and one based on the reverse, high costs and low benefits (i.e., high net costs or low net benefits) for the 100% WWS scenario. For ease of exposition we use the following abbreviations:

LCHB = low cost, high benefits for 100% WWS

HCLB = high cost, low benefits for 100% WWS

For each case, all component costs and benefits summed to make the total have the same underlying explicit or implicit assumptions regarding the discount rate and other parameters. This means, for example, that in either case we do not add a cost estimate based on a low discount rate to a benefit estimate based on a high-discount rate. See the Supplemental Information of Jacobson et al. (2015a) for further discussion.

Section S2. WWS Technologies Considered for each Energy Sector

Quantifying end-use energy requirements and the numbers of WWS generators needed in 2050 by country begins with 2012 energy use data in each energy sector of 139 countries for which data are available (Section S3.1). 2012 energy use in each sector of each country is projected to 2050 in a business-as-usual (BAU) scenario (Section S3.2). The BAU projections account for increasing demand; modest shifts from coal to gas, biofuels, bioenergy, some WWS; and some end use energy efficiency improvements.

All energy-consuming processes in each sector are then electrified, and the resulting end-use energy required for a fully electrified all-purpose energy infrastructure is estimated (Section S3.3). Some end-use electricity in each country is used to produce hydrogen for some long-distance transportation. Modest additional end-use energy efficiency improvements are then applied. Finally, the remaining power demand is supplied by a set of WWS technologies, the mix of which varies by country with available resources and rooftop, land, and water areas.

The WWS electricity generation technologies include wind, concentrated solar power (CSP), geothermal, solar PV, tidal, wave, and hydropower. These are existing technologies found to reduce health and climate impacts the most among several technologies while minimizing land and water use and other impacts (Jacobson, 2009).

Vehicles for transportation include battery electric vehicles (BEVs) and BEV-hydrogen fuel cell vehicle (HFCV) hybrids, where the hydrogen is electrolytic (produced by passing electricity through water). BEVs with fast charging dominate 2- and 3-wheel vehicles, short- and long-distance light-duty passenger vehicles and trucks, construction machines, agricultural equipment, short- and moderate-distance trains, short-distance boats and ships (e.g., ferries, speedboats), and aircraft traveling less than 1000 km. BEV-HFCV hybrids dominate medium- and heavy-duty trucks and long-distance trains, ships, and aircraft. Of all commercial aircraft flight distances traveled worldwide, 53.9% are short-haul (<3 hours in duration, with a mean distance of 783 km) (Wilkerson et al., 2010). As such, approximately half the aircraft flights may be electrified with batteries. Whereas hydrogen fuel cells are already commercially available in passenger cars and buses, they are not in many other forms of transport. Their accelerated adoption together with batteries in aircraft and long-distance ships may require policy incentives and will require manufacturing and fueling infrastructure changes.

In this study, ~7.0% of all 2050 WWS electricity (43.6% of the transportation load) is needed for producing, storing, and using hydrogen. None is used for stationary hydrogen fuel cells to generate electricity because of the relative inefficiency and cost of this process.

Air heating and cooling are accomplished with ground-, air-, or water-source electric heat pumps. Water heat is generated by heat pumps with an electric resistance element for low temperatures and/or solar hot water preheating. Cook stoves use electric induction technology. Dryers are all electric.

Electric arc furnaces, induction furnaces, dielectric heaters, and some resistance heaters are used to power high-temperature industrial processes.

The roadmaps assume the adoption of new energy-efficiency measures but exclude the use of nuclear power, coal with carbon capture, liquid or solid biofuels, or natural gas for the reasons described in the main text.

This study calculates the numbers of generators of each type needed to power each country based on the 2050 power demand in the country after all sectors have been electrified but before considering grid reliability and neglecting energy imports and exports. However, results from a grid reliability study for the continental U.S. (Jacobson et al., 2015b) are used to estimate the additional electric power generators needed and some of the additional storage needed by country to ensure a reliable electric power grid. An estimate of the full storage needed will be provided in a separate study.

For purposes of calculating the baseline number of energy generators needed in each country, we assume each country is energy self-sufficient thus can generate all its annually averaged end-use energy. In reality, energy exchanges among countries will occur in 2050 as they currently do because it will be more profitable for countries with higher-grade WWS resources to produce more power than they need for their own use and export the rest. As such, the real system cost will likely be less than that modeled here since the costs of, for example solar, are higher in low-sunlight countries than in countries that might export solar electricity.

Section S3. Reduction in Load upon Conversion to WWS

Our main objective in this section is to estimate energy end-use in a 2050 100% WWS world relative to a 2050 reference BAU scenario. We proceed in three steps:

S3.1) We start with estimates of actual end-use energy consumption, from the International Energy Agency (IEA), for each country in 2012.

S3.2) We then estimate BAU end-use energy consumption in a future target year (2050) based primarily on the energy end-use projections by the Energy Information Administration (EIA) for 16 regions of the world, assuming that the change in energy use for each country between 2012 and the target year is the same as the EIA-projected change over the period for the region containing the country.

S3.3) To estimate energy use in the future WWS scenario, relative to the future BAU scenario, we adjust the EIA/IEA-based BAU end-use energy estimates by differences between the BAU and the WWS scenarios due to

- i) Changes in energy requirements resulting from electrification of end uses in the WWS scenario;
- ii) The absence in the WWS scenario of non-minor “energy sector own use” (ESOU), which is the energy used to process and transport non-WWS energy (mainly fossil-fuel);
- iii) Changes in the amount of capital-intensive energy infrastructure; and
- iv) Extra end-use energy efficiency measures in the WWS scenario beyond those assumed in the BAU scenario.

Because our main objective is to estimate energy consumption in the WWS scenario *relative* to consumption in the BAU scenario, we want to estimate energy consumption for all end-use categories (combinations of demand sectors [e.g., the residential sector] and fuel types [e.g., liquid fuels]) where consumption is likely to differ in the WWS vs. the BAU scenario. The energy-use categories in the original IEA data and EIA projections (see discussion below and Table S1) cover most but not all of the end uses that are likely to differ between the BAU and WWS scenarios (for example, ESOU is only partially covered in the IEA data and not covered at all in the EIA projections), so we adjust the IEA energy-data and EIA energy-projection categories as needed to have estimates of all energy end uses that are likely to differ between the WWS and the BAU scenarios.

S3.1. End-Use energy Consumption by Country, Sector, and Fuel in 2012

We start with the IEA’s *World Energy Balances* reports “final consumption,” in thousands of tons of oil-equivalent (KTOE), for the year 2012 by country, end-use sector, and fuel (IEA, 2015c). The IEA’s energy balance framework shows for each country:

Total final consumption (TFC) (end-use) = Total Primary Energy Supply (TPES) + Transformation Processes (TP).

TPES is originally equal to production + imports – exports – energy for international aviation and marine bunkers. For each country, we add back in energy for international aviation and marine bunkers as described shortly.

Transformation Processes (TP) include for example “energy industry own use;” transformation losses at electricity plants, combined heat-and-power (CHP) plants, and heat-only plants (these are negative values); and transformation-process output from electricity plants, CHP, and heat plants (these are positive values).

TFC is then distributed to end-use sectors and fuel types as shown in Table S1. For the most part, our end-use sectors and end-use fuel types are based on the IEA’s categories.

We make three adjustments to the original IEA data to make them suitable for our purposes:

- i) The IEA reports energy used for “international marine bunkers” and “international aviation bunkers” as negative TPES rather than as final consumption in the “transport” sector for each country. We want to include this international fuel use in our “transportation” sector for each country, so end-use energy in our transportation sector (in the “oil” fuel category) is equal to the

IEA's reported transportation-sector energy use plus the IEA's reported energy use for international marine and air transport.

ii) The IEA estimates "energy industry own use"¹ (EIOU) of fossil fuels but as mentioned above counts it as a negative transformation process and deducts it from primary TPES. Thus, EIOU is not in the industrial sector or any other final demand sector. (EIOU is the industry-sector part of our general category "energy-sector own use" [ESOU]). We include EIOU as a part of our industrial-sector end use, although as discussed later we project EIOU differently from the way we project the energy use in the rest of the industrial sector.

As mentioned above, in the WWS scenario we deduct most EIOU. This gives rise to the question: given that the IEA excludes EIOU from final its final consumption estimates to begin with, why should we add it to industrial-sector consumption, only to subtract it later in the WWS scenario? There are four reasons. First, as just mentioned, we deduct most *but not all* EIOU: the portion of EIOU that pertains to non-energy fuels not replaceable by WWS is retained in the WWS scenario. We explicitly estimate this retained portion, as discussed later. Second, we think that for the purposes of estimating changes in end-use energy as a result of converting to WWS, it is most informative and natural to treat EIOU as end-use energy and show the benefit of reducing it in the WWS scenario. Third (and related to the second), EIOU as a fraction of total consumption is likely to increase as a result of increases in energy intensity (due for example to declining quality of crude oil) and a shift towards more energy-intensive products (such as refined petroleum). We account for this explicitly. Fourth, the IEA does *not* distinguish transportation-sector ESOU (e.g., liquid fuel used by tanker trucks distributing petroleum products), so in any case we have to estimate this separately, and deduct it in the WWS scenario. Given that, it makes more sense to distinguish EIOU (industrial-sector ESOU in our terminology) and provide an explicit, complete accounting of all ESOU.

iii) The IEA reports "non-energy use"² of fossil fuels but does not include it in the industrial sector or any other final demand sector. ("Non-energy use" refers to the use fossil fuels to make

¹ "Energy industry own use contains the primary and secondary energy consumed by transformation industries for heating, pumping, traction and lighting purposes... Included here are, for example, own use of energy in coal mines, own consumption in power plants (which includes net electricity consumed for pumped storage) and energy used for oil and gas extraction" (IEA, 2015b, p. 1.12). In its detailed documentation, the IEA (2015a) defines total energy industry own-use as the sum of own use for coal mines, oil and gas extraction, blast furnaces, gas works, gasification plants, coke ovens, patent fuel plants, peat/briquette plants, oil refineries, coal liquefaction plants, LNG plants, Gas-to-liquids plants, electricity and CHP plants, pumped hydro storage, the nuclear industry, charcoal production plants, non-specified energy sectors, and distribution losses. It thus appears that "own-use" for transport of fuels is not included.

² "Non-energy use covers those fuels that are used as raw materials in the different sectors and are not consumed as a fuel or transformed into another fuel. Non-energy use is shown separately in final consumption under the heading non-energy use.

Note that for biofuels, only the amounts of biomass specifically used for energy purposes (a small part of the total) are included in the energy statistics. Therefore, the non-energy use of biomass is not taken into consideration and the quantities are null by definition" (IEA, 2015b, p. 1.13).

non-energy product, such as the use of crude oil to make asphalt.) We include as industrial-sector energy use the fraction of non-energy use of fossil fuels that potentially is replaceable by WWS energy. (The fraction of non-energy use of fossil fuels that is *not* replaceable by WWS energy remains the same in the WWS scenario and the BAU scenario, and hence is outside the scope of our analysis, which is concerned with energy.) We assume that only 10% of non-energy use of coal, oil, and natural gas can be replaced directly by WWS energy.

Table S1 shows the relationships between our end-use sectors and end-use fuel types and those of the IEA.

Table S1. End-use sectors and fuel types in our analysis, the IEA, and the EIA.

A. End-use sectors.

Our analysis	IEA <i>World Energy Balances</i>	EIA <i>IEO</i>
Residential	Residential	Residential
Commercial	Commercial and public services	Commercial
Industrial	Industry + non-energy use ^a + energy industry own use	Industrial
Transportation	Transport, including world marine bunkers and world aviation bunkers	Transportation
Agriculture/forestry/fishing	Agriculture/forestry + fishing	Industrial
other	other, non-specified	Industrial

B. End-use fuel types.

Our analysis	IEA <i>World Energy Balances</i>	EIA <i>IEO</i>
Oil	Oil products + crude oil	Liquids
Natural gas	Natural gas	Natural gas
Coal	Coal + peat + oil shale	Coal
Electricity	Electricity	Electricity
Heat	Heat	N.S. (assume natural gas)
Biofuels and waste	Biofuels and waste	Renewables
Other renewables (excluding electricity, biofuels)	Geothermal + solar/wind/other ^b	Renewables

Source: IEA (2015a), EIA (2016a). IEO = *International Energy Outlook*; n.s. = not specified.

^a The portion of non-energy use that is potentially replaceable by WWS. See the discussion in the text.

^b Final consumption of solar thermal and non-electricity-producing geothermal energy

S3.2. Projected End-Use Energy Consumption by Country, Sector, and Fuel in 2050, BAU

The EIA's *International Energy Outlook (IEO)* projects end-use energy consumption by sector (residential, commercial, industrial, and transportation) and fuel (liquids, natural gas, coal, electricity, and renewables) for 16 world regions, through the year 2040 (EIA, 2016a). We start with the EIA's "reference" case for our BAU scenario, and extend their projections to the year 2075 using a 10-year moving linear extrapolation.³ The 16 world regions are

- United States
- Canada
- Mexico/Chile
- OECD Europe
- Japan
- South Korea
- Australia/New Zealand
- Russia
- Other Europe and Eurasia
- China
- India
- Other Asia
- Middle East
- Africa
- Brazil
- Other Central and South America

In order to apply the EIA projections to the IEA's base-year data, we line up the EIA's energy sector and fuel categories with ours and IEA's. The EIA has fewer fuel and sector categories than does the IEA: EIA does not have the fuel categories "heat" and "biofuels and waste" or the sectors "agricultural/fishing/forestry" and "other". We handle these as follows:

Heat. In the IEA's *Balances*, "heat shows the disposition of heat produced for sale" (IEA, 2015b, p. 1.10), primarily by combined heat-and-power (CHP) plants and heat-only plants. The actual fuels used to produce this purchased heat are included as negative values, and the actual heat produced is included as a positive value, under "transformation processes" (TP).⁴ The heat

³In most cases, the EIA's model bases the start of its projections on the same IEA *World Energy Balance* data that we use.

⁴In the IEA's discussion of transformation and losses: "Heat plants refers to plants (including heat pumps and electric boilers) designed to produce heat only, which is sold to a third party under the provisions of a contract... Columns 1 through 8 show the use of primary and secondary fuels in a heating system that transmits and distributes heat from one or more energy sources to, among others, residential, industrial and commercial consumers, for space heating, cooking, hot water and industrial processes" (IEA, 2015b, pp. I.11-I.12).

"Note that for autoproducer CHP plants, all fuel inputs to electricity production are taken into account, while only the part of fuel inputs to heat sold is shown. Fuel inputs for the production of heat consumed within the autoproducer's establishment are not included here but are included with figures for the final consumption of fuels in the appropriate consuming sector" (IEA, 2015b,

produced in TP is then distributed to different sectors of final consumption. (Thus, in the IEA data, heat is treated in the same way as is electricity.) This means that the end-use consumption of heat is *not* counted elsewhere as is end-use consumption in the EIA data, and so needs to be included in our projections of BAU end-use energy.

The EIA does not have a separate end-use fuel category for “heat,” so we need a proxy. In the IEA’s *Balances*, CHP and heat-only plants use more NG than any other fuel (IEA, 2015a). Therefore, for the purpose of projecting future BAU energy use, we assume that X energy units of heat, as reported by the IEA, are effectively X energy units of natural gas end use, and apply the EIA’s projected change rates for NG use.

Biofuels and waste. The IEA’s “Biofuels and waste” fuel category includes any bio-energy used for fuel purposes; amounts used for *non*-energy purposes are not included (IEA, 2015b, pp. 1.9-1.10). The majority of biofuel use appears to be wood fuel used by households. For the purpose of projecting future BAU energy use, we assume that X energy units of “biofuel and waste”, as reported by the IEA, are X energy units of generic “renewable fuels,” and apply the EIA’s projected change rates for renewable fuels.

Agricultural/fishing/forestry sector, and “other” sector. The EIA’s “industry” sector comprises the end uses in the IEA’s “agricultural/fishing/forestry” and “other” sectors, so we project energy use in these IEA sectors on the basis of the EIA’s projected change rates for the “industry” sector (Table S1).

We then project future energy use by sector and fuel for each country on the basis of the EIA-projected change in energy use for the region of which the country is a part. (The method is analogous to that used in Jacobson et al. (2015a) to project energy use for the 50 U.S. states.) The general method is

$$E_{i,X,C,TY,BAU} = E_{i,X,C,BY} \cdot \frac{E_{i' \rightarrow i, X' \rightarrow X, R: C \in R, TY, BAU}}{E_{i' \rightarrow i, X' \rightarrow X, R: C \in R, BY}}$$

where

$E_{i,X,C,TY,BAU}$ = Use of fuel i in sector X of country C in target-year TY in the BAU scenario

$E_{i,X,C,BY}$ = Use of fuel i in sector X of country C in the base-year BY scenario (IEA, 2015c; see discussion above)

$E_{i' \rightarrow i, X' \rightarrow X, R: C \in R, TY, BAU}$ = Use of EIA-fuel category i' (mapped to IEA fuel category i , as discussed above) in EIA-sector X' (mapped to EIA sector X , as discussed above) in region R (containing country C) in target-year TY in the BAU scenario (EIA, 2016a; see discussion above)

$E_{i' \rightarrow i, X' \rightarrow X, R: C \in R, BY}$ = Use of EIA-fuel category i' (mapped to IEA fuel category i , as discussed above) in EIA-sector X' (mapped to EIA sector X , as discussed above) in region R (containing country C) in base-year BY (EIA, 2016a; see discussion above)

Subscripts

i = IEA fuel categories (discussed above)
 i' = EIA fuel categories (discussed above)
 X = IEA energy sectors (discussed above)
 X' = EIA energy sectors (discussed above)
 C = country
 TY = Target year of the analysis
 BY = Base year of data
 WWS = 100% WWS scenario
 BAU = Business-as-usual scenario

This general method applies to the residential sector, the commercial sector, the transportation sector, and the industrial sector apart from ESOU and non-energy use of fossil fuels. As discussed next, we treat ESOU and non-energy use of fossil fuels differently from energy use in the rest of the industrial sector.

Projections of end-use energy consumption in the BAU industrial sector

Energy use in the industrial sector in the BAU in the target year is the sum of energy use in the original IEA industrial sector, ESOU, and non-energy use of fossil fuels that is potentially replaceable by WWS. (For our purposes, non-energy use of fossil fuels that is not replaceable by WWS is not counted as energy use.) Formally,

$$E_{i, industrial, C, TY, BAU} = E_{i, industrial^*, C, TY, BAU} + ESOU_{i, industrial, C, TY, BAU} + RF_{NE, i} \cdot E_{NE, i, industrial, C, TY, BAU}$$

where

$E_{i, industrial, C, TY, BAU}$ = End use consumption of fuel i in the industrial sector of country C in year TY , in the BAU scenario

$E_{i, industrial^*, C, TY, BAU}$ = End use consumption of fuel i in the industrial sector of country C in year TY in the BAU, based on IEA estimates for its original industrial sector, which exclude ESOU and non-energy use of products i

$ESOU_{i, industrial, C, TY, BAU}$ = Own-use of fuel i in the industrial sector of country C in year TY in the BAU

$E_{NE, i, industrial, C, TY, BAU}$ = Non-energy use of i in the industrial sector of country C in year TY in the BAU

$RF_{NE, i}$ = The fraction of non-energy use of i that is potentially replaceable by WWS (we assume that 10% of non-energy use of oil, natural gas, coal, and biofuels, and 100% of non-energy use of electricity, renewables and heat can be replaced by WWS)

Subscript NE = non-energy use of fuel or product

Subscript E = energy use of fuel or product

$E_{i,industrial,C,TY,BAU}^*$ and $E_{NE,i,industrial,C,TY,BAU}$ are estimated as described above, by multiplying IEA base-year estimates by EIA *IEO* projections of the change in energy use in the industrial sector between the base year and the target year (see the formula for $E_{i,X,C,TY,BAU}$).⁵

Industrial ESOU in the target year is the product of reported ESOU in the base year and an all-countries, all-fuels scalar that accounts for: i) changes in the *quantity* of fuels produced, ii) changes in the *mix* of fuel products (because some fuel products require more processing energy than others), and iii) changes in the industrial sector own-use *energy intensity* of fuel production:

$$ESOU_{i,industrial,C,TY,BAU} = ESOU_{i,industrial,C,BY_{IEA}} \cdot K_{ESOU,all-i(p),world,TY/BY}$$

$$K_{ESOU,all-i(p),world,TY/BY} = \frac{\sum_{i(p)} EI_{NE,i(p),industrial,world,TY,BAU} \cdot E_{NE,i(p),all-X,world,TY,BAU} + \sum_{i(p)} EI_{E,i(p),industrial,world,TY,BAU} \cdot E_{E,i(p),all-X,world,TY,BAU}}{ESOU_{all-i,industrial,world,BY_{IEA}}}$$

$$E_{E,i(p),all-X,world,TY,BAU} = E_{Total,i(p),all-X,world,TY,BAU} - E_{NE,i(p),all-X,world,TY,BAU}$$

where

$ESOU_{i,industrial,C,BY_{IEA}}$ = Own-use of fuel i in the industrial sector of country C in IEA base year BY
(see IEA data discussed above)

$K_{ESOU,all-i(p),world,TY/BY}$ = Scalar for industrial ESOU in the target year vs. the base year, for all own-use fuels and countries

$EI_{NE,i(p),industrial,world,TY,BAU}$ = The global-average industrial-sector energy intensity of producing NE product $i(p)$ in year TY in the BAU scenario (BTU-own use/BTU- i) (discussed below)

⁵Note that we apply the EIA's projection of energy use for the entire industrial sector to the IEA's estimate of energy use in the industrial sector *excluding* EIOU, which we are treating separately. This is a potential problem if the EIA estimates EIOU or any component of it separately, and if the projected rate of change in energy use for EIOU (or its component) is likely to be different from the projected rate of change for the entire industrial sector. The EIA's industrial-sector model does not explicitly treat industrial-sector energy "own use" (EIOU). It does estimate changes in the energy intensity of production in different industries, based on exogenous trend and vintaging factors and endogenous effects of price on efficiency, but it does not estimate increases in energy intensity in fuel-producing industries due to shifts in fuel product mixes or decreasing quality of feedstocks (EIA, 2011b). Thus, it appears that we reasonably may apply the EIA's projection of energy use for the entire industrial sector to the IEA's industrial sector *excluding* EIOU.

$EI_{E,i(p),industrial,world,TY,BAU}$ = The global-average industrial-sector energy intensity of producing E product $i(p)$ (used for energy purposes) in year TY in the BAU (BTU-own use/BTU- i) (discussed below)

$E_{NE,i(p),all-X,world,TY,BAU}$ = Total all-sector, all-country (global) energy use of NE product $i(p)$ in year TY in the BAU

$E_{E,i(p),all-X,world,TY,BAU}$ = Total all-sector, all-country (global) energy use of E product $i(p)$ in year TY in the BAU

$E_{Total,i(p),all-X,world,TY,BAU}$ = Total all-sector, all-country (global) energy use of $i(p)$ for all purposes (energy and non-energy) in year TY in the BAU

$ESOU_{all-i,industrial,world,BY_{IEA}}$ = Total industrial ESOU of all fuels in all countries IEA base year BY (see IEA data discussed above)

Subscript $i(p)$ refers to the *production* of fuel i , as distinguished from *consumption* or end-use of fuel i , which is designated just i (the actual fuel/product categories are the same for i and $i(p)$)

Note that this calculation is circular, because the total quantity of energy used includes the total amount of own-use fuels, but as just noted the scalar that gives the total amount of own-use fuels depends on the total quantity of all fuels produced. This circularity is resolved satisfactorily by iterative calculations until trials and results converge.

Note also that we could have applied the calculated energy intensities (by end-use fuel product category) to each country's mix of end-use fuel products, but this would have resulted in unreasonable estimates of ESOU because in fact for many countries industrial ESOU is not related to that country's mix of end-use fuel products. (We verified this by testing this method against the IEA-reported ESOU by country for 2012, and found that in many cases the estimated country ESOU was quite different from the reported ESOU.)

Note that the energy-intensity term captures total industrial-sector own use energy – mainly energy for feedstock production (e.g., coal mining) and fuel processing (e.g., oil refining), but *not* including energy for transporting fuels – per energy unit of fuel i . That is, the numerator of the energy intensity term includes all own-use energy as defined for the IEA's *World Energy Balances*, described above, but it does not include non-industrial sector “own use” – e.g., fuel used by trucks transporting fuels. We account separately for this transportation-sector ESOU.

Finally, note that we use different notation to distinguish the production of fuel i ($i(p)$) from the consumption of fuel i .

The energy intensity EI is equal to the intensity calculated for the IEA base year multiplied by an assumed annual rate of change through the target year:

$$EI_{E,i(p),global,TY,BAU} = EI_{E,i(p),global,BY_{IEA}} \cdot e^{r_{EI,E,i(p)}(TY-BY_{IEA})}$$

$$EI_{NE,i(p),global,TY,BAU} = EI_{NE,i(p),global,BY_{IEA}} \cdot e^{r_{EI,NE,i(p)}(TY-BY_{IEA})}$$

where

$EI_{NE,i(p),global,BY_{IEA}}$ = The globally-average energy intensity of producing *NE* product *i(p)* in base-year *BY* (BTU-own use/BTU-*i(p)*) (discussed below)

$EI_{E,i(p),global,BY_{IEA}}$ = The globally-average energy intensity of producing *E* product *i(p)* in base-year *BY* (BTU-own use/BTU-*i(p)*) (discussed below)

$r_{EI,NE,i(p)}$ = The annual rate of change in the energy intensity of producing *NE* product *i(p)* (Table S2)

$r_{EI,E,i(p)}$ = The annual rate of change in energy intensity of producing *E* product *i(p)* (Table S2)

We assume that decreasing quality of crude oil and raw natural gas, along with increasingly stringent specifications for liquid fuels, will result in slight increases in the industrial-sector energy intensity of extracting and processing liquid fuels and natural gas. This appears to have been the case historically: the global all-product average energy intensity, estimated from the IEA data and shown in Figure S1, generally has increased over time, although since 2008 it has declined. The annual rates of change in the data of Figure S1 are

1971 to 2013: 0.43%/yr


1990 to 2013: 0.67%/yr

2000 to 2013: 0.47%/yr

2003 to 2013: 0.12%/yr

2008 to 2013: -0.70%/yr

Figure S1. Global-average EIOU energy intensity, 1971-2013.

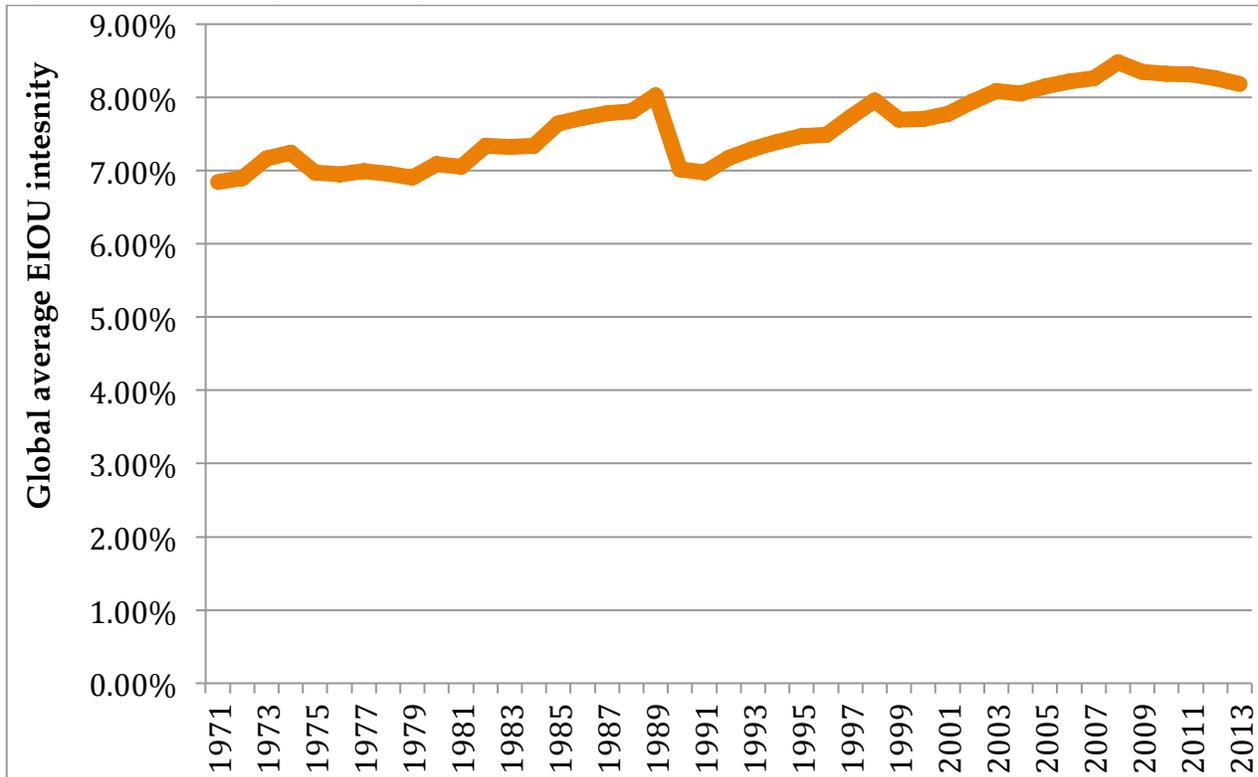

Source: IEA (2015c). The global-average intensity is equal to total EIOU reported by the IEA divided by total final consumption plus EIOU.

Note, though, that the global all-product average intensity also reflects shifts in the product mix, probably towards more energy intensive products, whereas our parameters $r_{EI,F,i(p)}$ and $r_{EI,NF,i(p)}$ represent the rate of change in the energy intensity of producing each fuel product i . In any event, consideration of the historical trend of Figure S1, along with our general knowledge of the energy intensity of producing different fuels (Delucchi et al., 2003) leads us to the assumptions of Table S2.

Table S2. Assumed annual rate of change in energy intensity of producing different products.

Fuel type	$r_{EI,NF,i(p)}$	$r_{EI,F,i(p)}$
Oil	0.15%	0.20%
Natural gas	0.10%	0.15%
Coal	0.00%	0.00%
Electricity	0.00%	0.00%
Heat	0.00%	0.00%
Renewables	0.00%	0.00%
Bio Fuels and Waste	0.00%	0.00%

The industrial-sector energy intensity to produce energy (E) or non-energy (NE) product $i(p)$ in the base year is equal to the average intensity over all products multiplied by the intensity of

energy or non-energy product $i(p)$ relative to the average the base year. We use this formulation because we can estimate the base-year sector-wide average intensity directly from the IEA data. Formally,

$$EI_{E,i(p),global,BY_{IEA}} = EI_{all-i(p),global,BY_{IEA}} \cdot R_{E,i(p),BY_{IEA}}$$

$$EI_{NE,i(p),global,BY_{IEA}} = EI_{all-i(p),global,BY_{IEA}} \cdot R_{NE,i(p),BY_{IEA}}$$

$$EI_{all-i(p),global,BY_{IEA}} = \frac{ESOU_{all-i,industrial,world,BY_{IEA}}}{E_{all-i,TFC,world,BY_{IEA}} + ESOU_{all-i,industrial,world,BY_{IEA}}}$$

where

$EI_{all-i(p),global,BY_{IEA}}$ = The average energy intensity of producing all products (E and NE), in the IEA data base year (BTU/BTU)

$R_{E,i(p),BY_{IEA}}$ = The industrial $ESOU$ energy-intensity of producing E product $i(p)$, relative to the average intensity, in IEA base year BY (discussed below)

$R_{NE,i(p),BY_{IEA}}$ = The industrial $ESOU$ energy-intensity of producing NE product $i(p)$, relative to the average intensity, in IEA base year BY (discussed below)

$ESOU_{all-i,industrial,world,BY_{IEA}}$ = Industrial sector “own use” of all fuels i , worldwide, in IEA base year BY (IEA *World Energy Balances*)

$E_{all-i,TFC,world,BY_{IEA}}$ = Total final (all-sector) consumption of all fuels i worldwide in IEA base year BY (IEA *World Energy Balances*)

The relative intensity parameters R must be specified such that the product of the relative intensity, the average intensity, and production, summed over all products, equals the actual reported industrial $ESOU$. To accomplish this, we specify R for all product categories except one, which we solve for using the equality constraint just described. The product categories for which we specify R are designated $i(p')$ and the solved-for product category is designated $i(p^*)$. We first develop our equality constraint,

$$ESOU_{all-i,industrial,world,BY} = ESOU_{NE,i,industrial,world,BY} + ESOU_{E,i,industrial,world,BY} =$$

$$\sum_{i(p)} \left[EI_{all-i(p),global,BY_{IEA}} \cdot R_{NE,i(p),BY_{IEA}} \cdot E_{NE,i(p),all-X,world,BY} + EI_{all-i(p),global,BY_{IEA}} \cdot R_{E,i(p),BY_{IEA}} \cdot E_{E,i(p),all-X,world,BY} \right]$$

$$= EI_{all-i(p),global,BY_{IEA}} \cdot \sum_{i(p)} \left[R_{NE,i(p),BY_{IEA}} \cdot E_{NE,i(p),all-X,world,BY} + R_{E,i(p),BY_{IEA}} \cdot E_{E,i(p),all-X,world,BY} \right]$$

Substituting for $ESOU_{all-i,industrial,world,BY}$ gives

$$ESOU_{all-i,industrial,world,BY_{IEA}} = \frac{ESOU_{all-i,industrial,world,BY_{IEA}}}{E_{all-i,TFC,world,BY_{IEA}} + ESOU_{all-i,industrial,world,BY_{IEA}}}$$

$$\cdot \sum_{i(p)} \left[R_{NE,i(p),BY_{IEA}} \cdot E_{NE,i(p),all-X,world,BY} + R_{E,i(p),BY_{IEA}} \cdot E_{E,i(p),all-X,world,BY} \right]$$

Define

$$Efr_{NE,i(p),all-X,industrial,world,BY_{IEA}} \equiv \frac{E_{NE,i(p),all-X,world,BY}}{E_{all-i,TFC,world,BY_{IEA}} + ESOU_{all-i,industrial,world,BY_{IEA}}}$$

$$Efr_{E,i(p),all-X,industrial,world,BY_{IEA}} \equiv \frac{E_{E,i(p),all-X,world,BY}}{E_{all-i,TFC,world,BY_{IEA}} + ESOU_{all-i,industrial,world,BY_{IEA}}}$$

Then we have

$$ESOU_{all-i,industrial,world,BY_{IEA}} = ESOU_{all-i,industrial,world,BY_{IEA}} \cdot$$

$$\sum_{i(p)} \left[R_{NE,i(p),BY_{IEA}} \cdot Efr_{NE,i(p),all-X,industrial,world,BY_{IEA}} + R_{E,i(p),BY_{IEA}} \cdot Efr_{E,i(p),all-X,industrial,world,BY_{IEA}} \right]$$

And finally,

$$1 = \sum_{i(p)} \left[R_{NE,i(p),BY_{IEA}} \cdot Efr_{NE,i(p),all-X,industrial,world,BY_{IEA}} + R_{E,i(p),BY_{IEA}} \cdot Efr_{E,i(p),all-X,industrial,world,BY_{IEA}} \right]$$

Distinguishing between the specified categories $i(p')$ and the solved-for category $i(p^*)$, we have

$$1 = R_{E,i(p^*),BY_{IEA}} \cdot Efr_{E,i(p^*),all-X,industrial,world,BY_{IEA}} + \sum_{i(p')} \left[R_{NE,i(p'),BY_{IEA}} \cdot Efr_{NE,i(p'),all-X,industrial,world,BY_{IEA}} + R_{E,i(p'),BY_{IEA}} \cdot Efr_{E,i(p'),all-X,industrial,world,BY_{IEA}} \right]$$

Our final solution for the category $i(p^*)$ is

$$R_{E,i(p^*),BY_{IEA}} = \frac{1 - \sum_{i(p')} \left[R_{NE,i(p'),BY_{IEA}} \cdot Efr_{NE,i(p'),all-X,industrial,world,BY_{IEA}} + R_{E,i(p'),BY_{IEA}} \cdot Efr_{E,i(p'),all-X,industrial,world,BY_{IEA}} \right]}{Efr_{E,i(p^*),all-X,industrial,world,BY_{IEA}}}$$

We pick values for $R_{NE,i(p'),BY_{IEA}}$ and $R_{E,i(p'),BY_{IEA}}$ so that they and the resultant $R_{E,i(p^*),BY_{IEA}}$ are consistent with our general knowledge of the relative energy intensity of producing different products (Table S3). Note that here we use global rather than country-specific values.

Table S3. Assumed relative energy intensity of producing different products.

Fuel type	$R_{NE,i(p'),BY_{IEA}}$	$R_{E,i(p'),BY_{IEA}}$
Oil	0.40	1.22*
Natural gas	0.30	1.10
Coal	0.20	0.70
Electricity	1.00	1.00
Heat	0.40	0.50
Renewables	0.40	1.00
Bio Fuels and Waste	0.40	1.10

Source: Based on Delucchi et al. (2003). * = R_{E,p^*}

S3.3. Projected End-Use Energy Consumption by Country, Sector, and Fuel in 2050, WWS

Energy use in the future WWS scenario is equal to energy use in the future BAU multiplied by an overall adjustment factor that accounts for the effects of electrification, the elimination of ESOU (energy-sector own-use), and extra energy efficiency measures.

Formally,

$$E_{i,X,C,TY,WWS} = E_{i,X,C,TY,BAU} \cdot AF_{i,X,C,TY,WWS/BAU}$$

where

$E_{i,X,C,TY,WWS}$ = Energy use in (the original BAU) fuel-type category i in sector X in country C in year TY in the WWS scenario

$E_{i,X,C,TY,BAU}$ = Projected end-use of fuel i in sector X in country C in year TY in the BAU scenario (discussed above)

$AF_{i,X,C,TY,WWS/BAU}$ = Adjustment factor for fuel-type category i in sector X in country C in year TY , for the WWS vs. the BAU scenario

The overall adjustment factor accounts for the effects on energy use of:

- Extra efficiency measures in the WWS scenario;
- Elimination of energy use for processing and transporting non-WWS energy products in the BAU (energy-sector own-use);
- The use of electricity or hydrogen rather than fossil fuels for combustion; considering effects upstream in the WWS system as well as end-use effects.

Formally,

$$AF_{i,X,C,TY,WWS/BAU} = EFF_{i,X,C,WWS/BAU} \cdot ESOUF_{i,X,C,TY,WWS/BAU} \cdot \left(EIF_{i,X,C,WWS} \cdot EIE_{eu,i,X,WWS/BAU} \cdot EIE_{up,i,X,WWS} + (1 - EIF_{i,X,C,WWS}) \cdot H2E_{eu,i,X,WWS/BAU} \cdot H2E_{up,i,X,WWS} \right)$$

where

$EFF_{i,X,C,WWS/BAU}$ = The effect of extra end-use efficiency measures in the WWS scenario: the ratio of energy use after the measure to energy use before the measure, for fuel-type category i in end-use sector X in country C

$ESOUF_{i,X,C,TY,WWS/BAU}$ = Factor to account for the elimination of (most) energy used for processing and transporting non-WWS energy products (mainly fossil fuels) in the BAU, for fuel-type i in sector X in country C in year TY

$EIF_{i,X,C,WWS}$ = Of end-use energy demand in fuel category i in sector X in country C in the BAU, the fraction that is met by direct use of electricity (as opposed to use of electrolytic hydrogen) in the WWS scenario

$EIE_{eu,i,X,WWS/BAU}$ = The ratio of end-use (eu) electrical energy in the WWS scenario to end-use fuel energy in the BAU scenario (holding energy services constant), for fuel category i in sector X (same for all countries and years)

$EIE_{up,i,X,WWS}$ = Factor to account for any upstream (up) energy needed to produce the direct electricity used in fuel category i in sector X in the WWS scenario (same for all countries and years)

$H2E_{eu,i,X,WWS/BAU}$ = The ratio of end-use (eu) hydrogen energy in the WWS scenario to end-use fuel energy in the BAU scenario (holding energy services constant), for fuel category i in sector X (same for all countries and years)

$H2E_{up,i,X,WWS}$ = Factor to account for any upstream (up) energy needed to produce the hydrogen used in fuel category i in sector X in the WWS scenario (same for all countries and years)

Table S4 shows most of the key parameter values in the analysis, for all sectors.

Table S4. Parameter values in the calculation of WWS energy use relative to the BAU.

Sector, fuel	Electricity:		Hydrogen : fuel ratio (end use) $H2E_{eu,i,X,WWS/BAU}$	Electricity upstream factor $EIE_{up,i,X,WWS}$	Hydrogen upstream factor $H2E_{up,i,X,WWS}$
	Extra efficiency measures $EFF_{i,X,C,WWS/BAU}$	fuel ratio (end use) $EIE_{eu,i,X,WWS/BAU}$			
Residential					
Oil	0.84	0.82	1.43	1.00	1.00
Natural gas	0.81	0.82	1.43	1.00	1.00
Coal	0.00	0.82	1.43	1.00	1.00
Electricity	0.77	1.00	1.00	1.00	1.00
Heat	1.00	1.00	1.00	1.00	1.00
Renewables	0.87	0.82	1.43	1.00	1.00
Biofuels/waste	0.87	0.82	1.43	1.00	1.00
Commercial					
Oil	0.95	0.82	1.43	1.00	1.00
Natural gas	1.01	0.82	1.43	1.00	1.00
Coal	1.00	0.82	1.43	1.00	1.00
Electricity	0.78	1.00	1.00	1.00	1.00
Heat	1.00	1.00	1.00	1.00	1.00
Renewables	1.00	0.82	1.43	1.00	1.00
Biofuels/waste	1.00	0.82	1.43	1.00	1.00
Industrial					
Oil	0.98	0.82	1.43	1.00	1.00
Natural gas	0.98	0.82	1.43	1.00	1.00
Coal	0.97	0.82	1.43	1.00	1.00
Electricity	0.92	1.00	1.00	1.00	1.00
Heat	1.00	1.00	1.00	1.00	1.00
Renewables	1.14	0.82	1.43	1.00	1.00
Biofuels/waste	1.00	0.82	1.43	1.00	1.00
Transportation					
Oil	0.96	0.19	0.64	1.00	1.18
Natural gas	0.88	0.82	1.43	1.00	1.00
Coal	0.00	1.00	1.43	1.00	1.00
Electricity	1.07	1.00	1.00	1.00	1.00
Heat	1.00	1.00	1.00	1.00	1.00
Renewables	1.00	1.00	1.43	1.00	1.00
Biofuels/waste	1.00	1.00	1.43	1.00	1.00
Agriculture/ forestry/fishing					
Oil	1.00	0.82	1.43	1.00	1.00
Natural gas	1.00	0.82	1.43	1.00	1.00
Coal	1.00	0.82	1.43	1.00	1.00
Electricity	1.00	1.00	1.00	1.00	1.00
Heat	1.00	1.00	1.00	1.00	1.00
Renewables	1.00	0.82	1.43	1.00	1.00
Biofuels/waste	1.00	0.82	1.43	1.00	1.00
Other					
Oil	1.00	0.82	1.43	1.00	1.00
Natural gas	1.00	0.82	1.43	1.00	1.00
Coal	1.00	0.82	1.43	1.00	1.00
Electricity	1.00	1.00	1.00	1.00	1.00
Heat	1.00	1.00	1.00	1.00	1.00
Renewables	1.00	0.82	1.43	1.00	1.00
Biofuels/waste	1.00	0.82	1.43	1.00	1.00

Extra energy efficiency measures in the WWS scenario (parameter $EFF_{i,X,C,WWS/BAU}$)

Our assumptions, shown in Table S4 are adapted from the analysis of Jacobson et al. (2015a) for the 50 U.S. states. See for comparison Table S4 from the Supplemental Information of Jacobson et al. (2015a). Although the extra-efficiency-measures parameter $EFF_{i,X,C,WWS/BAU}$ can be specified to be different for different countries, we have assumed here the same values for all countries.

Fraction of end-use energy demand met by electricity (parameter $EIF_{i,X,C,WWS}$)

We assume that all energy end uses can be 100% directly electrified, except for some solar and geothermal low-temperature heat and some hydrogen produced from electricity in the transportation sector. Any end-use demand not directly electrified is met by electrolytic hydrogen (produced by WWS power). Although the electrification-fraction parameter $EIF_{i,X,C,WWS}$ can be specified to be different for different countries, we have assumed here the same values for all countries.

Ratio of WWS energy to BAU fuel use in end use, and WWS upstream factors (parameters $EIE_{eu,i,X,WWS/BAU}$, $H2E_{eu,i,X,WWS/BAU}$, $EIE_{up,i,X,WWS}$ and $H2E_{up,i,X,WWS}$)

The parameters $EIE_{eu,i,X,WWS/BAU}$ and $H2E_{eu,i,X,WWS/BAU}$ express the end-use energy requirements of using electricity or hydrogen relative to the requirements of using BAU fuels, holding constant the service provided (e.g., heat for cooking or miles of travel). For example, in the case of heat for cooking, the parameter $EIE_{eu,i,X,WWS/BAU}$ can be BTUs of electricity, measured at the meter, per unit of heat transferred to the cooking object, relative to BTUs of natural gas, measured at the meter, per unit of heat transferred to the cooking object. In the case of transportation, these parameters are BTU/mi for electric vehicles (EVs) relative to BTU/mi for gasoline internal-combustion-engine vehicles (ICEVs), where the BTUs for the EV are measured at the electricity meter, going into the EV charger, and BTUs for the ICEV are measured at the gasoline pump nozzle. For hydrogen fuel-cell vehicles (FCVs), the BTUs are measured at the hydrogen dispenser outlet, going into the vehicle.

The values shown in Table S4 are adapted from Jacobson et al. (2015a). The values for hydrogen end-use ($H2E_{eu,i,X,WWS/BAU}$) assume that electrolytic hydrogen is produced only for transportation and with an electrolyzer at the site of end-use and therefore start with the energy content of the input electricity (rather than the energy content of the output hydrogen). The upstream adjustment for hydrogen ($H2E_{up,i,X,WWS}$) accounts for the electricity generated “upstream” for hydrogen compression or liquefaction.⁶

⁶ Note that because the factors $H2E_{eu,i,X}$ and $H2E_{up,i,X}$ are multiplicative it doesn't matter whether we show one under “end use” and one under “upstream”, and then multiply them together, or multiply them together and show the result under “upstream.” We have chosen to classify and show them separately, even though the distinction between “upstream” and “end use” in this case is arbitrary, because it makes the individual assumptions explicit.

Elimination of energy-sector own-use: energy to process and transport BAU energy products other than wind, water, and solar power (parameter $ESOUF_{i,X,C,TY,WWS/BAU}$)

In the 100% WWS scenario, no end-use energy will be needed to produce and transport fossil-fuels, nuclear energy, or bioenergy. For example, the 100% WWS scenario will eliminate energy used by petroleum refineries, natural-gas pipelines, and oil tankers. Here we estimate the adjustment-factor components that account for own-use energy in the industrial sector to produce fossil fuels, and own-use energy in the transport sector to transport fossil fuels.

Own-use energy eliminated in the industrial sector ($ESOUF_{i,industrial,C,TY,WWS/BAU}$)

The BAU industrial sector uses energy to produce different kinds of fossil-fuel based products $i(p)$ for energy (E) and non-energy (NE) purposes. This use of energy is referred to as “own use” in the industrial sector. As discussed above, the IEA reports total (all-purpose) $ESOUF_{industrial}$ for each country. (The IEA also breaks out $ESOUF_{industrial}$ by type of own-use fuel, but for our purposes in this section this breakout is not relevant.) In a WWS world, all of the products used for energy (E) purposes will be replaced by WWS energy, but only some (presumably small) fraction of the products used for NE purposes will be replaced by WWS energy. This means that in the WWS energy-use scenario, we must subtract all $ESOUF_{industrial}$ for E products, but only some fraction of the $ESOUF_{industrial}$ for NE products. Designating the final amount of energy-industry own-use to be subtracted as $EIOU^*$, we have

$$ESOUF_{i,industrial,C,TY,WWS/BAU} = \frac{E_{i,industrial,C,TY,BAU} - ESOU^*_{i,industrial,C,TY,BAU}}{E_{i,industrial,C,TY,BAU}} = 1 - \frac{ESOU^*_{i,industrial,C,TY}}{E_{i,industrial,C,TY,BAU}}$$

where

$ESOUF_{i,industrial,C,TY,WWS/BAU}$ = Factor to account for the elimination of (most) energy used in the industrial sector to process non-WWS energy products (mainly fossil fuels): the ratio of industrial-sector energy use of i in country C in year TY in the WWS scenario to industrial-sector energy use of i in country C in year TY in the BAU

$E_{i,industrial,C,TY,BAU}$ = Use of fuel i in the industrial sector of country C in year TY in the BAU (includes all industrial $ESOU$ and all use of replaceable non-energy products as well as all other industrial-sector energy use) (estimated as described above)

$ESOU^*_{i,industrial,C,TY,BAU}$ = Industrial energy-sector own-use of i in country C in year TY in the BAU , to produce products that will be replaced by WWS power: all energy (E) products and the replaceable portion of non-energy (NE) products

The industrial-sector own use, $ESOU^*_{i,industrial,C,TY,BAU}$, is the product of the industrial-sector energy intensity of fuel production and total fuel production, for E and replaceable NE products:

$$ESOU^*_{i,industrial,C,TY,BAU} = \sum_{i(p)} EI_{NE,i(p),industrial,world,TY,BAU} \cdot E_{NE,i(p),all-X,world,TY,BAU} \cdot RF_{NE,i(p)} + \sum_{i(p)} EI_{E,i(p),industrial,world,TY,BAU} \cdot E_{E,i(p),all-X,world,TY,BAU}$$

where all terms are defined and specified above in the subsection “Projections of end-use energy consumption in the BAU industrial sector.”

Own-use energy eliminated in the transport sector ($ESOUF_{i,transport,C,TY,WWS/BAU}$)

As discussed next, a small but nontrivial amount of petroleum end-use in the transport sector is for shipment of coal and petroleum products. This “own use” will be eliminated in the 100% WWS scenario. As noted above, the IEA does not include transport-sector energy “own-use” in its estimates of EIOU, so we must estimate it ourselves.

Table S5 shows ton-miles of movement of coal and petroleum products by truck, rail, water, and pipeline transport (*2012 Commodity Flow Survey [CFS]*, U. S. Bureau of Transportation Statistics and U. S. Census Bureau, 2015). The *CFS* data indicate that in 2012 transport of coal and petroleum products accounted for 55% of ton-miles by rail, 24% of ton-miles by water, 8% of ton-miles by truck, and 95% of ton-miles by pipeline. (Note that the *CFS* excludes shipment of crude oil and natural gas, which if included would increase the fossil-fuel share of total ton-miles by water and pipeline, but also excludes shipment of forestry and some agricultural commodities, which if included would decrease the fossil-fuel share of ton-miles by truck.) In the U. S. in 2012, medium and heavy trucks used 21.6% of all petroleum used in transport, freight ships used 3.3%, and freight rail used 1.9% (Davis et al., 2015). Combining these shares of transport petroleum use with the ton-mile shares from Table S5, we estimate that shipment of fossil fuels accounted for about 4% of all petroleum end use in the transport sector in the U. S. in 2012.

Table S5. Transport of fossil fuels by mode (ton-miles).

Rail	Ton-miles	% of total
All commodities	1,211,481	100.0%
Coal	609,335	50.3%
Petroleum products	19,682	1.6%
Fuel oil	3,187	0.3%
Other coal & oil	29,582	2.4%
<i>Coal+petroleum</i>	<i>661,786</i>	<i>54.6%</i>
Water	Ton-miles	% of total
All commodities	192,866	100.0%
Coal	1,075	0.6%
Petroleum products	19,779	10.3%
Fuel oil	8,888	4.6%
Other coal & oil	16,884	8.8%
Coal+petroleum	46,626	24.2%
Truck	Ton-miles	% of total
All commodities	1,247,717	100.0%
Coal	9,848	0.8%
Petroleum products	28,183	2.3%
Fuel oil	20,530	1.6%
Other coal & oil	47,539	3.8%
<i>Coal+petroleum</i>	<i>106,100</i>	<i>8.5%</i>
Pipeline	Tons	% of total
All commodities	635,975	100.0%
Coal	0	0.0%
Petroleum products	342,839	53.9%

Fuel oil	233,424	36.7%
Other coal & oil	29,950	4.7%
<i>Coal+petroleum</i>	606,213	95.3%

Source: U. S. Bureau of Transportation Statistics and U. S. Census Bureau (2015).

Following the method established for own-use energy eliminated in the industrial sector, we have

$$ESOUF_{i,transport,C,TY,WWS/BAU} = 1 - \frac{ESOU^*_{i,transport,C,TY}}{E_{i,transport,C,TY,BAU}}$$

$$ESOUF_{i,transport,C} = \frac{E_{i,X,C} - ESOU^*_{i,transport,C}}{E_{i,transport,C}} = 1 - \frac{ESOU^*_{i,transport,C}}{E_{i,transport,C}}$$

where

$ESOUF_{i,transport,C,TY,WWS/BAU}$ = Factor to account for the elimination of (most) energy used in the transport sector to transport non-WWS energy products (mainly fossil fuels): the ratio of transport-sector energy use of i in country C in year TY in the WWS scenario to transport-sector energy use of i in country C in year TY in the BAU

$E_{i,transport,C,TY,BAU}$ = Use of fuel i in the transport sector of country C in year TY in the BAU (includes all transport $ESOU$ and transport of replaceable non-energy products as well as all other transport-sector energy use) (estimated as described above)

$ESOU^*_{i,transport,C,TY,BAU}$ = Transport energy-sector own-use of i in country C in year TY in the BAU , to transport products that will be replaced by WWS power: all energy (E) products and the replaceable portion of non-energy (NE) products

For simplicity we define:

$$\frac{ESOU^*_{i,transport,C}}{E_{i,transport,C}} \equiv ESOUF^*_{i,transport,C}$$

and hence

$$ESOUF_{i,transport,C} = 1 - ESOUF^*_{i,transport,C}$$

where

$ESOUF^*_{i,transport,C}$ = Of total use of fuel i in the transport sector in country C , the fraction that is used to transport fossil fuels, nuclear materials, and biofuels used for energy purposes.

The Lifecycle Emissions Model (Delucchi et al., 2003) provides results that allow us to estimate $ESOUF^*$.

$$ESOUF^*_{liquids,transport} = 0.02$$

$$ESOUF^*_{NG,transport} = 0.75$$

$$ESOUF^*_{El,transport} = 0.50$$

(Note that in the accompanying spreadsheet, the quantity entered is *ESOUF*, not *ESOUF**.)

The EIA's *IEO* projects freight ton-miles and ton-miles per BTU by mode (heavy trucks, other trucks, rail, domestic water, and international water), fuel (gasoline, diesel, LPG, coal, electricity, natural gas, and renewables), and region (EIA, 2011a). Demand for freight service is projected as a function of GDP, fuel price, and, in some cases, a trend factor representing exogenous effects of, for example, improvements in efficiency (EIA, 2011a). Shares of different fuels are held fixed at the base-year values. Base-year data in the model are from the IEA's *World Energy Balances*.

S3.4. Summary of BAU and WWS Loads for Each of 139 Countries

Table S6 projects 139-country BAU and WWS end-use power demands to 2050. Table 1 of the main text summarizes results over all countries. End-use power is the power in delivered electricity or fuel (e.g., gasoline) that is actually used to provide services such as heating, cooling, lighting, and transportation. It excludes losses during the production and transmission of the electricity or fuel but includes industry self-energy-use for mining, transporting, and refining fossil fuels. All end uses that feasibly can be electrified use WWS electricity directly, but WWS electricity is also used to produce electrolytic hydrogen for some transportation.

Table S6. 1st row of each country: estimated 2050 total annually-averaged end-use load (GW) and percent of the total load by sector if conventional fossil-fuel, nuclear, and biofuel use continue from today to 2050 under a BAU trajectory. 2nd row of each country: estimated 2050 total end-use load (GW) and percent of total load by sector if 100% of BAU end-use all-purpose delivered load in 2050 is instead provided by WWS. The last column shows the percent reductions in total 2050 BAU load due to switching from BAU to WWS, including the effects of (a) energy use reduction due to the higher work to energy ratio of electricity over combustion, (b) eliminating energy use for the upstream mining, transporting, and/or refining of coal, oil, gas, biofuels, bioenergy, and uranium, and (c) policy-driven increases in end-use efficiency beyond those in the BAU case.

Country	Scenario	2050 Total end-use load (GW)	Residential percent of total end-use load	Commercial percent of total end-use load	Industrial percent of total end-use load	Transport percent of total end-use load	Ag/For /Fishing percent of total end-use load	Other percent of total end-use load	(a) Percent change end-use load w/WWS due to higher work: energy ratio	(b) Percent change end-use load w/WWS due to eliminating upstream	(c) Percent change end-use load w/WWS due to efficiency beyond BAU	Overall percent change in end-use load with WWS
Albania	BAU	4.1	33.5	11.9	13.8	37.4	3.3	0.2				
	WWS	2.1	47.9	17.7	7.0	21.7	5.4	0.3	-28.94	-8.82	-9.77	-47.53
Algeria	BAU	144.4	15.1	0.0	20.8	59.5	0.3	4.2				
	WWS	53.8	28.3	0.0	24.2	36.6	0.8	10.0	-29.29	-26.79	-6.70	-62.77
Angola	BAU	29.8	43.6	7.1	13.2	35.9	0.1	0.1				
	WWS	15.1	61.9	10.9	5.3	21.6	0.1	0.1	-32.83	-9.28	-7.25	-49.35
Argentina	BAU	166.3	21.0	6.0	28.5	41.7	2.9	0.0				
	WWS	79.8	30.3	9.8	32.1	22.8	5.0	0.0	-24.34	-20.12	-7.56	-52.01
Armenia	BAU	4.9	37.1	7.9	11.9	33.2	0.3	9.6				
	WWS	2.4	52.5	12.6	4.5	13.3	0.6	16.5	-16.02	-24.10	-10.52	-50.64

Australia	BAU	212.3	11.6	12.4	40.9	33.3	1.8	0.1				
	WWS	118.9	15.1	17.2	46.6	18.2	2.7	0.2	-26.25	-10.71	-7.04	-43.99
Austria	BAU	50.5	22.9	10.7	31.8	33.0	1.5	0.0				
	WWS	29.8	28.9	15.3	32.5	21.1	2.2	0.0	-21.22	-13.08	-6.70	-41.01
Azerbaijan	BAU	19.4	37.1	9.3	22.8	27.8	3.0	0.0				
	WWS	10.8	46.6	13.3	19.7	15.8	4.6	0.0	-26.11	-8.79	-9.41	-44.31
Bahrain	BAU	15.4	15.5	9.0	48.2	27.3	0.1	0.0				
	WWS	9.3	19.6	11.6	54.8	13.8	0.1	0.0	-23.32	-8.61	-7.83	-39.76
Bangladesh	BAU	70.9	36.7	2.1	24.8	31.7	4.5	0.2				
	WWS	37.7	49.2	3.1	27.7	12.4	7.1	0.5	-18.93	-19.41	-8.45	-46.79
Belarus	BAU	40.9	30.9	14.8	29.6	21.1	3.6	0.0				
	WWS	27.5	37.6	19.5	28.6	9.7	4.7	0.0	-17.07	-9.32	-6.34	-32.73
Belgium	BAU	68.2	20.8	12.8	29.8	35.1	1.4	0.1				
	WWS	37.6	26.2	18.5	31.3	21.7	2.1	0.2	-27.87	-9.85	-7.20	-44.92
Benin	BAU	9.0	37.0	10.3	2.0	50.8	0.0	0.0				
	WWS	3.9	60.6	19.1	-15.3	35.6	0.0	0.0	-40.11	-9.64	-6.67	-56.42
Bolivia	BAU	16.1	11.7	2.8	23.7	51.7	6.0	4.1				
	WWS	6.7	20.2	5.2	26.5	28.0	12.1	8.0	-27.23	-24.92	-5.91	-58.06
Bosnia and Herzegovina	BAU	6.6	34.1	0.0	23.5	32.5	0.2	9.8				
	WWS	3.8	44.1	0.0	22.6	17.8	0.3	15.2	-25.79	-7.97	-9.21	-42.97
Botswana	BAU	5.9	21.9	5.4	21.9	44.0	1.5	5.4				
	WWS	3.0	31.4	8.3	22.4	26.4	2.7	8.8	-34.72	-7.94	-6.44	-49.10
Brazil	BAU	550.6	8.9	5.2	42.8	39.0	3.8	0.2				
	WWS	315.9	11.6	7.1	48.4	27.0	5.7	0.2	-27.06	-10.56	-5.00	-42.62
Brunei Darussalam	BAU	6.2	8.6	10.7	48.3	32.3	0.0	0.0				
	WWS	3.5	11.7	14.9	55.8	17.7	0.0	0.0	-29.09	-9.03	-6.03	-44.15
Bulgaria	BAU	22.3	27.4	14.4	27.1	30.0	1.2	0.0				
	WWS	13.1	34.9	19.6	28.0	15.8	1.7	0.0	-21.30	-10.67	-9.38	-41.35
Cambodia	BAU	12.3	44.1	2.7	17.8	33.0	0.0	2.4				
	WWS	6.5	60.4	4.0	12.7	19.1	0.0	3.8	-31.18	-9.06	-7.18	-47.42
Cameroon	BAU	25.4	31.3	47.9	6.0	14.8	0.1	0.0				
	WWS	17.6	32.4	56.6	4.4	6.5	0.1	0.0	-22.86	-2.69	-5.21	-30.76
Canada	BAU	389.5	14.5	12.0	45.0	23.9	2.5	2.2				
	WWS	240.3	16.9	15.2	47.6	13.3	3.4	3.5	-21.55	-10.22	-6.55	-38.32
Chile	BAU	78.0	16.6	8.6	30.8	43.2	0.8	0.0				
	WWS	37.3	25.1	14.1	38.2	21.3	1.3	0.0	-22.87	-21.90	-7.44	-52.20
China	BAU	5404.1	19.2	3.5	47.4	26.5	1.4	2.0				
	WWS	3291.6	22.7	4.6	56.8	10.8	2.0	3.1	-15.63	-16.42	-7.04	-39.09
Chinese Taipei	BAU	167.1	10.9	8.5	45.6	31.4	0.9	2.8				
	WWS	99.8	13.7	11.1	52.3	17.0	1.4	4.6	-25.13	-8.47	-6.70	-40.30
Colombia	BAU	67.4	16.1	6.2	28.8	44.5	4.3	0.1				
	WWS	32.6	24.0	10.1	32.1	26.2	7.4	0.2	-32.06	-13.21	-6.36	-51.64
Congo	BAU	4.7	48.2	0.8	4.0	44.6	0.0	2.3				
	WWS	2.3	69.9	1.3	-2.6	27.5	0.0	3.9	-36.66	-6.06	-7.74	-50.46
Congo, Dem. Republic of	BAU	43.8	61.7	0.2	31.0	7.1	0.0	0.0				
	WWS	28.3	68.4	0.2	28.0	3.4	0.0	0.0	-19.35	-8.31	-7.69	-35.35
Costa Rica	BAU	7.7	15.1	11.8	18.0	53.2	1.4	0.5				
	WWS	3.5	25.2	20.3	14.9	36.0	2.8	0.9	-38.19	-9.52	-7.13	-54.85
Cote d'Ivoire	BAU	16.2	57.2	12.7	9.9	18.5	1.5	0.0				
	WWS	10.2	65.2	16.2	7.6	9.0	2.0	0.0	-23.85	-4.09	-8.86	-36.81
Croatia	BAU	14.3	32.0	15.8	21.8	28.2	2.1	0.0				
	WWS	8.2	41.5	21.9	17.6	16.0	3.0	0.0	-24.86	-8.72	-9.08	-42.66
Cuba	BAU	11.7	21.6	6.0	52.2	12.5	2.0	5.7				
	WWS	7.7	24.3	7.0	52.1	6.9	2.6	7.0	-17.88	-8.96	-6.85	-33.69
Cyprus	BAU	4.2	19.6	16.9	6.3	55.5	1.3	0.5				
	WWS	1.8	33.2	29.9	-6.6	39.9	2.6	1.0	-38.41	-9.29	-8.47	-56.17
Czech Republic	BAU	43.4	25.2	13.7	34.2	24.1	1.9	0.9				
	WWS	27.6	28.1	17.7	35.0	15.3	2.5	1.4	-18.93	-9.52	-7.94	-36.39
Denmark	BAU	26.9	29.4	14.7	22.6	28.7	4.5	0.1				
	WWS	16.8	38.8	20.1	18.5	16.3	6.3	0.1	-22.86	-8.34	-6.45	-37.64

Dominican Republic	BAU	12.6	19.9	7.1	20.6	50.9	1.5	0.0				
	WWS	5.8	31.6	12.0	20.1	33.3	3.1	0.0	-36.65	-9.96	-7.16	-53.77
Ecuador	BAU	27.0	11.1	3.9	27.4	55.3	0.6	1.6				
	WWS	11.9	18.5	6.8	31.7	38.5	1.2	3.3	-40.54	-10.10	-5.43	-56.06
Egypt	BAU	214.4	17.1	6.4	27.0	44.5	3.7	1.2				
	WWS	102.3	26.7	10.4	29.9	24.2	6.7	2.1	-27.66	-17.27	-7.35	-52.28
El Salvador	BAU	5.4	22.7	3.4	22.0	50.0	0.2	1.7				
	WWS	2.5	35.6	5.7	21.9	32.8	0.5	3.5	-37.30	-9.65	-6.52	-53.47
Eritrea	BAU	1.1	71.1	8.5	3.4	17.0	0.0	0.0				
	WWS	0.7	80.6	10.7	0.5	8.2	0.0	0.0	-23.27	-3.13	-10.20	-36.61
Estonia	BAU	5.9	30.2	14.8	23.2	29.1	2.7	0.0				
	WWS	3.6	40.1	19.9	20.8	15.5	3.7	0.0	-23.38	-8.21	-7.03	-38.62
Ethiopia	BAU	71.4	86.8	1.9	3.4	7.1	0.4	0.5				
	WWS	48.7	91.1	2.3	2.4	3.2	0.4	0.6	-19.63	-1.42	-10.77	-31.82
Finland	BAU	43.4	23.5	14.2	41.6	17.3	2.5	0.9				
	WWS	29.9	27.8	17.2	41.6	9.2	3.2	1.0	-16.03	-8.30	-6.60	-30.93
France	BAU	267.2	28.6	17.5	20.9	29.8	2.3	0.9				
	WWS	158.0	35.0	23.5	16.7	20.1	3.3	1.4	-23.09	-9.10	-8.66	-40.85
Gabon	BAU	5.7	39.2	2.8	29.6	27.4	0.6	0.4				
	WWS	3.2	50.6	3.9	28.8	15.0	0.9	0.7	-28.03	-9.09	-6.87	-43.99
Georgia	BAU	6.4	41.8	8.5	17.6	28.6	3.2	0.5				
	WWS	3.6	52.6	11.9	13.4	16.5	4.8	0.7	-24.99	-8.67	-9.88	-43.54
Germany	BAU	379.2	25.9	16.6	29.7	27.7	0.0	0.1				
	WWS	226.3	31.0	22.4	29.6	16.9	0.0	0.1	-21.97	-10.33	-8.03	-40.33
Ghana	BAU	18.9	25.0	4.3	22.0	46.8	1.9	0.0				
	WWS	9.0	38.2	7.2	21.3	30.1	3.2	0.0	-36.60	-9.57	-6.34	-52.51
Gibraltar	BAU	6.0	0.0	0.0	0.1	99.6	0.0	0.3				
	WWS	1.3	0.0	0.1	-39.9	138.2	0.0	1.6	-63.13	-11.17	-3.72	-78.01
Greece	BAU	35.5	24.4	12.9	24.8	34.8	1.3	1.7				
	WWS	19.3	32.8	18.5	23.5	20.3	2.3	2.6	-27.81	-9.63	-8.33	-45.78
Guatemala	BAU	15.0	51.4	4.8	9.5	34.3	0.0	0.0				
	WWS	8.2	67.6	6.9	6.2	19.2	0.0	0.0	-31.22	-5.58	-8.62	-45.42
Haiti	BAU	4.4	70.8	2.2	7.3	19.7	0.0	0.0				
	WWS	2.5	89.5	3.1	-3.2	10.6	0.0	0.0	-25.80	-8.63	-8.94	-43.38
Honduras	BAU	8.1	36.5	5.3	23.2	33.0	0.0	2.0				
	WWS	4.3	49.6	7.8	20.6	18.9	0.0	3.1	-30.26	-9.06	-7.40	-46.72
Hong Kong, China	BAU	76.9	5.9	15.8	7.6	70.7	0.0	0.0				
	WWS	27.5	11.3	34.4	-6.1	60.3	0.0	0.1	-47.23	-9.81	-7.15	-64.19
Hungary	BAU	27.1	34.5	19.8	21.4	22.3	2.1	0.0				
	WWS	16.8	39.6	25.9	17.3	14.3	2.9	0.0	-20.83	-8.36	-8.78	-37.97
Iceland	BAU	4.5	16.5	13.6	47.1	15.2	7.4	0.3				
	WWS	3.4	20.4	16.2	48.3	6.5	8.3	0.3	-11.98	-6.89	-5.85	-24.73
India	BAU	1709.4	24.2	4.1	37.3	27.9	4.1	2.4				
	WWS	996.0	30.0	5.6	40.0	14.4	6.6	3.6	-24.59	-10.77	-6.37	-41.73
Indonesia	BAU	427.6	27.5	4.6	30.5	35.6	1.6	0.2				
	WWS	226.7	37.5	6.7	31.9	21.0	2.5	0.3	-31.23	-9.29	-6.46	-46.98
Iran, Islamic Republic of	BAU	434.6	21.6	4.9	37.3	32.0	4.1	0.2				
	WWS	231.4	27.9	7.3	42.1	15.4	6.9	0.4	-24.42	-15.55	-6.78	-46.75
Iraq	BAU	60.5	17.4	1.3	22.7	49.5	0.0	9.2				
	WWS	29.0	26.4	2.0	20.9	31.5	0.0	19.1	-36.52	-9.87	-5.69	-52.08
Ireland	BAU	16.9	25.9	14.9	22.4	34.8	2.0	0.0				
	WWS	8.7	31.5	22.8	21.0	21.4	3.4	0.0	-29.18	-8.93	-10.15	-48.26
Israel	BAU	27.3	22.1	14.7	21.7	28.7	0.9	12.0				
	WWS	15.9	28.0	19.5	18.7	15.0	1.5	17.2	-24.82	-8.41	-8.52	-41.75
Italy	BAU	240.8	25.8	13.5	25.7	33.3	1.7	0.1				
	WWS	134.9	32.3	19.2	25.5	20.4	2.5	0.1	-22.65	-13.44	-7.87	-43.96
Jamaica	BAU	4.1	9.5	9.6	30.8	47.5	2.4	0.1				
	WWS	2.0	14.8	15.7	34.9	30.3	4.2	0.2	-36.73	-9.81	-5.59	-52.13
Japan	BAU	411.8	16.8	24.6	33.2	24.3	0.8	0.2				
	WWS	250.8	20.1	32.0	32.6	13.9	1.1	0.3	-21.80	-9.52	-7.77	-39.09

Jordan	BAU	14.7	21.4	7.3	21.5	44.0	3.2	2.7				
	WWS	7.4	31.7	11.3	19.5	26.7	6.3	4.4	-33.11	-9.18	-7.44	-49.73
Kazakhstan	BAU	114.1	13.2	4.9	69.0	9.6	0.9	2.4				
	WWS	81.1	13.7	6.0	71.6	4.6	1.2	2.9	-16.23	-7.68	-4.99	-28.90
Kenya	BAU	31.2	62.1	1.3	9.7	26.3	0.2	0.4				
	WWS	18.3	76.0	1.7	7.8	13.7	0.2	0.5	-28.03	-4.36	-9.01	-41.40
Korea, Dem. People's Rep.	BAU	32.3	0.8	0.0	65.5	4.6	0.0	29.2				
	WWS	24.2	0.8	0.0	64.2	1.9	0.0	33.2	-17.09	-5.72	-2.23	-25.04
Korea, Republic of	BAU	326.8	11.9	17.4	41.0	27.5	1.6	0.6				
	WWS	193.9	14.3	23.0	46.2	13.2	2.5	0.8	-21.17	-11.66	-7.82	-40.65
Kosovo	BAU	3.0	48.2	10.7	16.8	23.4	0.9	0.0				
	WWS	1.7	60.8	14.3	11.2	12.3	1.3	0.0	-21.98	-8.49	-11.52	-41.98
Kuwait	BAU	60.0	15.9	7.0	52.4	24.7	0.0	0.0				
	WWS	35.9	20.3	9.1	58.0	12.6	0.0	0.0	-24.56	-8.91	-6.73	-40.19
Kyrgyzstan	BAU	7.5	31.4	10.1	13.2	36.8	1.6	6.8				
	WWS	4.2	45.2	14.7	7.3	20.2	2.5	10.0	-27.57	-8.28	-8.51	-44.36
Latvia	BAU	8.8	34.2	19.1	14.8	29.6	2.2	0.0				
	WWS	5.3	45.9	26.5	8.4	16.0	3.1	0.0	-24.86	-8.33	-7.00	-40.19
Lebanon	BAU	11.3	28.6	6.3	14.5	44.7	0.0	5.8				
	WWS	5.6	42.3	9.8	8.9	27.4	0.0	11.6	-32.68	-9.00	-8.46	-50.14
Libya	BAU	36.0	9.3	6.1	14.7	59.6	1.0	9.4				
	WWS	15.7	15.6	10.7	8.2	41.6	2.4	21.4	-41.07	-9.80	-5.39	-56.26
Lithuania	BAU	11.8	29.6	14.5	25.4	29.2	1.2	0.0				
	WWS	7.1	39.1	20.2	23.2	15.8	1.7	0.0	-23.46	-8.82	-7.01	-39.29
Luxembourg	BAU	6.5	12.0	15.8	14.4	57.2	0.5	0.0				
	WWS	2.9	18.7	28.7	9.1	42.5	1.0	0.0	-39.31	-9.63	-6.32	-55.26
Macedonia, Republic of	BAU	4.0	36.9	16.4	22.9	23.0	0.8	0.0				
	WWS	2.4	46.7	21.4	19.2	11.7	1.1	0.0	-20.66	-8.31	-10.48	-39.46
Malaysia	BAU	158.0	8.0	11.1	40.2	39.0	1.7	0.0				
	WWS	83.9	11.3	16.2	47.8	22.1	2.6	0.0	-29.82	-10.84	-6.22	-46.88
Malta	BAU	3.6	6.8	7.0	2.2	83.8	0.2	0.1				
	WWS	1.1	17.1	18.2	-22.4	86.2	0.5	0.4	-54.13	-10.47	-5.57	-70.18
Mexico	BAU	326.4	13.0	5.3	39.7	38.6	2.7	0.8				
	WWS	173.2	18.0	7.8	46.7	21.6	4.3	1.5	-30.08	-11.14	-5.71	-46.94
Moldova, Republic of	BAU	4.4	44.0	15.3	21.7	17.1	1.5	0.5				
	WWS	2.8	50.9	20.4	17.5	8.5	1.9	0.8	-18.84	-8.21	-10.01	-37.06
Mongolia	BAU	9.0	19.5	6.1	35.7	26.3	2.2	10.3				
	WWS	5.8	21.1	9.5	38.6	14.2	2.9	13.8	-21.54	-7.35	-7.43	-36.32
Montenegro	BAU	1.5	48.6	1.4	19.2	30.0	0.4	0.5				
	WWS	0.8	64.0	2.1	16.3	16.4	0.5	0.7	-24.67	-8.55	-10.47	-43.68
Morocco	BAU	45.2	15.8	8.4	23.0	41.7	11.0	0.0				
	WWS	23.2	22.6	13.1	21.1	25.3	17.9	0.0	-33.15	-9.68	-5.90	-48.73
Mozambique	BAU	20.9	59.9	0.7	26.7	12.5	0.1	0.0				
	WWS	13.1	68.7	0.9	24.4	5.8	0.1	0.0	-19.87	-9.05	-8.48	-37.41
Myanmar	BAU	33.6	59.9	2.0	16.3	17.4	1.2	3.3				
	WWS	19.5	74.3	2.6	9.7	7.0	1.6	4.8	-19.61	-13.70	-8.76	-42.07
Namibia	BAU	4.6	4.1	0.1	11.4	47.5	17.2	19.7				
	WWS	2.4	5.6	0.1	2.2	28.0	27.3	36.7	-35.48	-10.08	-2.74	-48.31
Nepal	BAU	20.6	75.1	2.3	7.5	13.3	1.6	0.1				
	WWS	12.3	90.1	3.1	-2.3	6.9	2.2	0.2	-22.40	-8.27	-9.54	-40.21
Netherlands	BAU	114.7	16.6	14.7	28.8	35.6	4.3	0.0				
	WWS	63.3	21.0	21.6	29.4	21.3	6.7	0.0	-29.34	-9.25	-6.25	-44.84
Netherlands Antilles	BAU	6.8	0.9	0.0	29.8	68.6	0.0	0.7				
	WWS	2.5	1.7	0.0	40.6	55.9	0.0	1.8	-48.41	-10.76	-3.40	-62.57
New Zealand	BAU	31.1	11.6	13.5	35.9	34.0	4.7	0.3				
	WWS	17.6	15.4	18.6	39.6	18.5	7.4	0.5	-27.71	-8.94	-6.91	-43.56
Nicaragua	BAU	4.0	36.5	11.0	15.4	35.3	1.8	0.0				
	WWS	2.1	50.6	16.4	9.3	20.6	3.0	0.1	-30.94	-9.16	-7.71	-47.82
Nigeria	BAU	260.2	64.0	4.1	17.2	12.4	0.0	2.3				
	WWS	159.3	75.0	5.4	10.3	6.2	0.0	3.1	-22.09	-8.49	-8.22	-38.80

Norway	BAU	46.4	18.5	14.0	44.6	20.0	2.6	0.3				
	WWS	29.7	22.1	17.4	46.6	10.1	3.5	0.3	-16.94	-10.71	-8.45	-36.10
Oman	BAU	54.6	6.9	4.0	64.6	21.9	0.1	2.5				
	WWS	33.5	8.6	5.1	71.9	10.9	0.2	3.3	-25.20	-9.15	-4.29	-38.64
Pakistan	BAU	206.0	36.8	3.4	24.4	34.3	0.9	0.1				
	WWS	103.2	52.4	5.4	24.4	15.8	1.8	0.2	-22.95	-18.95	-8.01	-49.91
Panama	BAU	15.5	7.6	7.2	10.1	74.9	0.2	0.0				
	WWS	5.2	16.6	16.6	-1.2	67.6	0.4	0.0	-50.34	-10.33	-5.52	-66.19
Paraguay	BAU	8.7	25.8	8.1	23.2	42.9	0.0	0.0				
	WWS	4.5	37.1	12.3	22.1	28.5	0.0	0.0	-32.52	-9.16	-7.23	-48.91
Peru	BAU	40.8	14.5	5.8	27.9	50.0	1.8	0.0				
	WWS	18.9	22.9	9.8	32.5	31.5	3.3	0.0	-30.77	-16.60	-6.28	-53.65
Philippines	BAU	76.8	19.1	12.7	24.8	42.3	1.1	0.0				
	WWS	39.6	27.4	19.1	24.8	26.8	1.9	0.0	-32.14	-9.12	-7.23	-48.49
Poland	BAU	119.5	27.7	13.7	29.1	25.4	4.2	0.0				
	WWS	68.9	28.7	19.2	30.7	15.3	6.0	0.0	-20.10	-10.46	-11.75	-42.32
Portugal	BAU	29.6	16.9	14.2	32.1	34.8	2.0	0.1				
	WWS	16.8	21.9	19.7	34.2	21.1	3.0	0.1	-26.72	-9.44	-7.26	-43.42
Qatar	BAU	68.6	5.1	1.8	71.1	19.6	0.0	2.4				
	WWS	43.5	6.1	2.3	78.4	9.4	0.0	3.8	-23.84	-9.10	-3.67	-36.61
Romania	BAU	50.7	36.3	9.8	29.9	22.0	1.3	0.7				
	WWS	31.4	43.5	13.0	28.6	12.3	1.8	0.9	-21.85	-8.50	-7.69	-38.04
Russian Federation	BAU	725.5	24.2	8.5	40.3	25.4	1.6	0.0				
	WWS	473.3	31.1	11.0	44.9	10.7	2.3	0.0	-13.74	-14.98	-6.04	-34.76
Saudi Arabia	BAU	337.5	13.5	6.7	46.8	32.7	0.3	0.0				
	WWS	187.6	18.5	9.3	53.6	18.0	0.5	0.1	-28.90	-9.24	-6.29	-44.42
Senegal	BAU	7.9	36.6	5.0	14.9	42.5	0.3	0.7				
	WWS	3.8	54.5	8.0	8.8	26.8	0.5	1.4	-34.98	-9.07	-7.49	-51.54
Serbia	BAU	18.9	43.2	12.1	24.1	19.3	1.3	0.0				
	WWS	11.8	51.8	15.6	21.0	9.9	1.7	0.0	-18.45	-8.04	-10.97	-37.46
Singapore	BAU	203.2	1.2	3.6	10.5	84.7	0.0	0.1				
	WWS	61.6	3.0	9.1	0.0	87.6	0.0	0.2	-54.63	-10.78	-4.30	-69.71
Slovak Republic	BAU	22.1	17.2	12.6	36.2	33.0	0.9	0.0				
	WWS	12.4	23.2	18.4	41.5	15.5	1.4	0.0	-16.85	-20.04	-7.08	-43.97
Slovenia	BAU	8.1	25.9	12.0	24.9	35.4	1.3	0.4				
	WWS	4.6	34.2	17.0	24.6	21.8	1.9	0.6	-27.22	-8.94	-7.69	-43.85
South Africa	BAU	246.8	15.6	6.9	42.6	30.4	2.2	2.4				
	WWS	142.4	17.6	9.4	49.3	16.8	3.3	3.5	-26.68	-8.19	-7.43	-42.30
Spain	BAU	168.9	17.0	13.1	29.9	37.1	2.3	0.6				
	WWS	93.2	22.2	18.6	30.3	24.3	3.5	1.0	-27.54	-10.05	-7.24	-44.83
Sri Lanka	BAU	26.9	32.0	5.2	22.3	38.9	0.0	1.6				
	WWS	13.7	45.5	8.1	20.5	23.3	0.0	2.6	-33.28	-9.22	-6.63	-49.14
Sudan	BAU	27.6	30.9	14.7	14.5	38.4	0.9	0.7				
	WWS	14.1	43.9	23.2	7.3	22.9	1.5	1.1	-33.33	-9.31	-6.32	-48.96
Sweden	BAU	60.1	24.0	16.0	32.2	26.8	1.0	0.0				
	WWS	39.2	30.8	20.3	31.1	16.5	1.4	0.0	-18.26	-9.27	-7.26	-34.79
Switzerland	BAU	36.0	27.1	18.7	18.0	35.0	0.6	0.6				
	WWS	20.5	34.5	26.1	13.0	24.5	0.9	0.9	-24.83	-10.14	-8.20	-43.17
Syrian Arab Republic	BAU	24.7	21.7	4.8	31.9	35.6	3.5	2.5				
	WWS	13.5	29.7	6.8	33.8	19.9	5.2	4.5	-28.90	-9.31	-7.21	-45.42
Tajikistan	BAU	3.5	24.3	7.3	20.6	8.7	11.9	27.1				
	WWS	2.6	25.6	7.7	16.1	3.6	16.3	30.6	-10.28	-8.21	-8.55	-27.05
Tanzania, United	BAU	44.3	55.9	0.9	19.6	13.7	5.9	4.0				
	WWS	27.2	65.1	1.2	13.6	6.8	7.9	5.3	-22.71	-8.52	-7.26	-38.48
Republic of Thailand	BAU	282.3	9.7	8.9	36.5	41.3	3.5	0.1				
	WWS	143.4	14.1	13.7	43.8	22.6	5.6	0.2	-26.50	-16.57	-6.13	-49.20
Togo	BAU	5.0	50.1	10.3	4.0	35.4	0.0	0.3				
	WWS	2.5	70.9	16.5	-9.2	21.3	0.0	0.6	-32.47	-9.09	-7.65	-49.21
Trinidad and Tobago	BAU	19.4	4.8	1.2	73.9	20.0	0.0	0.0				
	WWS	12.2	5.6	1.5	83.2	9.7	0.0	0.0	-24.78	-8.66	-3.51	-36.95

Tunisia	BAU	42.5	10.8	5.2	16.7	64.7	2.7	0.0				
	WWS	13.8	24.2	12.5	17.7	38.5	7.1	0.0	-23.71	-36.28	-7.56	-67.55
Turkey	BAU	140.6	26.4	13.7	33.9	21.4	4.6	0.0				
	WWS	82.2	27.1	18.6	36.8	10.9	6.6	0.0	-21.39	-9.58	-10.55	-41.51
Turkmenistan	BAU	40.5	2.1	40.9	21.8	20.1	0.8	14.4				
	WWS	25.3	2.5	54.4	15.7	7.0	1.3	19.1	-18.30	-17.19	-2.05	-37.54
Ukraine	BAU	148.8	39.6	9.5	31.0	18.0	1.9	0.0				
	WWS	96.3	45.2	12.7	30.8	8.6	2.6	0.0	-15.86	-10.54	-8.86	-35.27
United Arab Emirates	BAU	196.8	6.3	5.1	51.6	35.3	0.0	1.7				
	WWS	108.0	8.7	7.2	61.3	19.7	0.0	3.1	-31.17	-9.35	-4.63	-45.16
United Kingdom	BAU	251.6	29.2	14.0	25.2	30.3	0.5	0.7				
	WWS	140.4	36.1	20.1	23.6	18.4	0.8	1.0	-26.55	-8.86	-8.78	-44.20
United States of America	BAU	2360.6	14.6	14.7	31.8	36.6	1.4	0.9				
	WWS	1291.4	19.3	21.5	33.9	21.6	2.2	1.6	-27.58	-10.93	-6.78	-45.29
Uruguay	BAU	8.6	18.4	10.0	26.0	41.4	4.0	0.2				
	WWS	4.4	26.5	15.1	26.0	25.4	6.6	0.3	-32.28	-9.31	-6.84	-48.43
Uzbekistan	BAU	73.5	49.2	10.5	21.3	10.6	3.3	5.0				
	WWS	45.7	52.9	13.9	16.2	4.1	4.9	7.9	-15.85	-12.10	-9.88	-37.83
Venezuela	BAU	131.0	7.8	5.2	52.0	34.9	0.1	0.0				
	WWS	71.6	10.5	7.4	62.3	19.6	0.1	0.0	-30.82	-9.64	-4.90	-45.36
Vietnam	BAU	131.1	28.0	4.5	38.7	27.5	1.2	0.0				
	WWS	75.5	34.4	6.1	43.1	14.6	1.8	0.0	-26.23	-8.32	-7.88	-42.43
Yemen	BAU	10.4	19.1	3.4	24.3	46.3	3.8	3.1				
	WWS	5.0	28.9	5.5	23.4	29.5	6.5	6.1	-36.45	-9.77	-5.93	-52.15
Zambia	BAU	17.0	57.1	1.9	32.3	7.4	0.8	0.5				
	WWS	11.2	62.7	2.3	29.8	3.5	1.1	0.6	-17.32	-8.30	-8.63	-34.26
Zimbabwe	BAU	23.0	53.5	5.8	13.2	12.6	13.5	1.5				
	WWS	14.5	61.1	7.3	5.9	6.0	17.7	2.0	-20.86	-8.07	-8.00	-36.93
All countries	BAU	20,604	20.40	8.08	37.30	31.00	1.87	1.34				
	WWS	11,840	25.71	11.21	42.05	16.04	2.85	2.15	-23.00	-12.65	-6.89	-42.54

BAU values are extrapolated from IEA (2015c) data for 2012 to 2050 as described in Section S3.2. Briefly, EIA's International Energy Outlook (IEO) projects energy use by end-use sector, fuel, and world region out to 2040 (EIA, 2015). This is extended to 2075 using a ten-year moving linear extrapolation. EIA sectors and fuels are then mapped to IEA sectors and fuels, and each country's 2012 energy consumption by sector and fuel is scaled by the ratio of EIA's 2050/2012 energy consumption by sector and fuel for each region. The transportation load includes, among other loads, energy produced in each country for international transportation and shipping. 2050 WWS values are estimated from 2050 BAU values assuming electrification of end-uses and effects of additional energy-efficiency measures.

In 2012, the 139-country all-purpose, end-use load was ~12.1 TW. Of this, 2.37 TW (19.6%) was electricity demand. Under the BAU trajectory, all-purpose end-use load may grow to 20.6 TW in 2050 (Table S6). Conversion to WWS by 2050 reduces the 139-country load by ~42.5%, to 11.8 TW (Table S6), with the greatest percentage reduction in transportation.

While electricity use increases with WWS, conventional fuel use decreases to zero. The increase in electric energy is much less than the decrease in energy in the gas, liquid, and solid fuels that the electricity replaces, for three major reasons:

(a) The higher energy-to-work conversion efficiency of electricity used for heating, heat pumps, and electric motors than of fossil fuel equivalents and the higher energy-to-work conversion efficiency of electrolytic hydrogen used for hydrogen fuel cells than of liquid fuels used for transportation (Table S4).

(b) The elimination of energy needed to mine, transport, and refine coal, oil, gas, biofuels, bioenergy, and uranium;

(c) Modest additional policy-driven energy efficiency measures beyond those in the BAU case.

These three factors decrease 139-country-averaged demand ~23.0%, 12.6%, and 6.9%, respectively. Thus, electrification of all energy sectors reduces demand 42.5%. This result implies that WWS not only replaces fossil-fuel electricity directly but is also an energy efficiency measure, reducing demand.

The percent decreases in load upon conversion to WWS in Table S6 are greater in some countries than in others. The reason is that the transportation-energy share of total energy is greater in some countries than in others. This trend is shown in Table S6, where countries with a higher fraction of load in the transportation sector exhibit a greater reduction in power demand.

Section S4. Numbers of WWS Generators, Footprint Areas, and Spacing Areas

Table S7 summarizes the number of WWS power plants or devices needed to power the sum of all 139 countries in 2050 for all purposes assuming the end use power requirements in Table S6 and the percent mixes of end-use power generation by country in Table S8. Table S7 accounts for power losses during energy transmission and distribution, generator maintenance, and competition among wind turbines for limited kinetic energy (array losses).

Table S7. Number, capacity, footprint area, and spacing area of WWS power plants or devices needed to provide total annually averaged end-use all-purpose load over all 139 countries examined. Derivations for individual countries are in Delucchi et al. (2016).

Energy Technology	Rated power one plant or device (MW)	^a Percent of 2050 all-purpose load met by plant/device	Name-plate capacity, existing plus new plants or devices (GW)	Percent name-plate capacity already installed 2015	Number of new plants or devices needed for 139 countries	^b Percent of 139-country land or roof area for footprint of new plants or devices	Percent of 139-country area for spacing of new plants or devices
Annual average power							
Onshore wind	5	23.50	8,330	5.04	1,580,000	0.00002	0.9240
Offshore wind	5	13.60	4,690	0.26	935,000	0.00001	0.5460
Wave device	0.75	0.58	307	0.00	410,000	0.00018	0.0086
Geothermal plant	100	0.67	96	13.05	839	0.00023	0.0000
Hydropower plant ^c	1300	4.00	1,060	100.00	0	0.00000	0.0000
Tidal turbine	1	0.06	31	1.79	30,100	0.00001	0.00009
Res. roof PV	0.005	14.90	9,280	0.76	1,840,000,000	0.04030	0.0000
Com/gov roof PV ^d	0.1	11.60	7,590	1.16	75,000,000	0.03280	0.0000
Solar PV plant ^d	50	21.40	12,630	0.53	251,000	0.12800	0.0000
Utility CSP plant ^d	100	9.72	2,150	0.23	21,000	0.05270	0.0000
Total for average power		100	46,200	3.76	1,920,000,000	0.255	1.480
New land average power^e						0.181	0.924
For peaking/storage							
Additional CSP ^f	100	5.83	1,292	0.00	12,900	0.032	0.000
Solar thermal ^f	50		4,640	8.98	84,400	0.005	0.000
Geothermal heat ^f	50		70	100.00	0	0.000	0.000
Total peaking/storage		5	6,000	8.11	97,300	0.037	0.000
Total all			52,159	4.26	1,920,000,000	0.291	1.480
Total new land^c						0.218	0.924

Annual average power is annual average energy divided by the number of hours per year. The total number of each device is the sum among all countries. The number of devices in each country is the end-use load in 2050 in each country to be supplied by WWS (Table S6) multiplied by the fraction of load satisfied by each WWS device in each country (Table S8) and divided by the annual power output from each device. The annual output by device equals the rated power in the first column (same for all countries) multiplied by the country-specific annual capacity factor of the device, diminished by transmission, distribution, maintenance, and array losses. The capacity factors, given in Delucchi et al. (2016), before transmission, distribution, and maintenance losses for onshore and offshore wind turbines at 100-m hub height in 2050, are calculated country by country from global model simulations of winds and wind power (Figure S3) that account for competition among wind turbines for available kinetic energy based on the approximate number of turbines needed per country as determined iteratively from Tables S7 and S8. Wind array losses due to competition among turbines for the same energy are calculated here to be ~8.5%. Footprint and spacing areas are calculated in Delucchi et al. (2016). Footprint is the area on the top surface of soil covered by an energy technology, thus does not include underground structures.

^aTotal end-use power demand in 2050 with 100% WWS is from Table S6.

^bTotal land area for each country is given in Delucchi et al. (2016). 139-country land area is 119,651,632 km². The world land area is 510,072,000 km².

^cThe average capacity factors of hydropower plants are assumed to increase from their current values to 50%.

^dThe solar PV panels used for this calculation are Sun Power E20 panels. For footprint calculations alone, the CSP mirror sizes are set to those at Ivanpah. CSP is assumed to have storage with a maximum charge to discharge rate (storage size to generator size ratio) of 2.62:1 (Jacobson et al., 2015b). The capacity factors used for residential PV, commercial/government rooftop PV, utility scale PV, and CSP are calculated as discussed in Section S5.2. For utility solar PV plants, “spacing” between panels is included in the plant footprint area.

^eThe footprint area requiring new land equals the sum of the footprint areas for new onshore wind, geothermal, hydropower, and utility solar PV. Offshore wind, wave and tidal generators are in water and thus do not require new land. Similarly, rooftop solar PV does not use new land because the rooftops already exist. Only onshore wind requires new land for spacing area. Spacing area is for onshore and offshore wind is calculated as $44D^2$, where D =rotor diameter. The 5-MW Senvion (RePower) turbine is assumed here, where D =126 m. The other energy sources either are in water or on rooftops, or do not use new land for spacing. Note that the spacing area for onshore wind can be used for multiple purposes, such as open space, agriculture, grazing, etc.

^fThe installed capacities for peaking power/storage are estimated from Jacobson et al. (2015b). Additional CSP is CSP plus storage needed beyond that for annual power generation to firm the grid across all countries. Additional solar thermal and geothermal are used for direct heat or heat storage in underground rocks. Other types of storage are also used in Jacobson et al. (2015b).

Rooftop PV in Table S7 is divided into residential (5-kW systems on average) and commercial/government (100-kW systems on average). Rooftop PV can be placed on existing rooftops or on elevated canopies above parking lots, highways, and structures without taking up additional undeveloped land. Table S22 (Section S5.2) summarizes projected 2050 rooftop areas by country usable for solar PV on residential and commercial/government buildings, carports, garages, parking structures, and parking lot canopies. The rooftop areas in Table S22 are used to calculate potential rooftop generation, which in turn limits the penetration of PV on residential and commercial/government buildings in Table S8.

Utility-scale PV power plants are sized, on average, relatively small (50 MW) to allow optimal placement in available locations. While utility-scale PV can operate in any country because it can take advantage of both direct and diffuse solar radiation, CSP is assumed to be viable only in countries with significant direct solar radiation, and its penetration in each country is limited to less than its technical potential. Whereas, the fraction of total power generation that is utility PV in Table S8 may appear high for some countries (e.g., 29.3% in Denmark), the PV in that case requires only 0.8% of Denmark’s land area. Given that PV is 20% efficient, whereas photosynthesis is only 1% efficient at converting sunlight to energy, farmers will benefit

financially by putting utility PV on their farmland rather than crops for biofuels. In the case of Japan, 77% of all end-use energy for all sectors is proposed to come from utility PV. Whereas, that PV requires 3.4% of the country's land area, some or much of that PV can be placed offshore, over lakes, and over farmland. In the case of the Netherlands, 39% of all end-use energy is proposed to come from utility PV. That represents 6.4% of the country's land area, but again some of that PV can be placed offshore.

Onshore wind is available to some extent in every country but assumed to be viable in high penetrations primarily in countries with good wind resources (Section S5.1).

Offshore wind is assumed to be limited to the 108 out of 139 countries with either ocean or lake coastline. Of these, the technical potential (Section S5.1) was determined for 73 countries based on data from Arent et al. (2012) as the potential installed capacity in coastal areas of less than 60 m depth with a capacity factor of at least 34% in the annual average. The potential installed capacities offshore of, for example, Australia, New Zealand, Vietnam, and Norway in depths less than 60 m from that study are ~2,100 GW, 153 GW, 476 GW, and 169 GW, respectively. The present roadmaps propose to use only 2.3%, 4.4%, 8.0%, and 8.1% of these potentials, respectively. For the remaining 35 countries, including several with mean annual capacity factors less than 34%, a technical potential is estimated as a simple function of an assumed wind power density and coastline length.

In all except three countries (Gibraltar, Hong Kong, and Singapore), the roadmaps here propose offshore wind installed capacities less than the offshore wind technical potential in depths less than 60 m. For the three remaining countries, the proposed installed capacities can be met only with floating offshore turbines. Whereas, most offshore wind today is confined to shallow water with depths less than 60 m, floating wind farms are being planned for deep water off the coasts of Aberdeen, Scotland (50 MW); Fukushima, Japan (~ 400 MW); and Oahu, Hawaii (400 MW). We anticipate that this technology will expand further over the next 10 years and certainly by 2050.

Some optimization studies (e.g., Elliston et al., 2016, for Australia) suggest that electricity can be obtained at low cost from primarily onshore wind and solar, without the need for offshore wind. This may be correct for present-day electricity demand in Australia. However, our study examines the situation when all energy is converted to electricity so that more generation is needed. Whereas, it may still be possible and less expensive to exclude offshore wind in many countries including Australia, we believe there are many viable scenarios in which it is included, particularly in countries where the resources in shallow water are significant, because the cost of offshore wind is dropping rapidly.

Wind and solar are the only two sources of electric power with sufficient resource to power the world independently on their own. Averaged over the 139 countries, wind (~37.1%) and solar (57.6%) are the largest generators of annually averaged end-use electric power under these plans. Thus the ratio of solar to wind end-use power is 1.55:1. Of the total solar end-use annually-averaged power, 16.9% is CSP.

Under the roadmaps, the 2050 nameplate capacity of hydropower in each country is assumed to be exactly the same as in 2015. However, existing dams in most countries are assumed to run more efficiently for producing peaking power, thus the capacity factor of dams is assumed to increase (Section S5.4). The percent generation by hydro in Table S8 is the percent generation of all energy converted to electricity in 2050, thus it is much lower than the percent generation of electricity today, since electricity represents only about one-fifth of all energy today.

Geothermal, tidal, and wave energy expansions are limited in each country by their technical potentials (Sections S5.3 and S5.5).

Table S7 indicates that 4.26% of the summed nameplate capacity required for a 100% WWS system for 2050 all-purpose, annually averaged power over the 139 countries was already installed as of the end of 2015. Figure S2 shows that the countries closest to 100% 2050 all-purpose WWS installations as of the end of 2015 are Tajikistan (76.0%), Paraguay (58.9%), Norway (35.8%), Sweden (20.7%), Costa Rica (19.1%), Switzerland (19.0%), Georgia (18.7%), Montenegro (18.4%), and Iceland (17.3%). China (5.8%) ranks 39th and the United States (4.2%) ranks 52nd. The high penetrations in Tajikistan, Paraguay, and several other countries are due to their significant hydroelectric power capacity already installed plus their ability to obtain higher capacity factors from the same facilities without building more dams.

Figure S2. Countries ranked in order of how close they are at the end of 2015 to reaching 100% WWS power for all energy sectors (electricity, transportation, heating/cooling, industry, agriculture/forestry/fishing) in 2050. The first number is existing plus new nameplate capacity needed in 2050 (GW); percentages are of 2050 WWS total installed capacity (summed over all WWS technologies) needed that was already installed as of the end of 2015. The 139-country existing plus new installed capacity needed is 52.16 TW; of this, 4.26% is already installed.

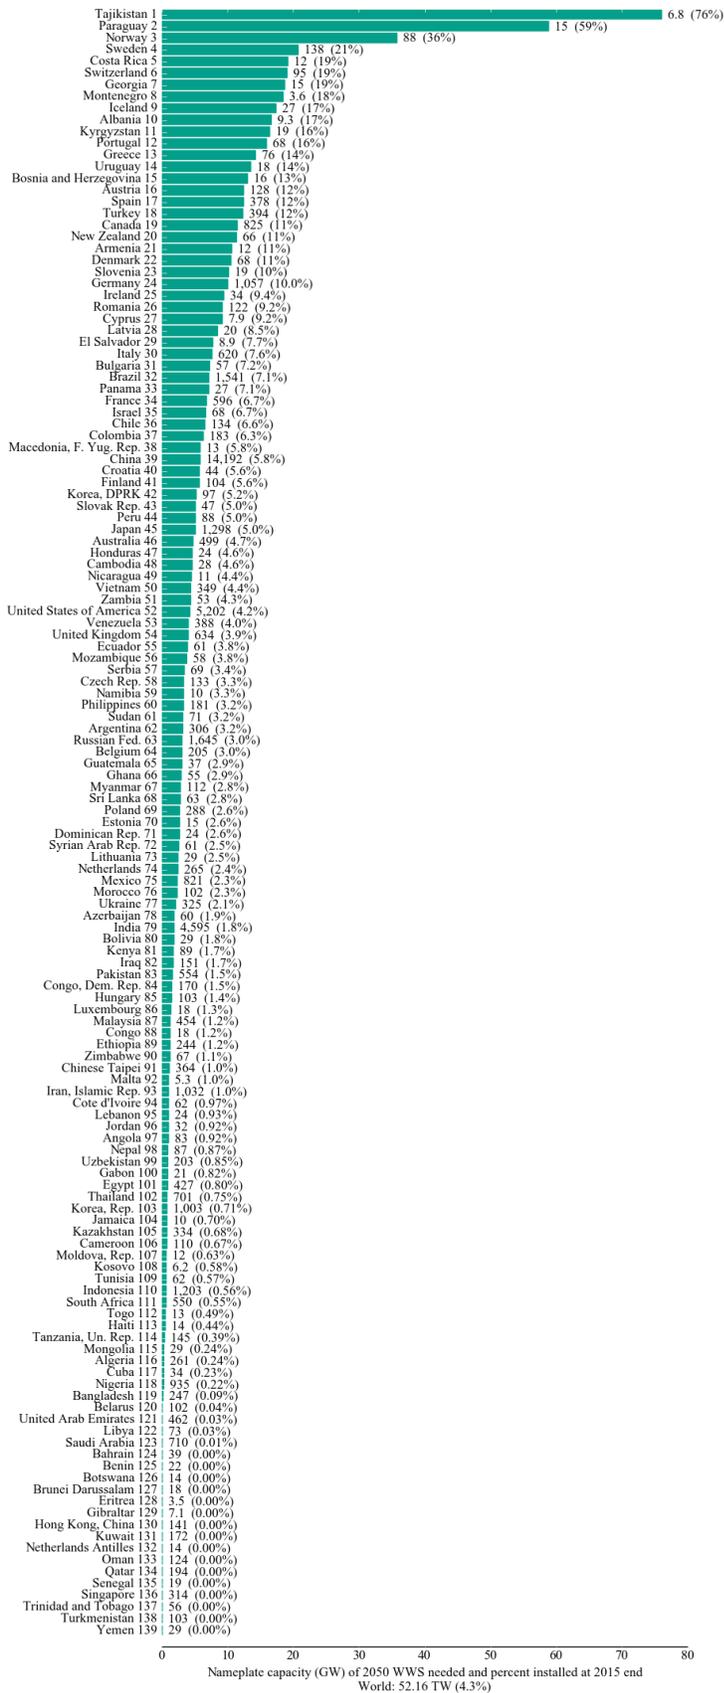


Table S7 also lists needed installed capacities of 1) additional CSP with storage, 2) solar thermal collectors, and 3) existing geothermal for heat. These collectors are needed to provide electricity or heat that is stored and used later to provide peaking power and to account for power losses into and out of such storage (Section S7).

Table S8. Percent of the annually averaged 2050 country-specific all-purpose end-use load (not installed capacity) in Table S6 in a WWS world that we propose to meet with the given electric power generator. All rows add up to 100%.

Country	On-shore wind	Offshore wind	Wave	Geo-thermal	Hydro-electric	Tidal	Res PV	Com/gov PV	Utility PV	CSP
Albania	18.71	0.31	0.00	0.00	30.84	0.10	12.76	24.31	4.68	8.29
Algeria	32.64	0.02	0.07	0.00	0.17	0.01	21.98	24.97	8.16	11.97
Angola	24.14	1.38	5.74	0.00	2.27	0.04	16.99	32.37	6.04	11.03
Argentina	19.10	15.92	0.00	1.02	5.14	0.02	21.43	21.34	4.77	11.26
Armenia	19.17	0.00	0.00	0.81	22.41	0.00	18.79	13.88	15.72	9.21
Australia	20.07	16.73	5.79	0.28	3.13	0.10	13.73	11.17	18.11	10.88
Austria	44.67	0.00	0.00	0.00	12.44	0.00	7.93	6.36	28.33	0.25
Azerbaijan	14.95	0.00	0.00	0.00	4.46	0.00	21.42	22.87	24.83	11.46
Bahrain	0.38	16.89	0.00	0.00	0.00	0.02	3.70	1.74	65.28	12.00
Bangladesh	5.77	5.80	0.50	0.00	0.26	0.08	27.81	7.81	40.06	11.90
Belarus	64.55	0.00	0.00	0.03	0.06	0.00	3.83	3.41	16.14	11.99
Belgium	4.80	17.80	0.00	0.00	0.15	0.00	1.43	1.27	74.56	0.00
Benin	22.63	18.86	0.85	0.00	0.01	0.03	25.39	14.69	5.66	11.89
Bolivia	22.33	0.00	0.00	15.34	3.34	0.00	15.03	28.63	5.58	9.76
Bosnia and Herzegovina	20.12	4.32	0.00	0.00	25.15	0.01	16.21	19.54	5.67	8.98
Botswana	27.46	0.00	0.00	0.00	0.00	0.00	18.48	35.20	6.86	12.00
Brazil	17.24	14.37	0.89	0.00	13.03	0.01	19.34	20.48	4.31	10.33
Brunei Darussalam	1.04	21.11	1.24	0.00	0.00	0.04	18.85	8.25	37.62	11.85
Bulgaria	44.14	10.34	0.00	0.00	7.80	0.02	13.34	13.33	11.04	0.00
Cambodia	15.02	12.51	0.00	0.00	8.81	0.04	16.85	32.09	3.75	10.94
Cameroon	16.52	0.92	0.69	0.00	1.91	0.01	25.79	12.01	30.46	11.69
Canada	27.49	22.90	2.24	1.65	14.51	0.18	5.30	9.09	6.87	9.77
Chile	18.70	15.59	5.28	3.65	8.22	0.06	20.22	13.67	4.68	9.93
China	24.08	11.77	0.03	0.05	4.13	0.01	14.08	9.14	25.23	11.49
Chinese Taipei	2.08	21.73	0.14	28.64	0.98	0.01	10.83	5.09	30.51	0.00
Colombia	13.70	11.42	0.81	0.00	15.68	0.34	15.37	29.28	3.43	9.98
Congo	17.81	14.85	1.59	0.00	3.20	0.05	19.98	38.07	4.45	0.00
Congo, Dem. Republic	38.00	0.54	0.04	0.00	4.11	0.00	25.87	10.44	9.50	11.50
Costa Rica	5.70	1.23	2.88	28.23	23.63	0.15	8.34	15.88	8.55	5.41
Cote d'Ivoire	18.42	15.41	1.18	0.00	2.39	0.03	20.75	25.56	4.70	11.57
Croatia	9.73	0.00	0.00	0.00	10.20	0.18	15.38	12.01	41.75	10.75
Cuba	15.41	12.84	5.97	0.00	0.36	0.13	17.29	32.93	3.85	11.22
Cyprus	8.33	16.67	1.70	0.00	0.00	0.19	22.44	22.21	16.68	11.77
Czech Republic	41.64	0.00	0.00	0.00	1.76	0.00	6.17	5.89	44.54	0.00
Denmark	26.51	37.29	1.08	0.00	0.02	0.10	3.66	1.92	29.43	0.00
Dominican Republic	8.13	12.76	0.00	9.50	4.21	0.09	17.18	26.76	11.01	10.34
Ecuador	21.69	2.27	5.10	0.27	8.56	0.46	15.82	30.14	5.42	10.27
Egypt	30.28	0.24	0.00	0.00	1.23	0.01	20.51	28.32	7.57	11.85
El Salvador	9.14	7.62	2.32	33.46	8.64	0.08	10.25	19.53	2.29	6.66
Eritrea	16.31	13.59	0.00	0.00	0.00	1.00	18.29	34.85	4.08	11.88
Estonia	43.85	36.54	0.00	0.00	0.10	0.28	4.83	3.43	10.96	0.00
Ethiopia	39.58	0.00	0.00	2.47	2.05	0.00	26.64	7.90	9.90	11.46
Finland	43.58	36.31	0.00	0.00	5.05	0.02	2.86	1.29	10.89	0.00
France	31.12	25.94	0.49	0.02	5.25	0.14	9.57	8.40	7.78	11.29
Gabon	17.19	14.32	5.86	0.00	2.20	0.12	19.28	36.73	4.30	0.00
Georgia	14.96	12.47	0.00	0.00	33.71	0.06	16.79	18.27	3.74	0.00

Germany	22.08	22.95	0.07	0.01	0.92	0.00	5.49	5.76	42.72	0.00
Ghana	17.78	14.81	1.37	0.00	6.98	0.03	19.94	23.65	4.44	11.00
Gibraltar	0.00	98.10	0.18	0.00	0.00	0.02	0.10	0.05	0.00	1.55
Greece	35.20	3.52	2.74	2.00	6.66	0.13	16.06	14.27	8.80	10.62
Guatemala	17.33	2.82	1.10	22.14	5.39	0.03	13.18	25.11	4.33	8.56
Haiti	10.79	10.61	0.00	0.00	0.91	0.21	26.00	12.72	26.89	11.87
Honduras	13.90	11.58	2.85	9.55	5.02	0.08	15.59	28.06	3.47	9.90
Hong Kong, China	0.00	98.17	0.15	0.00	0.00	0.01	1.15	0.52	0.00	0.00
Hungary	11.55	0.00	0.00	1.79	0.15	0.00	12.36	10.82	63.33	0.00
Iceland	22.04	18.37	2.93	22.66	28.09	0.39	0.00	0.00	5.51	0.00
India	34.73	2.67	0.05	0.02	2.09	0.02	24.92	14.89	8.88	11.74
Indonesia	12.25	12.88	3.71	3.45	1.03	0.03	17.33	31.25	7.06	11.01
Iran, Islamic Republic	21.85	9.49	0.00	0.00	1.91	0.00	18.17	11.04	25.77	11.77
Iraq	26.02	0.67	0.00	0.00	3.28	0.00	17.87	34.05	6.51	11.61
Ireland	36.74	30.62	5.92	0.00	1.22	0.06	12.93	3.31	9.19	0.00
Israel	6.84	12.60	0.00	0.00	0.02	0.01	17.48	9.03	42.02	12.00
Italy	25.15	1.13	0.22	0.61	4.85	0.01	16.38	5.72	34.62	11.32
Jamaica	6.36	16.49	0.00	0.00	0.47	0.20	22.20	23.99	18.37	11.92
Japan	1.74	7.02	0.74	0.49	4.14	0.20	5.52	3.35	76.79	0.00
Jordan	30.79	1.37	0.00	0.00	0.07	0.01	21.46	26.61	7.70	11.99
Kazakhstan	45.75	0.00	0.00	0.00	1.30	0.00	16.62	13.04	11.44	11.84
Kenya	23.14	6.28	0.49	7.42	1.86	0.01	18.96	25.23	5.78	10.83
Korea, Dem. People's Rep.	52.42	13.50	0.00	0.00	8.43	0.83	9.59	1.93	13.10	0.21
Korea, Republic of	3.15	11.56	0.00	0.00	0.43	0.12	5.62	3.47	63.73	11.93
Kosovo	24.21	0.00	0.00	35.94	0.90	0.00	16.47	8.52	6.38	7.58
Kuwait	1.19	11.68	0.00	0.00	0.00	0.01	2.70	1.58	70.85	12.00
Kyrgyzstan	24.97	0.00	0.00	0.00	29.14	0.00	16.81	14.34	6.24	8.50
Latvia	35.88	29.90	0.00	0.00	14.01	0.06	6.98	4.21	8.97	0.00
Lebanon	2.74	24.57	0.00	0.00	1.82	0.03	16.29	8.66	34.11	11.78
Libya	29.10	3.02	0.00	0.00	0.00	0.04	21.21	27.36	7.27	12.00
Lithuania	38.22	31.85	0.00	0.00	0.76	0.01	10.24	9.36	9.55	0.00
Luxembourg	3.86	0.00	0.00	0.00	0.56	0.00	1.35	1.42	92.82	0.00
Macedonia, Republic of	15.38	0.00	0.00	0.00	12.03	0.00	24.22	18.76	29.61	0.00
Malaysia	2.47	18.54	0.18	0.00	2.99	0.01	24.96	13.88	25.34	11.62
Malta	1.36	0.00	0.75	0.00	0.00	0.17	4.54	2.24	79.04	11.89
Mexico	19.16	15.97	0.71	2.20	2.94	0.01	21.49	21.44	4.79	11.30
Moldova, Republic of	58.40	0.00	0.00	0.00	1.15	0.00	18.70	7.14	14.60	0.00
Mongolia	34.44	0.00	0.00	0.00	0.00	0.00	23.18	21.77	8.61	12.00
Montenegro	12.97	10.81	0.00	0.00	33.31	0.22	14.55	16.91	3.24	7.98
Morocco	16.24	13.53	2.07	0.00	2.53	0.03	18.22	31.87	4.06	11.44
Mozambique	19.92	16.60	4.29	0.00	7.08	1.59	22.35	12.74	4.98	10.44
Myanmar	15.37	12.81	0.64	0.00	5.87	0.18	17.24	32.84	3.84	11.20
Namibia	21.33	3.43	5.60	0.00	6.47	0.25	16.20	30.87	5.33	10.52
Nepal	16.07	0.00	0.00	0.00	2.23	0.00	28.63	4.25	37.09	11.73
Netherlands	5.73	41.32	0.00	0.00	0.03	0.00	1.07	0.81	39.04	12.00
Netherlands Antilles	0.71	6.71	0.00	0.00	0.00	0.09	2.90	1.27	76.33	11.99
New Zealand	19.04	15.86	4.61	9.29	13.55	0.25	13.85	10.11	4.76	8.68
Nicaragua	12.45	10.37	4.82	16.90	2.54	0.19	13.96	26.59	3.11	9.07
Nigeria	6.31	0.00	0.14	0.00	0.59	0.00	22.24	23.80	35.00	11.91
Norway	22.90	19.08	3.32	0.00	44.47	0.26	3.63	0.61	5.73	0.00
Oman	47.44	3.52	0.63	0.00	0.00	0.02	15.27	9.33	11.86	11.92
Pakistan	19.14	8.42	0.19	0.00	2.83	0.00	24.77	14.56	18.45	11.64
Panama	17.02	6.18	5.11	0.00	14.06	0.84	14.78	28.16	4.26	9.60
Paraguay	6.48	0.00	0.00	0.00	76.41	0.00	4.36	8.30	1.62	2.83
Peru	21.50	0.00	5.00	6.28	10.37	0.04	14.47	27.56	5.37	9.40
Philippines	7.66	11.54	0.59	11.22	3.86	0.27	15.53	29.59	9.65	10.09
Poland	42.62	23.38	0.00	0.13	0.37	0.00	8.64	14.19	10.66	0.00
Portugal	18.45	15.37	4.18	0.48	12.03	0.65	20.69	13.61	4.61	9.92
Qatar	0.32	11.82	0.00	0.00	0.00	0.01	1.30	0.74	73.82	12.00

Romania	32.73	27.28	0.00	0.26	9.41	0.01	15.54	6.60	8.18	0.00
Russian Federation	39.13	32.61	0.25	0.08	4.62	0.02	5.55	5.86	9.78	2.12
Saudi Arabia	41.77	0.00	0.00	0.00	0.00	0.00	22.26	13.52	10.44	12.00
Senegal	17.16	14.30	1.56	0.00	0.00	0.07	19.25	31.56	4.29	11.80
Serbia	10.41	0.00	0.00	0.00	8.11	0.00	15.93	15.40	50.13	0.00
Singapore	0.00	92.93	0.00	5.49	0.00	0.00	1.22	0.35	0.00	0.00
Slovak Republic	61.78	0.00	0.00	0.00	6.05	0.00	10.12	6.60	15.44	0.00
Slovenia	43.31	7.70	0.00	1.81	13.05	0.01	11.95	11.33	10.83	0.00
South Africa	42.00	6.17	3.19	0.00	0.22	0.01	17.22	9.11	10.50	11.59
Spain	33.49	13.55	1.47	0.04	6.29	0.23	17.18	8.34	8.37	11.04
Sri Lanka	15.55	12.95	1.38	0.00	5.19	0.04	17.44	32.36	3.89	11.21
Sudan	15.38	12.82	0.00	0.00	6.61	0.03	17.25	32.86	3.85	11.20
Sweden	36.42	30.35	0.00	0.00	18.69	0.06	3.70	1.67	9.11	0.00
Switzerland	20.70	0.00	0.00	0.00	30.49	0.00	11.27	9.25	28.18	0.11
Syrian Arab Republic	17.57	10.70	0.00	0.00	4.81	0.01	17.59	33.50	4.39	11.42
Tajikistan	3.26	0.00	0.00	0.00	88.11	0.00	2.20	4.18	0.82	1.43
Tanzania, United Republic	33.10	5.42	0.60	0.00	0.85	0.37	25.20	14.38	8.28	11.78
Thailand	3.24	16.27	0.00	0.07	1.13	0.01	25.68	13.55	28.18	11.85
Togo	19.84	17.99	0.66	0.00	1.19	0.03	26.77	9.87	11.88	11.77
Trinidad and Tobago	0.27	29.05	0.30	0.00	0.00	0.02	12.24	2.85	43.31	11.96
Tunisia	21.76	18.14	0.00	0.00	0.21	0.03	24.41	18.04	5.44	11.97
Turkey	26.66	0.06	0.00	0.67	12.93	0.02	17.98	24.66	6.66	10.37
Turkmenistan	49.92	0.00	0.00	0.00	0.00	0.00	15.50	10.10	12.48	12.00
Ukraine	41.47	34.55	0.00	0.00	2.55	0.01	7.32	3.73	10.37	0.00
United Arab Emirates	7.01	11.88	0.00	0.00	0.00	0.01	4.21	2.40	62.50	12.00
United Kingdom	13.13	35.57	2.49	0.00	0.54	1.80	3.50	2.76	40.22	0.00
United States of America	21.32	17.09	1.08	0.41	2.80	0.01	14.48	11.79	19.53	11.48
Uruguay	16.36	13.63	1.45	0.00	15.82	0.08	18.35	20.31	4.09	9.92
Uzbekistan	29.45	0.00	0.00	0.00	1.75	0.00	26.33	11.23	19.45	11.79
Venezuela	20.98	17.49	0.10	0.00	8.98	0.01	23.54	12.75	5.25	10.91
Vietnam	0.88	16.25	0.69	0.00	8.93	0.01	21.88	17.01	23.50	10.84
Yemen	5.71	12.83	5.06	1.35	0.00	0.11	17.28	32.91	13.54	11.22
Zambia	24.70	0.00	0.00	0.67	9.37	0.00	16.62	31.66	6.17	10.79
Zimbabwe	41.17	0.00	0.00	0.00	2.26	0.00	27.71	6.82	10.29	11.73
World average	23.52	13.62	0.58	0.67	4.00	0.06	14.89	11.58	21.36	9.72

Footprint area is the physical area on the top surface of the ground or water needed for each energy device. Spacing area is the area between some devices, such as wind, tidal, and wave turbines, needed to minimize interference of the wake of one turbine with downwind turbines.

Only onshore wind, geothermal, additional hydropower (none of which is proposed here), utility PV plants, and CSP plants require new footprint on land. Rooftop PV does not take up new land. The footprint required for onshore wind is trivial. Table S7 indicates that the total new land footprint required for the plans, averaged over the 139 countries is ~0.22% of the land area of the countries, almost all for utility PV and CSP plants. This does not account for the decrease in footprint from eliminating the current energy infrastructure, which includes the footprint for mining, transporting, and refining fossil fuels and uranium and for growing, transporting, and refining biofuels and bioenergy.

The only spacing over land needed for the WWS system is between onshore wind turbines and requires ~0.92% of the 139-country land area. Because the footprint on the ground of wind is so small (Table S7), the spacing area between turbines can be used for multiple purposes, such as open space, agriculture, grazing, etc.

For several reasons, the footprint and spacing areas of additional transmission lines is neglected here. Transmission systems have virtually no footprint on the ground because transmission towers are four metal supports connected to small foundations, allowing grass to grow under the towers. Further, the rights-of-way under transmission lines can typically accommodate many uses; more than can the rights-of-way under gas and oil pipelines and other conventional infrastructure that new transmission lines will replace. Finally, in the WWS roadmaps, as much additional transmission capacity as possible will be placed along existing pathways but with enhanced lines.

Section S5. WWS Resource Availability and Technical Potential


This section evaluates the raw resource availability and technical potential in each of the 139 countries for each energy technology

S5.1. Onshore and Offshore Wind

Raw Resources. Figure S3 shows three-dimensional computer model estimates, derived for this study, of the world annually averaged wind speed and capacity factor at the 100-m hub height above the topographical surface of a modern 5-MW wind turbine. The figure also compares near-surface modeled wind speeds with QuikSCAT data over the oceans, suggesting model predictions and data are similar at that height and giving confidence in the 100-m values.

Locations of strong onshore wind resources include the Great Plains of the U.S. and Canada, the Sahara desert, the Gobi desert, much of Australia, the south of Argentina, South Africa, and northern Europe among other locations. Strong offshore wind resources occur off the east and west coasts of North America, over the Great Lakes, the North Sea, the west coast of Europe and the east coast of Asia, offshore of Peru and Argentina, Australia, South Africa, India, Saudi Arabia, and west Africa.

Figure S3. (a) QuikSCAT 10-m above ground level (AGL) wind speed at $1.5^\circ \times 1.5^\circ$ resolution (JPL, 2010), (b) GATOR-GCMOM (Jacobson, 2007; 2010a,b; Ten Hoeve et al., 2012) 4-year-average modeled annual 15-m AGL wind speed at 2.5° W-E \times 2.0° S-N resolution, (c) Same as (b) but at 100 m AGL, (d) Same as (c) but showing capacity factors assuming a Senvion (RePower) 5 MW turbine with 126-m rotor diameter. In all cases, wind speeds are determined before accounting for competition among wind turbines for the same kinetic energy.

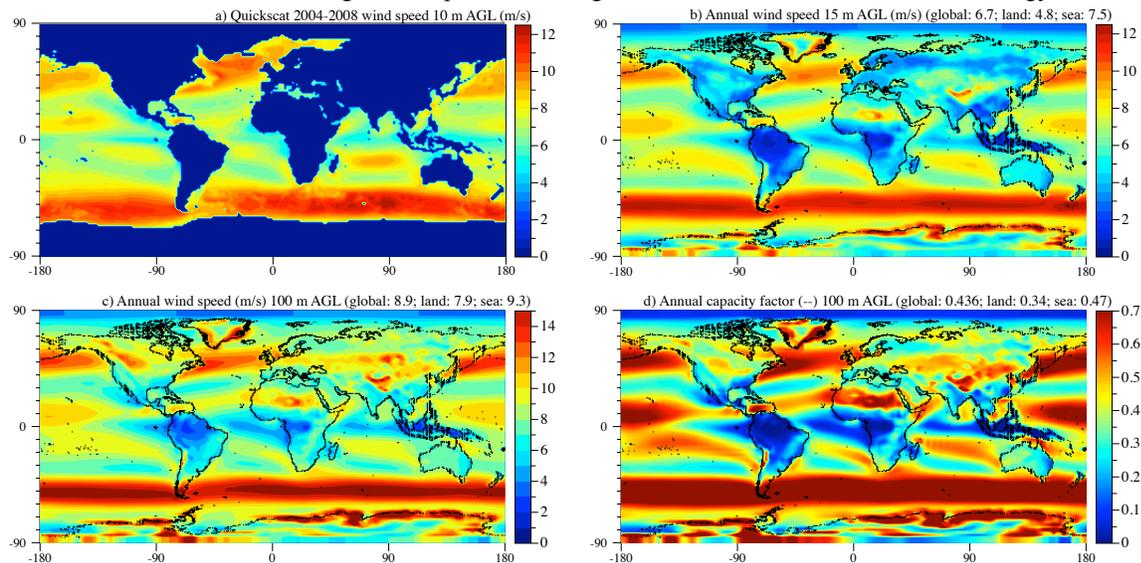

Technical and Economic Potential. Our estimates of the nameplate capacity of onshore and offshore wind to be installed in each country (Tables S7 and S8) are limited by the country's power demand and the wind's technical potential capacity, as described next.

Technical potential of onshore wind

The technical potential capacity of onshore wind is set equal to the areal power density of onshore wind systems multiplied by the lesser of: i) the maximum allowable land area for wind power, and ii) the total onshore land area with a wind resource that can provide what we designate as the minimum acceptable capacity factor, where the capacity factor and the areal power density are a function of the hub height of the turbines. We also assume that the technical potential is at least as great as either some multiple of the capacity actually installed in a base year *BY*, or some fixed minimum capacity. Formally,

$$C_{TP,ONW,h,C,TY} = \max \left[\begin{array}{l} C_{ONW,C,BY} \cdot M_{TP,ONW}, C_{\min,ONW}, \\ C_{AD,ONW,h} \cdot \min \left[LA_{\max,ONW,C,TY}, LA_{CF_{ONW,h} \geq CF_{ONW,\min},C} \right] \end{array} \right]$$

$$C_{AD,ONW,h} = \frac{CAP_{ONW,h}}{SA_{ONW,h}}$$

where

subscript h = Hub height of wind turbine (m) (a variable in our analysis; here, we assume $h=100$ m)

$C_{TP,ONW,h,C,TY}$ = Total technical potential (*TP*) capacity of onshore wind power with a hub height of h in country C in year TY (MW)

$C_{ONW,C,BY}$ = Capacity of onshore wind installed in country C in year BY (use year 2015 data)

$M_{TP,ONW}$ = Multiplier on capacity installed as of year BY (we assume 3.0)

$C_{\min,ONW}$ = The minimum onshore wind capacity in any country (we assume 100 MW)

$C_{AD,ONW,h}$ = The capacity of onshore wind systems, as areal power density, for a hub height of h (MW/km²)

$LA_{\max,ONW,C,TY}$ = The maximum allowable land area devoted to onshore wind power in country C in year TY (km^2) (see discussion below)

$LA_{CF_{ONW,h} \geq CF_{ONW,\min},C}$ = The total onshore area of country C with a wind resource that can provide at least the minimum wind capacity factor given a hub height of h ($CF_{ONW,h} \geq CF_{ONW,\min}$) (km^2) (see discussion below)

$CAP_{ONW,h}$ = The rated capacity of an individual offshore wind turbine, with a hub height of h (5 MW here)

$SA_{ONW,h}$ = The average spacing area per onshore wind turbine with a hub height of h (0.70 km^2 for the turbine assumed here)

$CF_{ONW,h}$ = The wind capacity factor given a hub height of h

$CF_{ONW,\min}$ = The minimum capacity factor for qualifying the resource as potentially “technically” available (see discussion below)

Wind turbine spacing affects not only the capacity factor of installed turbines, but also land acquisition cost and social opposition (Enevoldsen and Sovacool, 2016). Thus, it is important to ensure that the spacing distances chosen for the 2050 WWS scenario is reasonable. A recent study analyzed the spacing of more than 1,000 operating wind turbines of different size covering 44 onshore and offshore wind farms worldwide (Enevoldsen and Valentine, 2016). The study found a median spacing of 4.2 times the rotor diameter, which corresponds to $A = 4.2D \times 4.2D = 0.28 \text{ km}^2$ per 5-MW Senvion (RePower) turbine, where D =turbine rotor diameter (126 m). This compares to a spacing area of $4D \times 11D = 0.70 \text{ km}^2$ assumed for the turbines proposed here. Thus, our estimate is conservative compared with data. In other words, a large buildout of wind turbines may in reality take up less space than proposed here. Real wind turbine spacing has decreased over time, due to improved technologies (Enevoldsen and Valentine, 2016).

Maximum allowable land area devoted to wind power. We assume that there is a limit to the amount of land that a country will devote to wind power development. We estimate this limit as a function of population density and non-urban population share, relative to reference points, with the assumption that the greater the population density and the urban population share, the smaller the maximum percentage of land area that can be devoted to wind power:

$$LA_{\max,ONW,C,TY} = LA_{\max,ONW,C,TY}^{\%} \cdot LA_C$$

$$LA_{\max,ONW,C,TY}^{\%} = \min \left[LA_{\max,ONW,upper}^{\%}, \max \left[LA_{\max,ONW,lower}^{\%}, LA_{\max,ONW,ref}^{\%} \cdot \left(\frac{PD_{C,TY}}{PD_{ref}} \right)^{\kappa_1} \cdot \left(\frac{1-URB_{C,TY}^{\%}}{1-URB_{ref}^{\%}} \right)^{\kappa_2} \right] \right]$$

where

$LA_{\max,ONW,C,TY}^{\%}$ = The maximum allowable percent of land area for onshore wind in country C in year TY

$LA_{\max,ONW,upper}^{\%}$ = The upper bound on the maximum allowable percentage (discussed below)

$LA_{\max,ONW,lower}^{\%}$ = The lower bound on the maximum allowable percentage (discussed below)

$LA_{\max,ONW,ref}^{\%}$ = The reference value maximum allowable percent of land area for onshore wind (discussed below)

$PD_{C,TY}$ = Population density of country C in year TY (persons/km²) (discussed elsewhere)

PD_{ref} = Reference population density (persons/km²) (discussed below)

$URB_{C,TY}^{\%}$ = The urban population share of country C in year TY (%) (see Appendix S3)

$URB_{ref}^{\%}$ = The reference urban population share (discussed below)

LA_C = Land area of country C (km²) (discussed elsewhere)

κ_1 = Exponent relating change in population density to change in the maximum allowable land percentage (discussed below)

κ_2 = Exponent relating change in non-urban population share to change in the maximum allowable land percentage (discussed below)

We use the non-urban share, rather than the urban share, because the function behaves more desirably when the non-urban share goes to zero than when the urban share goes to 100%. We set upper and lower bounds on the maximum allowable land percentage to keep it within reasonable bounds; in particular, without a lower bound the formula would evaluate to $LA\% = 0$ for countries with zero rural population, and this doesn't seem reasonable. We believe that bounds of 0.5% and 15% are reasonable.

We set the reference values to what we think are reasonable for the U.S. for ca. 2015: 6.5% maximum land area with U. S. population density and urban shares for 2015. Our investigation of the behavior of the function with different values of the exponents suggests that the most reasonable range of results is obtained with $\kappa_1 = -0.30$ and $\kappa_2 = 0.50$. For example, these exponent values result in $LA_{\max,ONW,C,TY}^{\%} = 0.5\%$ for a country a population density of 3000 persons/km² and an urban population share of 95%, and $LA_{\max,ONW,C,TY}^{\%} = 12.6\%$ for a country a population density of 15 persons/km² and an urban population share of 50%

Minimum qualifying capacity factor $CF_{ONW,min}$. If the technical potential capacity is defined without regard to economics, then *any* wind resource can provide technical potential – even, for example, if the resource is so poor that it results in a wind turbine operating at capacity for only one hour a year. However, it does not seem reasonable to count towards technical potential wind resources that provide capacity factors so low as to render wind power uneconomical under *any* conceivable circumstances, anywhere, at any time. Therefore, we count towards the technical potential capacity only those resources that *might* conceivably be exploited economically. Accordingly, we define the minimum qualifying capacity factor $CF_{wind,min}$ as the capacity factor below which no wind resource ever will be exploited, anywhere, and hence as the lower-bound capacity factor for determining the technical potential. We believe that a reasonable value for $CF_{wind,min}$ is just below 10%. (We pick a value just below 10% in order to capture a very small fraction of the wind resource in the lowest resource class.)

Total onshore area with minimum acceptable potential resource. This parameter is the sum of the areas in each capacity-factor class above the minimum, using the midpoint of each capacity factor class. The areas by capacity-factor class, for a turbine of height h , are based on the NREL estimates of land areas with wind resources of different capacity-factor classes at 50 m above the ground (corresponding to a 50-m turbine-hub height), with the midpoints of the NREL capacity-factor classes adjusted to account for the effects of (hub) heights greater than 50 m. Formally,

$$LA_{CF_{ONW,h} \geq CF_{ONW,min},C} = \sum_{\substack{j_{mid} \leq CF_{ONW,max} \\ j_{mid} \geq CF_{ONW,min}}} LA_{CF_{j_{mid},ONW,h},C}$$

$$LA_{CF_{j_{mid},ONW,h},C} = LA_{CF_{j_{mid},ONW,50}(\rightarrow CF_{j_{mid},ONW,h}),C}$$

$$CF_{j_{mid},ONW,h} = \frac{P_{PD,ONW,j_{mid},h}}{C_{PD,ONW,h}}$$

$$CF_{j_{mid},ONW,50} = \frac{P_{PD,ONW,j_{mid},50}}{C_{PD,ONW,50}}$$

$$CF_{j_{mid},ONW,h} = CF_{j_{mid},wind,50} \cdot \frac{P_{PD,ONW,j_{mid},h}}{C_{PD,ONW,h}} = CF_{j_{mid},ONW,50} \cdot \frac{C_{PD,ONW,50}}{C_{PD,ONW,h}} \cdot \frac{P_{PD,ONW,j_{mid},h}}{P_{PD,ONW,j_{mid},50}}$$

where

$LA_{CF_{j_{mid},ONW,h},C}$ = Onshore area of country C with a wind resource corresponding to capacity-factor class midpoint $CF_{j_{mid},ONW,h}$ at a height of h m (km^2)

$LA_{CF_{j_{mid},ONW,50},C}$ = Onshore area of country C with a wind resource corresponding to capacity-factor class midpoint $CF_{j_{mid},ONW,50}$ at a height of 50 m (km^2) (NREL, 2012c)

$CF_{j_{mid},ONW,50} \left(\rightarrow CF_{j_{mid},ONW,h} \right)$ = The capacity-factor midpoints at 50 m height mapped to the capacity-factor midpoints at h m height

$CF_{ONW,max}$ = The maximum capacity-factor class for wind (based on the adjusted maximum capacity-factor class in the NREL estimates)

$CF_{j_{mid},ONW,h}$ = The midpoint of capacity-factor class j , for a height of h m

$CF_{j_{mid},ONW,50}$ = The midpoint of capacity-factor class j , for a height of 50 m

$P_{PD,ONW,j_{mid},h}$ = The average annual power production, as areal power density, for onshore wind, at capacity-factor-class midpoint j_{mid} , for a height of h (MW/km^2)

$P_{PD,ONW,j_{mid},50}$ = The average annual power production, as areal power density, for onshore wind, at capacity-factor-class midpoint j_{mid} , for a height of 50 m (MW/km^2)

$C_{PD,ONW,h}$ = The rated capacity of an onshore wind turbine per unit ground area (areal power density) for a turbine of hub-height of h (MW/km^2) (=5 MW /0.70 km^2 = 7.16 MW/km^2 here, where $h=100$ m)

$C_{PD,ONW,50}$ = The rated capacity of an onshore wind turbine per unit ground area (areal power density) for a turbine of hub-height 50 m (assumed to be 6.0 MW/km^2)

Subscript j = Capacity-factor classes in the original NREL estimates (5% increments from 0 to over 45%: 0-5%, 5-10%, 10-15%...35-40%, 40-45%, 45%+)

Generally the minimum acceptable wind capacity factor falls between two capacity-factor-class midpoints (i.e., the minimum is almost never *exactly* equal to one of the class midpoints). In these cases, rather than count only wind power above the upper bracketing midpoint, we give a partial weight to the lower bracketing capacity-factor-class midpoint, where the weight is equal to:

$$\frac{CF_{j_{mid}-upper,ONW,h} - CF_{ONW,min}}{CF_{j_{mid}-upper,ONW,h} - CF_{j_{mid}-lower,ONW,h}}$$

and $CF_{j_{mid}-upper,ONW,h}$ is the capacity-factor -class midpoint immediately above $CF_{ONW,min}$, and

$CF_{j_{mid}-lower,ONW,h}$ is the wave-power-class midpoint immediately below.

The ratio $\frac{P_{PD,ONW,j_{mid},h}}{P_{PD,ONW,j_{mid},50}}$. The published NREL data for $LA_{CF_{j_{mid},ONW,50},C}$ show land area by capacity-

factor-class increments for a hub height of 50 m. Now, for any given area $LA_{WCF_{j_{mid},50},C}$, if the assumed hub height were increased to h , then generally the wind speed and hence wind power

would increase. Therefore, we adjust the NREL capacity-factor classes from their 50m-height basis to our h -height basis. (Note that this matters only because we have assumed some nonzero value of $CF_{ONW,\min}$: increasing $CF_{j_{mid},ONW,50}$ to $CF_{j_{mid},ONW,h}$ increases the land area above the threshold $CF_{ONW,\min}$.)

We define the ratio $\frac{P_{PD,ONW,j_{mid},h}}{P_{PD,ONW,j_{mid},50}} \equiv AF_{CF_{j_{mid},ONW,h}/CF_{j_{mid},ONW,50}}$. We assume that there is a maximum

adjustment factor based on the change in power output with height, and a minimum adjustment factor of 1.00 (no adjustment). We assume that the adjustment factor decreases logistically with increasing capacity factor, because in areas with very high wind speeds (and hence high capacity factors) at 50 m, there is less of an increase in wind speed from 50 m to 100 m based on a logarithmic or power-law wind speed profile. Formally,

$$AF_{CF_{j_{mid},ONW,h}/CF_{j_{mid},ONW,50}} = AF_{lower,h/50} + \frac{AF_{upper,h/50} - AF_{lower,h/50}}{1 + e^{k(CF_{ONW} - CF_{ONW,ref})} \cdot \left(\frac{AF_{upper,h/50} - AF_{ref,h/50}}{AF_{ref,h/50} - AF_{lower,h/50}} \right)}$$

$$AF_{ref,h/50} = 1 + k1 \cdot (AF_{upper,h/50} - AF_{lower,h/50})$$

where

$AF_{lower,h/50}$ = The lower bound of the adjustment factor (1.00)

$AF_{upper,h/50}$ = The upper bound of the adjustment factor (see discussion below)

$AF_{ref,h/50}$ = The adjustment factor at the reference wind capacity factor

$CF_{ONW,ref}$ = The reference wind capacity factor (0.325)

CF_{ONW} = The wind capacity factor

k = Exponent that determines steepness of decline from upper to lower limit (30; higher values make steeper declines)

$k1$ = Reference adjustment factor as a fraction of difference between upper and lower adjustment factors (0.541)

The upper bound of the adjustment factor is assumed to be slightly above the increase in power resulting from increasing the turbine height from 50 m to h , where the power varies with the cube of the change in wind speed,

$$AF_{upper,h/50} = k2 \cdot \left(\frac{V_{ONW,h}}{V_{ONW,50}} \right)^3$$

$$\frac{V_{ONW,h}}{V_{ONW,50}} = \left(\frac{h}{50} \right)^{\frac{1}{7}}$$

where

$k2$ = Upscaling factor (1.04)


$V_{ONW,h}$ = Wind speed at height h (m/sec)

$V_{ONW,50}$ = Wind speed at height 50 m (m/sec)

h = Height of turbine (we assume 100 m)

The parameter values shown above result in the logistic relationship shown in Figure S4.

Figure S4. The land-area adjustment factor due to increased height, as a function of the wind capacity factor class.

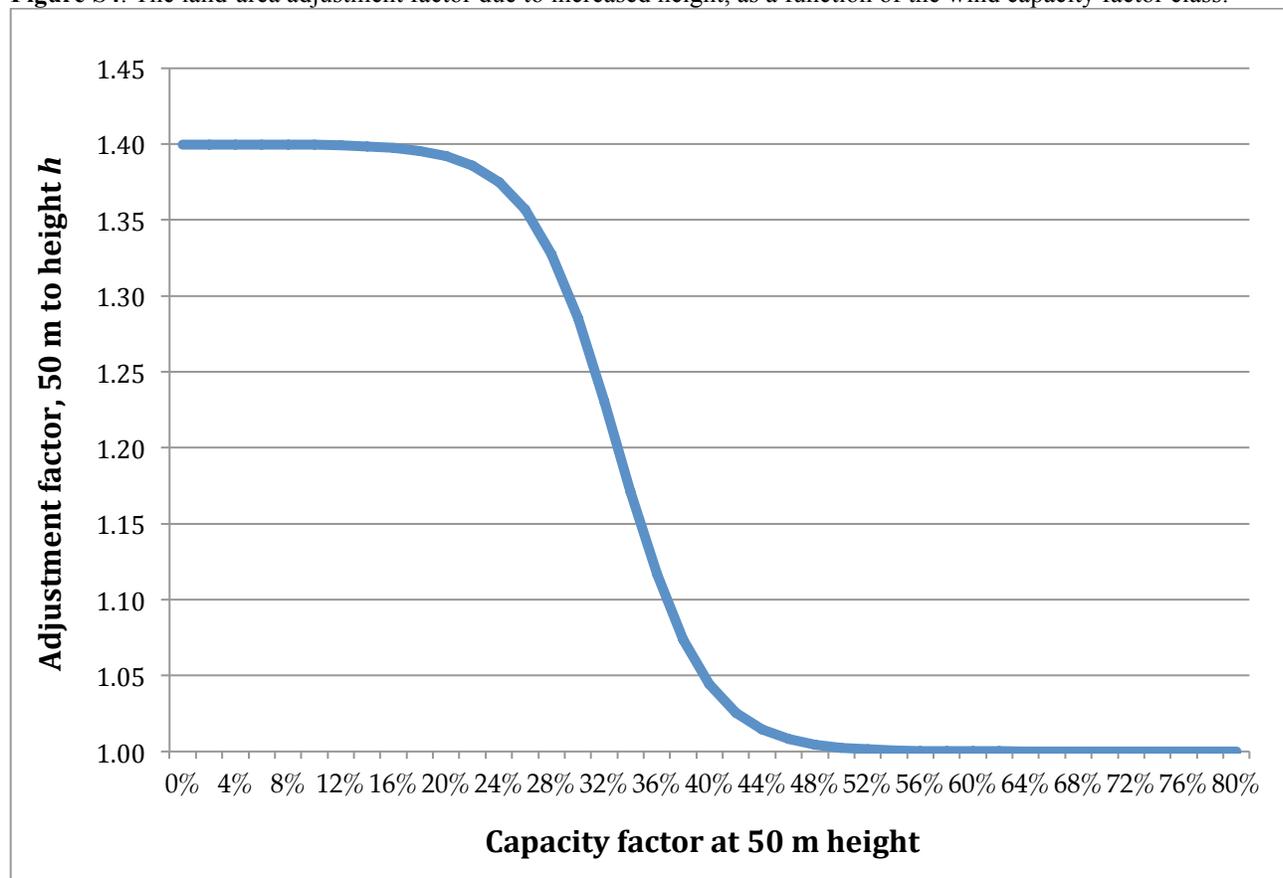

Technical potential for offshore wind

We use the National Renewable Energy Laboratory (NREL) estimates of technical potential offshore wind capacity by country (Arent et al., 2012), for offshore areas less than 60 meters deep and with a wind resource providing at least a 34% capacity factor. For countries not covered in NREL's analysis, we estimate the technical potential as the product of the areal power density for offshore wind systems and the coastal area suitable for wind power development,

$$C_{TP,OFFW,C} = C_{AD,OFFW} \cdot OA_C \cdot Sfr_{OFFW}$$

$$C_{AD,OFFW} = \frac{CAP_{OFFW}}{SA_{OFFW}}$$

$$OA_C = CL_C \cdot CLK_{OFFW} \cdot (OD_{max} - OD_{min})$$

where

$C_{TP,OFFW,C}$ = Total technical potential (*TP*) capacity of offshore wind power in country *C* (MW)

$C_{AD,OFFW}$ = The areal power density of offshore wind systems (MW/km²)

OA_C = The total offshore area of country *C* available for offshore wind farms (km²)

Sfr_{OFFW} = The fraction of available offshore area technically suitable for offshore wind development (5%; same for all countries)

CAP_{OFFW} = The rated capacity of an individual offshore wind turbine (5 MW)

SA_{OFFW} = The average spacing area per offshore wind turbine (0.70 km²)

CL_C = The reported length of coastline of country *C* (km) (CIA, 2016a)

$CL_C \cdot CLK_{OFFW}$ = The coastline convolution correction factor for offshore wind; equal to the ratio of the coastline length at approximately a 1 km resolution to the reported coastline length (same for all countries; see discussion below)

OD_{max} = Maximum distance from shore for wind turbines, reflecting economic and siting considerations (km; same for all countries; see discussion below)

OD_{min} = Minimum distance from shore for wind turbines, reflecting visual/esthetic considerations (km; same for all countries; see discussion below)

Coastline convolution correction factor for offshore wind. Because no coastline is perfectly straight at all scales (levels of resolution), the length of a coastline depends on the scale or level of resolution of the measurement. The smaller the scale, the longer the measured coastline: a measurement taken every cm will count the contours of rocks along the shore; a measurement taken every 100 km will result in straight lines cutting across large-scale features such as bays and peninsulas.

Because offshore wind turbines will be placed on the order of 0.5 to 1.0 km apart, the relevant coast-side length of the available offshore area should be measured at about a 1.0 km scale. It appears to us that the data source we use, the CIA's *World Factbook* (CIA, 2016a), takes measurements at close to this scale. We assume a correction factor of 70%.

Maximum and minimum distance from shore. The ocean coastal area suitable for offshore wind depends mainly on the distance from shore of shallow enough water, although floating turbines are now being commercialized. GWEC (2014) states, “at present, in Europe the average offshore wind turbine size is 3.7 MW, average water depth 22.4 meters and average distance from shore 32.9 km” (p. 53). NREL (Arent et al., 2012) assumes a minimum distance from shore of 5 nautical miles (9.26 km), and a maximum of 50 to 100 nautical miles (92.6 to 185.2 km). The minimum is meant to keep the turbines far enough offshore so that they are not really noticeable from shore; the maximum is based mainly on the need to minimize costs associated with installation in deeper waters.


With these considerations, we assume a minimum distance of 10 km and a maximum of 100 km.

As a check on the plausibility of our method, we applied it to estimate the technical potential for the countries covered in NREL's (Arent et al., 2012) analysis. Many of our estimates for particular countries differ considerably from NREL's, but because some of our estimates are higher while some are lower than NREL's, our estimated total potential for *all* countries is very close to NREL's. In any case, the technical potential estimated by this method for the countries not included in the NREL analysis is only 4% of the total potential estimated by NREL.

Results. Only 16.8% of the onshore technical potential and 32.6% of the near-shore offshore technical potential are proposed for use in 2050. Table S7 indicates that the 2050 WWS roadmaps require ~0.92% of the 139-country onshore land area and 0.55% of the 139-country onshore-equivalent land area that is sited offshore for wind-turbine spacing to power 37.1% of all-purpose annually averaged 139-country power in 2015.

As of the end of 2015, 5.04% of the proposed 8.33 TW of 2050 onshore wind nameplate capacity and 0.26% of the 4.69 TW of offshore wind capacity among the 139 countries had been installed. Figure S5 indicates that China, the United States, and Germany have installed the greatest capacity of onshore wind, whereas the United Kingdom, Germany, and Denmark have installed the most offshore wind to date.

Figure S5. Installed onshore and offshore wind power by country as of the end of 2015 from GWEC (2016) and EWEA (2016).

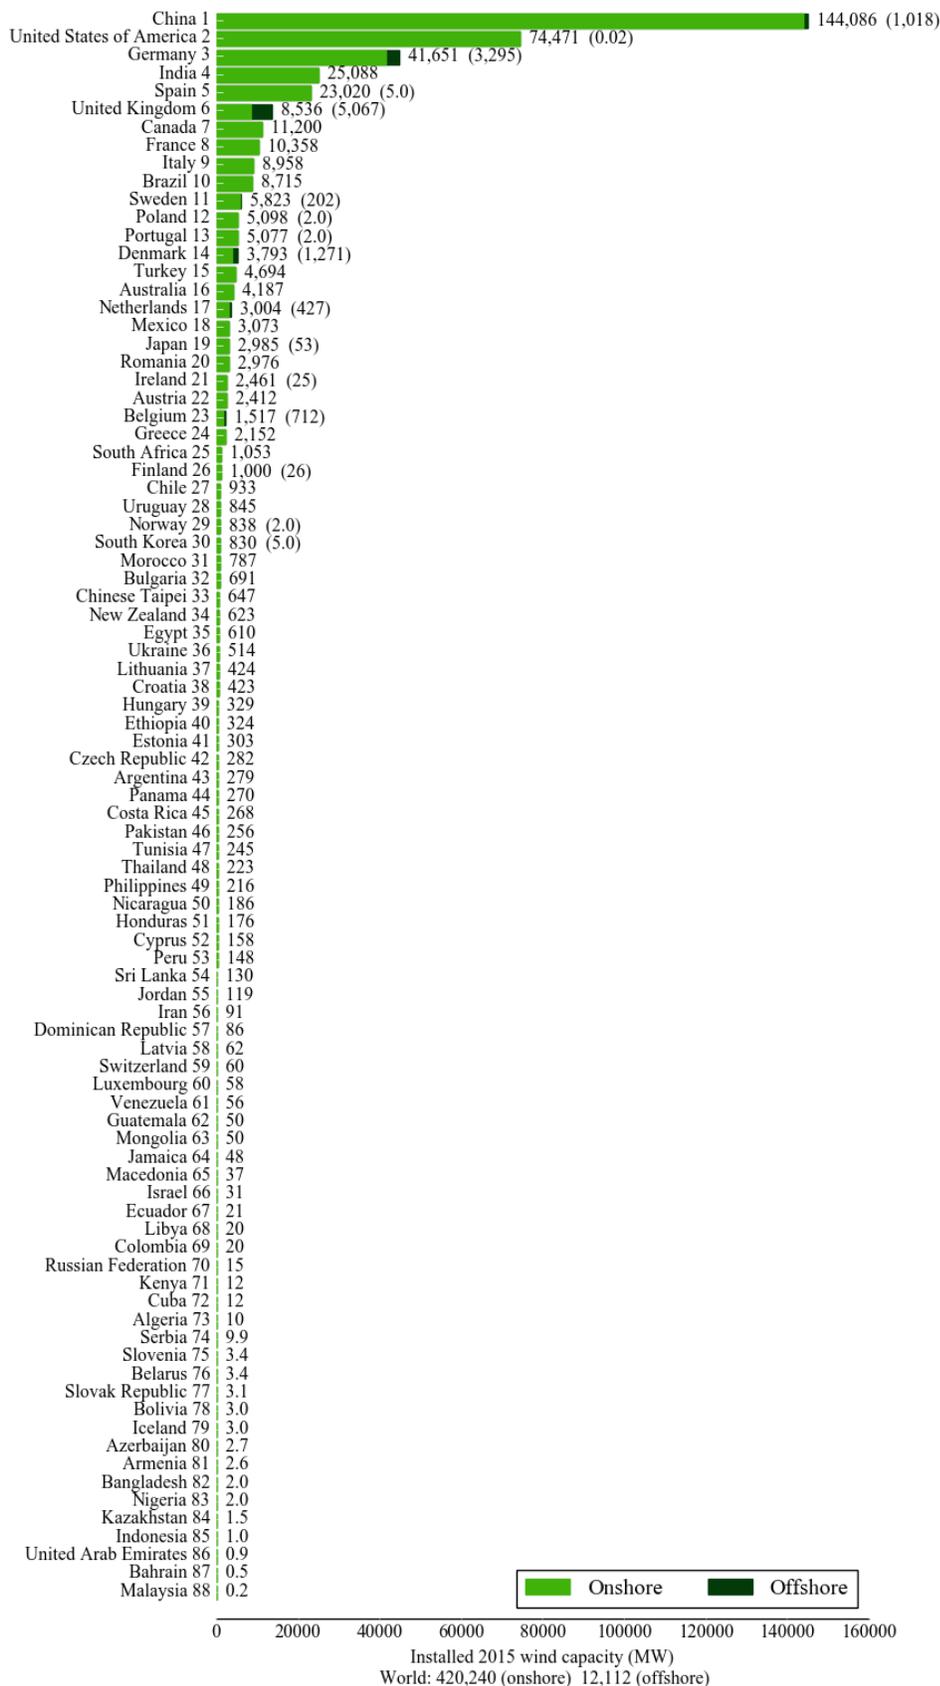


S5.2. Rooftop and Utility-Scale PV and CSP

Resources

Figure S6 shows annually averaged modeled solar irradiance worldwide accounting for sun angles, day/night, and clouds. The best solar resources are broadly between 40 °N and 40 °S. The new land area in 2050 required for non-rooftop solar under the roadmaps here is equivalent to ~0.22% of the 139-country land area (Table S7).

Figure S6. Modeled annually averaged downward direct plus diffuse solar irradiance at the ground (kWh/m²/day) worldwide. The model used is GATOR-GCMOM (Jacobson, 2007; 2010a,b; Ten Hoeve et al., 2012), which simulates clouds, aerosols gases, weather, radiation fields, and variations in surface albedo over time. The model is run with horizontal resolution of 2.5° W-E x 2.0° S-N.

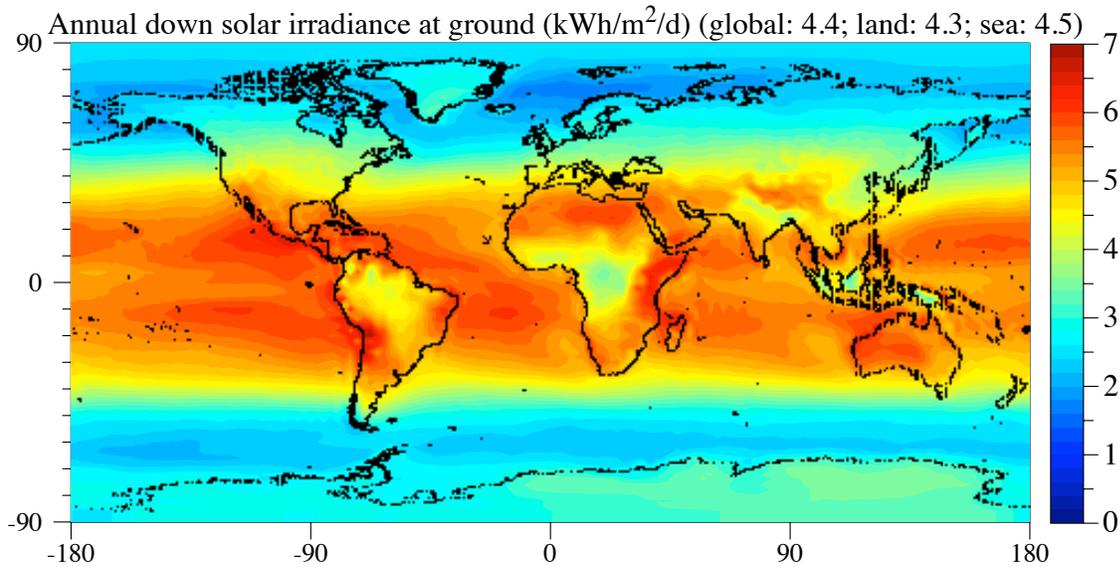

Technical potential of rooftop PV

In this section, we estimate the technical-economic potential and installed capacity of solar PV on the rooftops of residential buildings, residential parking structures, commercial/institutional/government buildings, and industrial/manufacturing facilities. In some instances we report results in two aggregated categories, residential and commercial, where *residential* includes residential parking rooftops and *commercial* includes manufacturing/industrial rooftops. Generally, we build from estimates of floor space to estimates of rooftop area and ultimately to the useable fraction of technical potential capacity.

Installed capacity

The estimated installed capacity of rooftop solar in the target year is equal to the technical potential multiplied by the fraction of the technical potential that we estimate is used:

$$C_{I,PVroof,C,TY} = C_{TP,PVroof,C,TY} \cdot U_{fr,PVroof,C,TY}$$

where

$C_{I,PVroof,C,TY}$ = Total installed capacity of rooftop solar power in country C in target year TY (MW)

$C_{TP,PVroof,C,TY}$ = Total technical-potential capacity of rooftop solar power in country C in target year TY (MW)

$Ufr_{PVroof,C,TY}$ = The fraction of technically suitable rooftop actually used for PVs in country C in target year TY

Technical potential

The technical potential is the product of the PV areal power density, the total rooftop area, the fraction of rooftop area that is technically suitable for PVs.

Formally,

$$C_{TP,PVroof,C,TY} = P_{AD,PVmod,TY} \cdot RA_{C,TY} \cdot Sfr_{PVroof,C}$$

where

$P_{AD,PVmod,TY}$ = The areal power density of PV modules in target year TY (MW/km²) (discussed below)

$Sfr_{PVroof,C}$ = The fraction of rooftop area technically suitable for rooftop PV in country C (discussed below)

$RA_{C,TY}$ = The total rooftop area of country C in target year TY (km²) (discussed below)

Areal power density of PV system

For all PV systems (commercial, residential, and utility-scale), in all countries, the base-year (2015) panel is a SunPower E20-327, which has a *dc* nameplate rating of 327W for a panel of 1.046m by 1.558m (SunPower, 2016), giving $P_{AD,PVmod,2015} = 201 \text{ W/m}^2$ in 2015. We assume that the panel efficiency and hence $P_{AD,PV}$ (power output at constant panel size) increases at 0.5%/year, based in part on estimates in the NREL (2012b).

Total rooftop area in each country

The total rooftop area for residential buildings, commercial/institutional/government buildings, and industrial/manufacturing buildings is the product of the floor area per capita, the population, an overhang multiplier, and a pitch (slope) multiplier, divided by the average number of stories,

$$RA_{C,TY} = \frac{FAC_{C,TY} \cdot P_{C,TY} \cdot OH_{C,TY} \cdot SL_C}{SB_{C,TY} \cdot 10^6}$$

$$SB_{C,TY} \equiv \frac{FA_{C,TY}}{CA_{C,TY}}$$

where

$FAC_{C,TY}$ = Floor area per capita in country C in target year TY (m^2 /capita)

$P_{C,TY}$ = The population in country C in year TY (see Appendix S3)

$OH_{C,TY}$ = The overhang multiplier covered parking-area roofs in country C in year TY

SL_C = Slope multiplier for pitched roofs in country C (assumed to be the same for all years)

$SB_{C,TY}$ = The average number of stories per building in country C in year Y

$FA_{C,TY}$ = The total (all-stories) floor area in country C in year TY (m^2)

$CA_{C,TY}$ = The upper ceiling area in country C in year TY (essentially the flat underside of the roof, excluding any overhang) (m^2)

The method to estimate the rooftop area of residential parking is slightly different, and is presented later.

Floor area per capita (FAC) for residential and commercial buildings

For residential buildings (not including residential parking) and commercial/institutional/government buildings (not including industrial/manufacturing facilities), the total floor area per capita (FAC) for each country in year TY ($FAC_{C,TY}$) is calculated as a function of GDP per capita (divided by 1000), population density, and urban population percentage in a prior year, on the assumption that floor area per capita is related to construction activity in prior years. The function is calibrated to base-year estimates of FAC for several European countries and the United States, and is constrained to above minimum and below maximum values.

For countries for which we have reported base-year data on FAC (Table S9), we calculate $FAC_{C,TY}$ by scaling the base-year data (Table S9) by the ratio of estimated target-year to base-year FAC ; otherwise, we use estimated target-year FAC directly. Formally,

If we have base-year data on FAC for country C , then

$$FAC_{C,TY} = FAC_{C,BY} * \frac{\hat{FAC}_{C,TY}}{\hat{FAC}_{C,BY}} \cdot FAC_{correction}$$

Otherwise,

$$FAC_{C,TY} = \hat{FAC}_{C,TY} \cdot FAC_{correction}$$

$$\hat{FAC}_{C,TY} = \min \left[FAC_{\max,TY}, \max \left[FAC_{\min,TY}, \beta 1 \cdot \left(\frac{GDPC_{C,TY-L_{BD}}}{1000} \right)^{\delta 1} + \beta 2 \cdot \left(\frac{GDPC_{C,TY-L_{BD}}}{1000} \right)^{\delta 2} + \beta 3 \cdot \left(\frac{GDPC_{C,TY-L_{BD}}}{1000} \right)^{\delta 3} + \beta 4 \cdot PD_{C,TY-L_{BD}}^{\delta 4} + \beta 5 \cdot PD_{C,TY-L_{BD}}^{\delta 5} + \beta 6 \cdot URB\%_{C,TY-L_{BD}}^{\delta 6} + \beta 7 \right] \right]$$

$$PD_{C,TY} = \frac{P_{C,TY}}{LA_C}$$

where

$\hat{FAC}_{C,TY}$ = Estimated floor area per capita in country C in target year TY (m^2 /capita) (discussed below)

$FAC_{C,BY}^*$ = Reported base-year data on floor-area per capita (Table S9)

$FAC_{correction}$ = Factor to correct for omissions in the reported base-year data (discussed below)

$\frac{GDPC_{C,TY-L_{BD}}}{1000}$ = GDP per capita in country C in year $TY-L$, divided by 1000 (constant year-2013 international dollars, PPP basis; see section “Projection of GDP per capita”)

$PD_{C,TY-L_{BD}}$ = The population density of country C in year $TY-L$

LA_C = The total onshore area of country C (km^2) (World Bank, 2016b; except values for Gibraltar, Taiwan (Chinese Taipei), and Netherlands Antilles from Wikipedia, 2016d)

$URB\%_{C,TY-L_{BD}}$ = The percentage of the population in urban areas in country C in year $TY-L$ (see Appendix S3)

L_{BD} = The effective (average) lag between the target year and the year of the economic and demographic conditions that determine building characteristics in the target year (discussed below)

$\beta 1... \beta 7$ and $\delta 1... \delta 6$ are estimated parameters (discussed below; Table S10)

$FAC_{\min,TY}$ = The minimum floor space per capita in year TY (m^2 /capita), linearly interpolated based on the following assumed points:

2010	2060	
7.0	10.5	Residential
1.2	1.8	Service (commercial/institutional/government)

$FAC_{\max,TY}$ = The maximum floor space per capita in year TY (m^2 /capita), linearly interpolated based on the following assumed points:

2010	2050	
65.0	81.3	Residential
35.0	43.8	Service (commercial/institutional/government)

Table S9. Residential and commercial floor space per capita in selected countries.

Country	m ² floorspace/capita		Year	Source
	Residential	Commercial		
Austria	40.96	13.71	2008	Entranze
Belgium	35.28	9.74	2008	Entranze
Bulgaria	25.87	8.37	2008	Entranze
Cyprus	48.80	9.74	2008	Entranze
Czech Republic	29.68	8.51	2008	Entranze
Denmark	54.36	22.38	2008	Entranze
Estonia	27.87	8.96	2008	Entranze
Finland	37.53	20.11	2008	Entranze
France	38.77	14.19	2008	Entranze
Germany	39.39	13.47	2008	Entranze
Greece	28.77	12.48	2008	Entranze
Hungary	30.22	9.84	2008	Entranze
Ireland	41.75	9.77	2008	Entranze
Italy	42.92	6.93	2008	Entranze
Latvia	28.00	7.60	2008	Entranze
Lithuania	30.90	9.25	2008	Entranze
Luxembourg	33.77	10.03	2008	Entranze
Malta	32.82	9.68	2008	Entranze
Netherlands	38.45	17.97	2008	Entranze
Poland	24.70	10.11	2008	Entranze
Portugal	38.59	9.67	2008	Entranze
Romania	21.23	2.76	2008	Entranze
Slovak Republic	24.51	7.05	2008	Entranze
Slovenia	29.91	13.54	2008	Entranze
Spain	33.97	7.58	2008	Entranze
Sweden	41.75	16.48	2008	Entranze
United Kingdom	31.35	11.99	2008	Entranze
United States	68.88	25.95	2009/12	EIA 2009 RECS, 2012 CBECS
Serbia	22.28	7.43	2008	Entranze
Croatia	25.44	7.26	2008	Entranze

Sources: Entranze = Entranze, 2015; RECS = EIA 2009 Residential Energy Consumption Survey (RECS; EIA, 2013a); CBECS = 2012 Commercial Buildings Energy Consumption Survey (CBECS; EIA, 2016d). The Entranze data are reported for the residential and the non-residential “service” sectors, with the latter including “office buildings, hospitals, schools and universities, hotels and restaurants, buildings in wholesale and retail trade” (Sebi et

al., 2013, p. 11). This is consistent with the EIA's CBECS "commercial" sector and with our "commercial/institutional/government" sector. The FAC estimate for the residential sector in Israel is based on our review of the literature. The FAC estimate for the commercial sector in Israel is our assumption.

The effective lag L_{BD} accounts for the fact that the relevant characteristics (such as floor space) of buildings in any year Y presumably were determined by economic and demographic variables (such as GDP per capita) in years prior to Y , mainly because most buildings existing in year Y were built many years prior to Y . If building characteristics were determined by the economic and demographic conditions at the time the buildings were built, then L_{BD} is approximately the average age of buildings. This presumably is the maximum reasonable value of L_{BD} . However, builders are aware that buildings exist

The effective lag L_{BD} accounts for the fact that the relevant characteristics (such as floor space) of buildings in any year Y presumably were determined by economic and demographic variables (such as GDP per capita) in years prior to Y , mainly because most buildings existing in year Y were built many years prior to Y . If building characteristics were determined by the economic and demographic conditions at the time the buildings were built, then L_{BD} is approximately the average age of buildings. This presumably is the maximum reasonable value of L_{BD} . However, builders are aware that buildings exist for many years and hence ought to accommodate future needs, and thus in some fashion probably build in anticipation of future economic and demographic conditions. If builders have good foresight and do long-range planning with no "discounting," then they build in anticipation of the conditions when the building is roughly at its average age, which results in L_{BD} being about zero (the minimum value, of course).

An analysis of the distribution of building ages from the EIA's *Commercial Buildings Energy Consumption Survey* (CBECS), (EIA, 2016d) and *Residential Energy Consumption Survey* (RECS) (EIA, 2013a) suggests that floor-space weighted average age is about 32 years for commercial buildings and 36 years for residential buildings. (Note that the EIA's definition of "commercial" includes institutional and government buildings.) If we exclude the oldest buildings (60+ years for commercial, 55+ years for residential) on the grounds that buildings today are not built for as long a life, then the average age is 27 commercial buildings and 28 for residential. Thus, in the U. S., L_{BD} can range from 0 to about 30 years. Without further analysis, we assume a mid-range value of 15 years for L_{BD} . This means, for example, that the average building in the year 2050 was built in about 2020 on the basis of conditions anticipated for the year 2035.

The reported base-year residential data of Table S9 from Entranze (2016) include only the conditioned or living area of permanently occupied dwellings; they do not include areas of vacant homes, second homes, or spaces such as shared hallways in multi-family dwellings (Sebi et al., 2013; country reports from Entranze, 2016). However, these areas are relevant to our analysis because they have roof area that is available for PVs. We assume that this area is 2% of the uncorrected estimated floor space in all countries for which we use the Entranze data.

We assume that the reported service (commercial/institutional/government) area data do not include covered (or potentially coverable) parking areas *not* underneath floorspace that is included in the reported data. We assume that this area is 5% of the uncorrected estimated floor space in all countries.

The residential data of Table S9 also presumably do not include areas of residential garages, so we estimate this separately.

Table S10. Parameters in the estimation of FAC .

	$\delta 1$	$\delta 2$	$\delta 3$	$\delta 4$	$\delta 5$	$\delta 6$	$\beta 1$	$\beta 2$	$\beta 3$	$\beta 4$	$\beta 5$	$\beta 6$	$\beta 7$
$\hat{FAC}_{res,C,Y}$	1.279	1.378	0.000	0.287	0.000	0.010	1.517	-0.851	25.469	-1.802	-1.567	0.799	-0.193
$\hat{FAC}_{com,C,Y}$	1.618	1.547	1.471	0.126	0.094	0.146	0.786	-2.435	1.950	4.299	-11.900	5.835	2.266

res. = residential; *com* = commercial; *n.a.* = not applicable.

The parameters $\beta 1... \beta 7$ and $\delta 1... \delta 6$ are estimated by using a genetic algorithm to find the best (error-minimizing) fit of the polynomial to base-year data on FAC , $GDPC$, PD , and $URB\%$, for several European countries. Table S9 shows the base-year (2008) FAC data; the other base-year data ($GDPC$, PD , and $URB\%$) are estimated as described elsewhere in this documentation. We assume that the “service” category in Tables S9 is the same as our “commercial” category. Table S10 shows the fitted parameters $\beta 1... \beta 7$ and $\delta 1... \delta 6$. These parameters, along with the minimum and maximum constraints, give reasonable results for years from 2005 to 2075.

Floor area per capita (FAC) for manufacturing/industrial buildings

For manufacturing/industrial buildings, FAC is calculated as function of $GDPC$, PD , $URB\%$ and a reference value of FAC for the U. S.,

$$FAC_{ind,C,TY} = FAC_{ind,US,RY_{ind}} \cdot \min \left[\frac{FAC_{ind,C,TY}}{FAC_{ind,US,RY_{ind}}} \Big|_{\max}, \overline{GDPC}_{C,\bar{Y}} \cdot \overline{PD}_{C,\bar{Y}} \cdot \overline{URB\%}_{C,\bar{Y}} \right]$$

where

$FAC_{ind,C,TY}$ = Floor area per capita in the industrial sector in country C in year TY (m^2 /capita)

$FAC_{ind,US,RY_{ind}} = FAC_{ind,C,TY}$ = Floor area per capita in the industrial sector in the U. S. in reference year RY_{ind} (m^2 /capita) (discussed below)

$\left. \frac{FAC_{ind,C,TY}}{FAC_{ind,US,RY_{ind}}} \right|_{\max}$ = The maximum value of the ratio of FAC for country C in year TY to FAC for the U. S. in year RY (assume 2.5)

$\overline{GDPC}_{C,\bar{Y}}$ = Adjusted relative GDP per capita in country C , for \bar{Y}

$\overline{PD}_{C,\bar{Y}}$ = Adjusted relative population density in country C , for \bar{Y}

$\overline{\overline{URB\%}}_{C,\bar{Y}}$ = Adjusted relative urban population share in country C , for \bar{Y}

The $GDPC$, PD , and $URB\%$ parameters are a nonlinear function of the parameter for each country relative to that for the U. S., where the exponent (or elasticity) is itself a function of the relative parameter:

$$\overline{\overline{GDPC}}_{C,\bar{Y}} = GDPC'_{C,\bar{Y}}^{\varepsilon_1 \cdot GDPC'_{C,\bar{Y}}^{\alpha_1}} \quad \overline{\overline{PD}}_{C,\bar{Y}} = PD'_{C,\bar{Y}}^{\varepsilon_2 \cdot PD'_{C,\bar{Y}}^{\alpha_2}}$$

$$\overline{\overline{URB\%}}_{C,\bar{Y}} = URB\%_{C,\bar{Y}}^{\varepsilon_3 \cdot URB\%_{C,\bar{Y}}^{\alpha_3}}$$

$$\overline{\overline{GDPC}}_{C,\bar{Y}} = \frac{GDPC_{C,TY-L_{ind}}}{GDPC_{US,RY_{ind}-L_{ind}}} \quad \overline{\overline{PD}}_{C,\bar{Y}} = \frac{PD_{C,TY-L_{ind}}}{PD_{US,RY_{ind}-L_{ind}}}$$

$$\overline{\overline{URB\%}}_{C,\bar{Y}} = \frac{URB\%_{C,TY-L_{ind}}}{URB\%_{US,RY_{ind}-L_{ind}}}$$

where

$GDPC'_{C,\bar{Y}}$ = GDP per capita in country C relative to the U. S., for \bar{Y}

$PD'_{C,\bar{Y}}$ = Population density in country C relative to the U. S., for \bar{Y}

$URB\%_{C,\bar{Y}}$ = Urban population share in country C relative to the U. S., for \bar{Y}

\bar{Y} = Estimate based on year $TY - L_{ind}$ for country C and year $RY_{ind} - L_{ind}$ for the U. S.

$\bar{Y} \varepsilon_1, \varepsilon_2, \varepsilon_3, \alpha_1, \alpha_2, \alpha_3$ = Exponents (Table S11)

TY = Target year of the analysis

RY_{ind} = Year of reference value of floorspace per capita in the industrial sector

$RY_{ind} - L_{ind}$ = The effective (average) lag between the target or reference year and the year of the economic and demographic conditions that determine industrial-building characteristics in the target or reference year (discussed below)

$RY_{ind} - L_{ind} GDPC_{C,Y}$, $PD_{C,Y}$, and $URB\%_{C,Y}$ are discussed in the Appendices S1..S3

The EIA's *Manufacturing Energy Consumption Survey* (MECS) reports 11,000 billion square feet of total enclosed floorspace at manufacturing facilities in the U. S. in 2010 (EIA, 2013b). We use this value to calculate $FAC_{ind,US,RY_{ind}}$ for the U. S. for 2010. About half of the square footage is in the food, chemicals, plastics, fabricated-metals, and transportation-equipment industries.

As discussed above in the estimation of FAC for residential and non-industrial commercial buildings, the effective lag L accounts for the fact that the relevant characteristics (such as floor space) of buildings in any year Y presumably were determined by economic and demographic variables (such as GDP per capita) in years prior to Y , mainly because most buildings existing in

year Y were built many years prior to Y . On the assumption that industrial buildings generally are older than commercial buildings, we assume that L_{ind} is 20 years, which is larger than L_{BD} .

Table S11. Estimation of the floors pace of industrial buildings.

	α	ϵ	Comment
1. $GDPC$	-0.48	0.2	Makes $\overline{\overline{GDPC}}_{C,\bar{Y}}$ much more sensitive to decreases in $GDPC'_{C,\bar{Y}}$ than to increases; as $GDPC'_{C,\bar{Y}}$ approaches highest values, $\overline{\overline{GDPC}}_{C,\bar{Y}}$ is only ~ 1.15 , but as $GDPC'_{C,\bar{Y}}$ approaches lowest values, $\overline{\overline{GDPC}}_{C,\bar{Y}}$ is close to zero.
2. PD	0.34	-0.09	Makes $\overline{\overline{PD}}_{C,\bar{Y}}$ much more sensitive to increases in $PD'_{C,\bar{Y}}$ than to decreases; as $PD'_{C,\bar{Y}}$ approaches highest values, $\overline{\overline{PD}}_{C,\bar{Y}}$ approaches zero, but as $PD'_{C,\bar{Y}}$ approaches zero, $\overline{\overline{PD}}_{C,\bar{Y}}$ increases to only ~ 1.10 .
3. $URB\%$	5.00	-0.80	Makes $\overline{\overline{URB\%}}_{C,\bar{Y}}$ much more sensitive to increases in $URB\%'_{C,\bar{Y}}$ than to decreases; as $URB\%'_{C,\bar{Y}}$ approaches 100%, $\overline{\overline{URB\%}}_{C,\bar{Y}}$ drops below 0.5, but as $URB\%'_{C,\bar{Y}}$ approaches 0%, $\overline{\overline{URB\%}}_{C,\bar{Y}}$ actually returns to 1.00

Overhang multiplier (OH)

The overhang multiplier accounts for the fact that roofs typically overhang the floor area below. Assuming that the overhang distance does not increase in proportion to floor area, then the multiplier decreases with increasing floor area. Table S12 shows the overhang multiplier for four different building sizes and six roof overhangs. Table S12 shows that the overhang multiplier can range from 1.01 for large industrial buildings with small overhangs, to 1.5 for small houses with large overhangs.

Here we assume a simple nonlinear relationship between the multiplier, upper-ceiling-area per capita, and latitude, around a reference values,

$$OH_{C,TY} = \max \left[OH_{\min}, \min \left[OH_{\max}, OH_{ref} \cdot \left(\frac{CAC_{C,TY}}{CAC_{ref}} \right)^{\phi_1} \cdot \left(\frac{LAT_{ave,C}}{LAT_{OH,ave,ref}} \right)^{\phi_2} \right] \right]$$

$$CAC_{C,TY} = \frac{FAC_{C,TY}}{SB_{C,TY}}$$

where

OH_{\min} = the minimum overhang multiplier

OH_{\max} = the maximum overhang multiplier

OH_{ref} = the reference overhang multiplier

CAC_{ref} = the reference upper ceiling area per capita (m^2 /capita) (the calculated 139-country average)

$CAC_{C,TY}$ = the upper ceiling area per capita in country C in year TY (essentially the flat underside of the roof, excluding any overhang) (m^2 /capita)

$LAT_{OH,ave,ref}$ = the reference average latitude for the overhang-multiplier estimate

$LAT_{ave,C}$ = the average latitude of country C (degrees)

$\phi 1$ = exponent relating changes in ceiling area to changes in overhang

$\phi 2$ = exponent relating changes in latitude to changes in overhang

All parameter values are discussed in Table S13. With these assumptions, the overhang multiplier OH averages 1.17 for residential buildings, 1.27 for residential parking, 1.05 for commercial/institutional/government buildings, and 1.02 for industrial/manufacturing buildings.

Table S12. Overhang multiplier as a function of building size and overhang.

Type of building	Ceiling area	Feet of overhang					
		0.50	1.00	1.50	2.00	2.50	3.00
Small residential building	750	1.08	1.16	1.24	1.33	1.42	1.51
Residential buildings, U. S.	1,499	1.06	1.11	1.17	1.23	1.29	1.35
Commercial buildings, U. S.	10,004	1.02	1.04	1.06	1.09	1.11	1.13
Industrial buildings, U. S.	31,996	1.01	1.02	1.04	1.05	1.06	1.07
Residential buildings, world	1,050	1.07	1.13	1.21	1.28	1.35	1.43
Commercial buildings, world	7,003	1.03	1.05	1.08	1.10	1.13	1.16
Industrial buildings, world	22,397	1.01	1.03	1.04	1.06	1.07	1.09

Ceiling area is the “upper ceiling area” as estimated in this section. Average upper ceiling area per building in the U. S. is calculated using U. S. EIA data on number of buildings and total square footage, as reported in the EIA’s RECS, CBECS, and MECS, and our estimates of number stories, as described elsewhere in this SI. On the basis of our estimates here, we assume that world-average building areas are 70% of U. S. values. Commercial buildings include institutional and government buildings. We assume that buildings are rectangles with one side twice the other.

Multiplier for sloped roofs (SL)

The slope multiplier accounts for the fact that for pitched roofs, the roof area exceeds the floor area, as a function of the slope angle. The slope multiplier is calculated as a function of the percentage of roofs that are pitched (or sloped; as opposed to almost flat) and the average slope:

$$SL_C = 1 - SL\%_C + \frac{SL\%_C}{\cos[SL\theta_C]}$$

where

$SL\%_C$ = the percentage of pitched (sloped) roofs in country C

$SL\theta_C$ = the average slope of pitched roofs in country C (degrees)

These parameters are estimated as a function of the country latitude, with fewer flat roofs and greater slope with increasing latitude, on the assumptions the further from the equator, the greater average snowfall and the consequent need for steeper roofs for shedding snow. Formally,

$$SL\%_C = \min \left[SL\%_{\max}, \max \left[SL\%_{\min}, SL\%_{ref} \cdot \left(\frac{LAT_{ave,C}}{LAT_{SL,ave,ref}} \right)^{\partial 1} \right] \right]$$

$$SL\theta_C = \min \left[SL\theta_{\max}, \max \left[SL\theta_{\min}, SL\theta_{ref} \cdot \left(\frac{LAT_{ave,C}}{LAT_{SL,ave,ref}} \right)^{\partial 2} \right] \right]$$

where

$SL\%_{\max}$ = The maximum percentage of sloped roofs in a country

$SL\%_{\min}$ = The minimum percentage of sloped roofs in a country

$SL\%_{ref}$ = The percentage of sloped roofs at the reference latitude

$LAT_{SL,ave,ref}$ = The reference average latitude for the slope-multiplier estimate (assume 38 degrees)

$SL\theta_{\max}$ = The maximum average slope of pitched roofs in a country

$SL\theta_{\min}$ = The minimum average slope of pitched roofs in a country

$SL\theta_{ref}$ = The average of slope of pitched roofs at the reference latitude

$\partial 1$ = Exponent relating changes in latitude to changes in percentage of sloped roofs

$\partial 2$ = Exponent relating changes in latitude to changes in slope angle

Table S14 provides all parameter values, which are used for all 139 countries. With these assumptions, the slope correction factor SL varies from 1.0 to 1.16 with an average of 1.08 for residential, 1.00 - 1.08 [1.04 avg.] for residential parking, 1.00 - 1.04 [1.02] for commercial/institutional/government, and 1.00 - 1.02 [1.01] for industrial/manufacturing.

Stories per building (SB)

The average number of stories per commercial/ institutional/government building in country C in year Y , $SB_{com,C,TY}$, is estimated as a function of GDP per capita, population density, urban percentage, with respect to reference values, fit to synthetic data. Formally,

$$SB_{com,C,TY} = \min \left[SB_{max,com}, \max \left[SB_{min,com}, \beta 1 + SB_{com,Cref,RY} \cdot \left(\frac{GDPC_{C,Y-L_{BD}}}{GDPC_{Cref,RY-L_{BD}}} \right)^{\delta 1} \cdot \left(\frac{PD_{C,Y-L_{BD}}}{PD_{Cref,RY-L_{BD}}} \right)^{\delta 2} \cdot \left(\frac{URB\%_{C,Y-L_{BD}}}{URB\%_{Cref,RY-L_{BD}}} \right)^{\delta 3} \right] \right]$$

$$SB_{com,Cref,RY} = SB_{com,Cref,RY}^* - \beta 1$$

where

$SB_{max,com}$ = the maximum allowable value of SB in the commercial sector (30 stories per building)

$SB_{min,com}$ = the minimum allowable value of SB in the commercial sector (1.02 stories per building)

$SB_{com,Cref,RY}$ = the part of the reference SB that varies with $GDPC$, PD , and $URB\%$

Table S13. Parameters in the estimation of the roof-overhang multiplier.

<i>Parameter</i>	Residential		Res. parking		Com.	Ind.	Comment
	<i>urban</i>	<i>non-urban</i>	<i>urban</i>	<i>non-urban</i>			
OH_{\min}	1.05	1.05	1.06	1.06	1.01	1.00	See Table S12. Overhang multiplier is larger for buildings with smaller ceiling area, and we assume buildings are smaller in urban areas. However, we also assume buildings in urban areas, and commercial and industrial buildings, have smaller overhangs.
OH_{\max}	1.35	1.35	1.45	1.45	1.15	1.08	
OH_{ref}	1.16	1.16	1.20	1.20	1.025	1.015	See Table S12. The reference values here apply to the 139-country averages ceiling areas.
$\phi 1$	-0.10	-0.10	-0.10	-0.10	-0.10	-0.10	The overhang decreases slightly with increasing ceiling area.
$LAT_{OH,ave,ref}$	38	38	38	38	38	38	Our assumption.
$\phi 2$	0.00	0.00	0.00	0.00	0.00	0.00	Presently we assume that OH does not vary by latitude.

Res. parking = residential parking; *Com.* = commercial/institutional/government; *Ind.* = industrial/manufacturing.

Table S14. Parameters in the estimation of the rooftop slope adjustment factor.

	Residential		Res. Park.		Commercial		Industrial		Comment
	SL%	SL θ	SL%	SL θ	SL%	SL θ	SL%	SL θ	
Min.	20%	10	15%	7	15%	5	5%	5	We believe that most countries will have at least 15-20% pitched roofs. We assume characteristics of res. parking are between those of residential and commercial. Assume industrial buildings generally have flat roofs.
Max.	99%	65	95%	65	95%	65	50%	45	Our judgment.
Ref.	90%	26	65%	21	25%	23	15%	20	Residential, commercial based on values for cool regions of California (Jacobson et al., 2014). See also Melius et al. (2013). Assume industrial buildings generally have flat roofs.
Exp. ∂	-0.30	-0.30	-0.30	-0.30	-0.35	-0.35	-0.30	-0.30	Our judgment, assuming small deviations away from ref values.
<i>Results</i>									
Min.	22%	10	16%	7	15%	5	5%	5	
Max.	99%	30	76%	25	30%	28	18%	23	
Ave.	79%	23	57%	19	22%	20	13%	18	
SD	18%	5.0	13%	4.1	5%	5.1	3%	4.0	

Res. Park. = residential parking; *Commercial* includes commercial/institutional/government *Min.* = minimum; *Max.* = maximum; *Ref.* = reference value; *Exp.* = exponent; *Ave.* = average; *SD* = standard deviation.

$SB_{com,Cref,RY}^*$ = The reference level of *SB*: stories per building in the commercial sector in reference country *Cref* in reference year *RY* (discussed below)

$GDPC_{Cref,RY-LBD}$ = The reference level of *GDPC*: GDP per capita in the commercial sector in reference country *Cref* in reference year *RY* (discussed below)

$PD_{Cref,RY-LBD}$ = The reference level of *PD*: population density in the commercial sector in reference country *Cref* in reference year *RY* (discussed below)

$URB\%_{Cref,RY-LBD}$ = The reference level of *URB%*: the urban percentage in the commercial sector in reference country *Cref* in reference year *RY* (discussed below)

RY = The year of reference data (discussed below)

Cref = The reference country (U. S.)

β_1 and $\delta_1 \dots \delta_3$ are estimated parameters (dependent on whether *GDPC*, *PD*, or *URB%* are above or below its reference value; Table S15a)

Subscript *com* = Commercial/institutional/government

Other parameters are discussed in the estimation of *FAC*

The equation is fit to synthetic data that represent our judgment of how stories per building vary with GDP per capita, population density, and the urban fraction of population. The fit is subject to constraints on the predicted minimum, maximum, and average values for all 139 countries for the year 2020 and the year 2075, as shown in Table S15b.

The reference values are based on data for the U. S. in 2012. The EIA's *Commercial Building Energy Consumption Survey* (CBECS) reports floor space and number of floors for all commercial buildings in the U. S. in 2012 (EIA, 2016e). In the CBECS (EIA, 2016f):

Commercial buildings include all buildings in which at least half of the floorspace is used for a purpose that is not residential, industrial, or agricultural. By this definition, CBECS includes building types that might not traditionally be considered commercial, such as schools, hospitals, correctional institutions, and buildings used for religious worship, in addition to traditional commercial buildings such as stores, restaurants, warehouses, and office buildings.

We assume that buildings in the EIA category "4 to 9 stories" have 6 stories, and that buildings in the category "10 or more stories" have 15 stories. We also assume that the upper floors on 2-story and 3-story buildings cover 95% of the ground area of the first floor. With these assumptions, we calculate the total upper ceiling area, $CA_{com,US,2012}$, and then the average number

of stories as $SB_{com,US,2012} = \frac{FA_{com,US,2012}}{CA_{com,US,2012}}$, where $FA_{com,US,2012}$ is provided by the CBECS. The

result is 1.57, which seems reasonable. We then use U. S. 2012 values for $GDPC_{Cref,RY-LBD}$,

$PD_{Cref,RY-LBD}$, and $URB\%_{Cref,RY-LBD}$.

Table S15. Parameters for estimating stories per building.

Table S15.a. Exponents and intercept.

	$\delta 1$	$\delta 2$	$\delta 3$	$\beta 1$
Parameter above reference value	0.30	0.33	4.78	1.10
Parameter below reference value	0.34	1.20	0.24	

Table S15.b. Constraints on estimation of $SB_{com,C,TY}$.

	Year 2075, all countries			US 2075	Year 2020, all countries		
	avg SB	min SB	max SB	SB	avg SB	min SB	max SB
Lower bound	2.00	1.02	12.00	1.90	1.40	1.00	7.00
Upper bound	2.40	1.30	30.00	2.30	1.90	1.20	30.00

We assume that stories per building in the residential sector is related to stories in the commercial/institutional/government sector:

$$SB_{res,C,TY} = SB_{com,C,TY}^{\eta}$$

To estimate η , we compare the average number of stories per building in the residential sector with our estimate of 1.57 stories per commercial/institutional/government building in the U. S. in 2012. Using data from the U. S. EIA's *RECS* (EIA, 2013a), we estimate that all residential buildings in the U. S. averaged 1.32 stories in 2009. This implies that $\eta = \sim 0.6$ for all commercial/institutional/government and residential buildings in the U. S. On the assumption that urban residential buildings have more stories than do non-urban buildings, we assume η is 0.80 for urban areas and 0.50 in non-urban areas.

Finally, we assume that all industrial/manufacturing buildings in all countries and all years are one story.

Rooftop area of residential parking

As mentioned above, the calculation of the rooftop area of residential parking is slightly different:

$$RA_{respark,C,TY} = PCC_{C,TY} \cdot PKC_{C,TY} \cdot PKCV\%_{C,TY} \cdot PKR\%_{C,TY} \cdot PKAC_{C,TY} \cdot OH_{respark,C,TY} \cdot SL_{respark,C}$$

where

$PCC_{C,TY}$ = Passenger cars per capita in country C in target year TY (discussed below)

$PKC_{C,TY}$ = Residential parking spaces per car in country C in year TY (discussed below)

$PKCV\%_{C,TY}$ = The percentage of parking spaces that are covered in country C in year TY (discussed below)

$PKR\%_{C,TY}$ = The percentage of covered parking floor area that has an exposed roof, in country C in year TY (discussed below)

$PKAC_{C,TY}$ = Floor area per covered space (m^2 /space)

$OH_{respark,C,TY}$ $OH_{respark,C}$ = The overhang multiplier covered parking-area roofs in country C in year TY (see discussion of $OH_{C,TY}$ above)

$SL_{respark,C}$ = Slope multiplier for pitched covered parking-area roofs in country C (assumed to be the same for all years; see discussion of SL_C above)

To estimate passenger cars per capita, we start with World Bank estimates for the year 2006 and then project to future years assuming that ownership increases with wealth (GDP per capita) but decreases with population density, with the wealth effect dominating:

$$PCC_{C,TY} = \max \left[PCC_{\min,C}, \min \left[PCC_{\max}, PCC_{C,BY} \cdot \left(\frac{GDPC_{C,TY-L_{PCC}}}{GDPC_{C,BY-L_{PCC}}} \right)^{\Omega 1} \cdot \left(\frac{PD_{C,TY-L_{PCC}}}{PD_{C,BY-L_{PCC}}} \right)^{\Omega 2} \right] \right]$$

$$PCC_{\min,C} = PCC_{C,BY} \cdot (1 - \Delta PCC_{\max})$$

where

$PCC_{C,BY}$ = Passenger cars per capita in country C in base year BY (data from World Bank Development Indicators [World Bank, 2014; note that these data are no longer available], with missing data filled in as described in Delucchi et al. [2016] and with data for reference country [U.S.] from sources for $PCC_{Cref,RY-L_{PK}}$, for internal consistency)

$PCC_{\min,C}$ = Minimum passenger cars per capita in country C

ΔPCC_{\max} = Maximum fractional decrease in PCC below level in BY in country C (10%)

PCC_{\max} = Maximum passenger cars per capita (we assume 0.60, for all countries)

$\Omega 1$ = Exponent relating changes in GDP per capita to changes in the passenger cars per capita (we assume 0.75)

$\Omega 2$ = Exponent relating changes in population density to changes in the passenger cars per capita (we assume -0.20)

L_{PCC} = The effective (average) lag between the target or base year and the year of the economic an demographic conditions that determine passenger cars per capita in the target or base year (discussed below)

BY = Base year (2006)

Regarding the lag parameter L_{PCC} , see the discussion of L_{BD} in the estimation of floor area per capita. Because cars have a relatively short lifetime, we expect that L_{PCC} is much less than L_{BD} . However, because we do not have data on GDP per capita prior to 2005, we cannot estimate

$GDPC_{C,BY-L_{PCC}}$ for any value of L_{PCC} greater than 1 when $BY = 2006$. Fortunately in this case it is reasonable to assume that L_{PCC} is zero, because $\frac{GDPC_{C,TY-L_{PCC}}}{GDPC_{C,BY-L_{PCC}}} \approx \frac{GDPC_{C,TY}}{GDPC_{C,BY}}$.

The parameters for residential spaces per car ($PKC_{C,TY}$), percentage of spaces that are covered ($PKCV\%_{C,TY}$), percentage of covered spaces with an exposed roof ($PKR\%_{C,TY}$), and floor area per covered space ($PKAC_{C,TY}$) are estimated as a function of cars per capita, GDP per capita and population density, subject to minimum and maximum values:

$$PRM_{C,TY} = \min \left[PRM_{\max}, \max \left[\begin{array}{l} PRM_{\min}, PRM_{Cref,RY} \cdot \\ \left(\frac{GDPC_{C,TY-L_{PK}}}{GDPC_{Cref,RY-L_{PK}}} \right)^{\epsilon_1} \cdot \left(\frac{PD_{C,TY-L_{PK}}}{PD_{Cref,RY-L_{PK}}} \right)^{\epsilon_2} \cdot \left(\frac{PCC_{C,TY-L_{PK}}}{PCC_{Cref,RY-L_{PK}}} \right)^{\epsilon_3} \end{array} \right] \right]$$

where

$PRM_{C,TY}$ = The value of the parameter ($PKC_{C,TY}$, $PKCV\%_{C,TY}$, $PKR\%_{C,TY}$, $PKAC_{C,TY}$) in country C in year TY

PRM_{\max} = Maximum value of the parameter (Tables S16a – S16d)

PRM_{\min} = Minimum value of the parameter (Tables S16a – S16d)

$PRM_{Cref,RY}$ = The value of the parameter in the reference country $Cref$ in the reference year (Tables S16a – S16d)

$GDPC_{Cref,RY-L_{PK}}$ = GDP per capita in the reference country $Cref$ in the year $RY-L_{PK}$ (constant year-2013 international dollars per capita, PPP basis) (based on World Bank Development Indicators [World Bank, 2016d])

$PD_{Cref,RY-L_{PK}}$ = Population density in the reference country $Cref$ in the year $RY-L_{PK}$ (persons/km²) (based on U. S. population data (U.S. Census Bureau, 2015))

$PCC_{Cref,RY-L_{PK}}$ = Passenger cars per capita in the reference country $Cref$ in the year $RY-L_{PK}$ (based primarily on data from U.S. Bureau of Transportation Statistics (2016))

$Cref$ = Reference country for all parameters (U. S.)

RY = The year of the reference value of the parameters (2012)

L_{PK} = The effective (average) lag between the target or base year and the year of the economic and demographic conditions that determine residential parking in the target or base year (discussed below)

ϵ_1 = Exponent determining the relationship between changes in GDP per capita and changes in the floor area of covered spaces (Tables S16a – S16d)

ϵ_2 = Exponent determining the relationship between changes in population density and changes in the floor area of covered spaces (Tables S16a – S16d)

ϵ_3 = Exponent determining the relationship between changes in passenger cars per capita and changes in the floor area of covered spaces (Tables S16a – S16d)

$GDPC_{C,TY-L}$, $PD_{C,TY-L}$, and $PCC_{C,TY-L}$ are defined elsewhere

Regarding the lag parameter L_{PK} , see the discussion of L_{BD} in the estimation of floor area per capita. We assume that L_{PK} is slightly less than L_{BD} , because we assume that residential parking spaces turnover slightly more quickly than do buildings.

The EIA's *RECS* reports data on residential parking spaces at single-family and mobile homes in the U. S. in 2009. With these data, we calculate 1.3 parking spaces per single family or mobile home. Assuming 0.85 spaces per multi-family housing unit, we calculate a national-average of 1.015 parking spaces per passenger car in the U. S. in 2009. We assume 1.02 for the U. S. for 2012.

Dulac (2013) estimates global land requirements for parking and road infrastructure in 2010 and 2050. He estimates that in 2010, passenger cars in North America, OECD Pacific (except Korea and Japan), China, ASEAN, the Middle East, and Latin America required 18 m^2 per parking space, and that passenger cars in OECD Europe, India, Japan, Korea, and Africa required 15 m^2 per parking space. He assumes that these requirements will remain the same in 2050 unless there are aggressive parking policies and major shifts to smaller, more fuel-efficient vehicles, in which case in all regions passenger cars would require 15 m^2 per parking space in 2050.

We use these estimates as the basis for our assumptions for the minimum, maximum and reference values of floor area per covered space (Table S16d).

Fraction of roof area technically suitable for PV

This parameter limits technical potential to portions of roofs with reasonable orientation (e.g., close to south-facing in the northern hemisphere) and relatively little shading. Melius et al. (2013) review estimates of rooftop suitability for PVs, and find that 10% to 60% of building rooftop area is suitable for PVs, with the higher end pertaining to commercial buildings, larger buildings, or buildings with flat roofs. (Presumably commercial buildings are more suitable mainly because they are larger and tend to have flatter roofs.)

Table S16. Parameters in the estimation of rooftop area for residential parking.

Table S16a. Residential spaces per passenger car.

	Urban	Non-urban	Comment
Min.	0.05	0.07	
Max.	1.50	2.00	Our assumptions. Reference values are for U. S. ca. 2012; see discussion of RECS data in the text.
Ref.	1.02	1.02	
ϵ_1	0.12	0.12	Assume parking spaces per car increases slightly with wealth.
ϵ_2	-0.16	-0.12	Assume that the number of parking spaces per car decreases with increasing population density.
ϵ_3	-0.03	-0.02	Assume that as the number of cars per capita increases the number of parking places per car decreases very slightly

Table S16b. Percentage of spaces that are covered.

	Urban	Non-urban	Comment
Min.	35%	20%	
Max.	100%	95%	Our assumptions. Reference values are for U. S. ca. 2012. Residential parking areas are more likely to be covered in urban areas.
Ref.	75%	60%	
ϵ_1	0.10	0.10	Coverage is costly and hence presumably increases slightly with GDP per capita.
ϵ_2	0.10	0.07	Coverage presumably increases with increasing population density, especially in urban areas.
ϵ_3	-0.07	-0.05	Coverage presumably decreases with increasing vehicle ownership, especially in urban areas.

Table S16c. Percentage of covered parking spaces with an exposed roof.

	Urban	Non-urban	Comment
Min.	15%	40%	
Max.	75%	95%	Our assumptions. Reference values are for U. S. ca. 2012. Residential parking areas are more likely to have an exposed roof in non-urban areas because buildings in non-urban areas generally have fewer stories.
Ref.	40%	70%	
ϵ_1	-0.10	-0.08	Assume that increasing wealth increases building on top of residential parking structures, with slightly greater effect in urban areas.
ϵ_2	-0.12	-0.10	Assume that increasing population density increases building on top of residential parking structures, with slightly greater effect in urban areas.
ϵ_3	0.00	0.00	Assume no effect

Table S16d. Floor area per covered space.

	Urban	Non-urban	Comment
Min.	15.00	15.00	
Max.	19.00	19.50	See discussion of Dulac (2013) in text. We assume that covered spaces are slightly larger than the uncovered spaces (Dulac's estimates are for all spaces, covered and uncovered). We also assume that spaces are slightly larger in non-urban than urban areas.
Ref.	18.50	19.00	
ϵ_1	0.10	0.12	Floor area per covered space presumably increases slightly with GDP per capita. Assume slightly larger response in non-urban areas, because less space constrained

$\epsilon 2$	-0.12	-0.10	Floor area per covered space presumably decreases with increasing population density. Assume less constrained in non-urban areas
$\epsilon 3$	-0.07	-0.05	Assume that area devoted to vehicles decreases slightly with increasing vehicle ownership

Here we estimate the fraction of rooftop area suitable for PVs as a function of parameters that we are estimating for each country:

- Average building height (the greater the average height, the greater the variation in height, and hence the more likely that buildings shade one-another);
- Average rooftop area (the greater the area, the more likely that some significant portion of it is unshaded);
- The percentage of rooftop area that is flat (all else equal, the entire area of a flat roof is suitable for PVs); and
- The average slope of pitched roofs (the steeper the roof, the less suitable it is for PVs if it is pitched away from the sun).

We estimate this function with respect to reference values for the U. S. Formally,

$$Sfr_{PVroof,C,TY} = \min \left[Sfr_{PVroof,max}, Sfr_{PVroof,US,RY} \cdot \left(\frac{SB_{C,TY}}{SB_{US,RY}} \right)^{\omega 1} \cdot \left(\frac{RAC_{C,TY}}{RAC_{US,RY}} \right)^{\omega 2} \cdot \left(\frac{FL\%_C}{FL\%_{US}} \right)^{\omega 3} \cdot \left(\frac{SL\theta_C}{SL\theta_{US}} \right)^{\omega 4} \right]$$

$$FL\%_C = 1 - SL\%_C$$

$$FL\%_{US} = 1 - SL\%_{US}$$

$$RAC_{C,TY} = \frac{RA_{C,TY}}{P_{C,TY}}$$

where

$Sfr_{PVroof,C}$ = The fraction of rooftop area technically suitable for rooftop PV in country C

$Sfr_{PVroof,max}$ = The maximum allowable fraction of rooftop area suitable for PVs (Table S17)

$Sfr_{PVroof,US,RY}$ = Fraction of rooftop area technically suitable for rooftop PV in the U. S. in reference year FY (Table S17)

$SB_{US,RY}$ = Average stories per building in the U. S. in reference year RY (see discussion of $SB_{C,TY}$)

$RAC_{C,TY}$ = The rooftop area per capita (m^2/cap)

$RAC_{US,RY}$ = Roof area per capita in the U. S. in reference year RY ($m^2/capita$) (see discussion of $RA_{C,TY}$)

$FL\%_C$ = The percentage of flat roofs in country C

$SL\%_{US}$ = The percentage of sloped roofs in the U. S. (see discussion of $SL\%_C$)

$SL\theta_{US}$ = The average slope of pitched roofs in the U. S. (degrees) (see discussion of $SL\theta_C$)

$SB_{C,TY}$, $RA_{C,TY}$, $P_{C,TY}$, $SL\%_C$, and $SL\theta_C$ are defined above

$\omega_1... \omega_4$ = Exponents determining the relationship between building characteristics relative to those in the U. S. and the suitability fraction Sfr (Table S17)

Fraction of technical potential used ($Ufr_{PVroof,C,TY}$)

The estimated fraction of the technical potential actually used – the usability fraction – is a function of the cost of rooftop PV, the structural quality of the building stocks, roof area reserved for fire access, and energy policy. We start with a baseline estimate of the usability fraction as a function of the cost of rooftop PV, and then make adjustments to this baseline for structural quality, fire access requirements, and energy policy:

$$Ufr_{PVroof,C,TY} = \text{MIN} \left[\frac{Ufr_{PVroof,max} \cdot Ufr(COST)_{PVroof,base,C}}{STRUCT_{PVroof,C,TY} \cdot FIRE_{PVroof,C,TY} \cdot POL_{PVroof,C}} \right]$$

where

$Ufr(COST)_{PVroof,base,C}$ = The baseline usability fraction for rooftop PV in country C as a function of the cost

$Ufr_{PVroof,max}$ = The maximum usability fraction for rooftop PV (0.90)

$STRUCT_{PVroof,C,TY}$ = The structural-quality adjustment for rooftop PV for country C in target year TY

$FIRE_{PVroof,C,TY}$ = Adjustment for roof area reserved for fire access for rooftop PV for country C in target year TY

$POL_{PVroof,C}$ = The policy adjustment for rooftop PV for country C (assumed to be scalar; e.g., for countries with aggressive PV policies, $POL = 3.0$)

We estimate the usability fraction for residential rooftops (excluding parking), residential parking rooftops, commercial/government/institutional rooftops (excluding industrial), and industrial rooftops. We then combine the residential and residential parking factors, weighted by technical potential, to estimate an overall usability factor for residential including parking, and combine the commercial and industrial factors, weighted by technical potential, to estimate an overall usability factor for commercial plus industrial.

The baseline usability fraction is estimated as a logistic function of the country-specific capacity factor – a proxy for cost – relative to a reference capacity factor and a reference usability factor. (The capacity factor is a good proxy for cost because the capacity factor is the primary determinant of the LCOE of rooftop PV.) With this formulation, the usability fraction is an S-shaped curve that passes through the reference points and approaches a lower limit of 0 and an upper limit of 1, with a “steepness” determined by an exponent α ,

$$Ufr(COST)_{PVroof,base,C} = \frac{1}{1 + e^{\alpha(CF_{PVroof-ave,C} - CF_{PVroof,ref})} \cdot \left(\frac{1 - Ufr_{PVroof,ref}}{Ufr_{PVroof,ref}} \right)}$$

$$CF_{PVroof-ave,C} = \frac{1}{ave \left(\frac{1}{CF_{PVroof-low,C}}, \frac{1}{CF_{PVroof-high,C}} \right)}$$

where

$Ufr_{PVroof,ref}$ = The usability fraction at the reference capacity factor (discussed below)

$CF_{PVroof-ave,C}$ = The average capacity factor for rooftop PV in country C (same for all years)

$CF_{PVroof-low,C}$, $CF_{PVroof-high,C}$ = Low and high estimates of the capacity factor for rooftop PV in country C (discussed below)

$CF_{PVroof,ref}$ = Reference capacity factor for rooftop PV (discussed below)

α = Steepness exponent (based on results in Table S18; see discussion below)

The baseline usability as a function of cost alone (setting aside the other usability factors) should be very high at typical, economical capacity factors (17% to 19%), very low at the capacity factors of 12% and below, and virtually 100% at capacity factors above 20%. We find that setting $Ufr_{PVroof,ref} = 0.35$ at $CF_{PVroof,ref} = 0.14$, along with a high value of α , results in reasonable estimates of $Ufr(COST)_{PVroof,base,C}$. Table S18 shows the value of $Ufr(COST)_{PVroof,base,C}$ as a function of the capacity factor and the exponent α . We have highlighted values of $Ufr_{PVroof,ref}$ at very low, low, typical, and high capacity factors. Based on our examination of Table S18, we have chosen $\alpha = -86.0$.

As a proxy for structural quality we use GDP/capita. We assume that there is a threshold value of GDP/capita at which the building stock is of sufficient quality to support rooftop PVs; at this threshold, $STRUCT_{PVroof,C,TY} = 1.0$. At lower levels of GDP/capita, $STRUCT_{PVroof,C,TY}$ falls below 1.0, as follows:

$$STRUCT_{PVroof,C,TY} = \text{MIN} \left[1.0, \left(\frac{GDPC_{C,TY}}{GDPC_{struct,ref}} \right)^{\gamma_{PV}} \right]$$

where

$GDPC_{C,TY}$ = GDP per capita in country C in target year TY (constant year-2013 international dollars, PPP basis) (see Appendix S1)

$GDPC_{struct,ref}$ = Reference GDP per capita (\$46,000, constant year-2013 international dollars, PPP basis)

$\gamma_{PV} = 0.45$ (based on results in Table S19; see discussion below)

Values of exponent parameters α and γ_{PV}

Table S18 shows the usability fraction $Ufr_{PVroof,C,TY}$ as a function of the capacity-factor exponent α and the capacity factor, given the values assumed above for $CF_{PVroof,ref}$, $Ufr_{PVroof,max}$, and

$Ufr_{PVroof,ref}$, and assuming that the structural-quality adjustment ($STRUCT_{PVroof,C,TY}$) = 1.0. The results for the chosen value of the exponent are highlighted.

Table S19 shows the structural-quality adjustment $STRUCT_{PVroof,C,TY}$ as a function of the GDP-per-capita exponent γ_{PV} and the GDP per capita. The results for the chosen value of the exponent are highlighted.

Adjustment for roof area reserved for fire access ($FIRE_{PVroof,C,TY}$)

We assume that most countries developing rooftop PV systems require (or will require) that a portion of the roof not be covered with PVs to allow access for firefighters. We assume that this reserved roof area is not captured by the parameter Sfr , the fraction of rooftop area *technically* suitable for PVs, or by the base-case usability fraction $Ufr_{PVroof,ref}$.

Table S17. Parameters in the estimation of suitable rooftop PV area.

	Com	Resid-roof		Resid-parking		Indus	Comment
		urb	n-urb	urb	n-urb		
$Sfr_{PVroof,US,R,Y}$	60%	25%	40%	18%	28%	65%	Com, res, and res-park assumptions based on review in Melius et al. (2013). We assume that residential buildings in non-urban areas have less shading. Industry values are our assumption.
$Sfr_{PVroof,max}$	85%	70%	80%	65%	75%	75%	Our assumptions.
$\omega 1 (SB)$	-0.30	-0.30	-0.30	n.a.	n.a.	-0.30	We assume that this is a relatively important factor, because higher average building heights cause more shading. Not applicable to residential parking because we implicitly assume only one story for residential parking.
$\omega 2 (RAC)$	0.15	0.15	0.15	0.15	0.15	0.15	Our assumptions.
$\omega 3 (FL\%)$	0.50	0.45	0.45	0.45	0.45	0.50	We assume that this is a relatively important factor, because flat roofs do not have any areas facing away from the sun. We assume that suitability is slightly more sensitive to this parameter for commercial and industrial buildings.
$\omega 4 (SL\theta)$	-0.15	-0.15	-0.15	-0.15	-0.15	-0.15	The steeper the roof, the less suitable it is for PVs if it is pitched away from the sun. This is a relatively minor factor because it is sub-ordinate to the more important orientation factor.

Com = commercial/institutional/government rooftop; *Resid-roof* = residential rooftops; *Resid-park* = residential parking; *Indus* = industrial/manufacturing; *urb* = urban; *n-urb* = non-urban; *n.a.* = not applicable.

Table S18. Usability fraction as a function of the capacity-factor exponent and the reference capacity factor.

CF / α	-70.0	-71.0	-72.0	-73.0	-74.0	-75.0	-76.0	-77.0	-78.0	-79.0	-80.0	-81.0	-82.0	-83.0	-84.0	-85.0	-86.0	-87.0	-88.0	-89.0	-90.0	-91.0
.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
.03	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
.04	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
.05	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
.06	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
.07	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
.08	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
.09	0.02	0.02	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01
.10	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.01	0.01
.11	0.06	0.06	0.06	0.06	0.06	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.04	0.04	0.04	0.04	0.04	0.04	0.04	0.04	0.03	0.03
.12	0.12	0.12	0.11	0.11	0.11	0.11	0.11	0.10	0.10	0.10	0.10	0.10	0.09	0.09	0.09	0.09	0.09	0.09	0.08	0.08	0.08	0.08
.13	0.21	0.21	0.21	0.21	0.20	0.20	0.20	0.20	0.20	0.20	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.18	0.18	0.18	0.18	0.18
.14	0.35	0.35	0.35	0.35	0.35	0.35	0.35	0.35	0.35	0.35	0.35	0.35	0.35	0.35	0.35	0.35	0.35	0.35	0.35	0.35	0.35	0.35
.15	0.52	0.52	0.53	0.53	0.53	0.53	0.54	0.54	0.54	0.54	0.55	0.55	0.55	0.55	0.56	0.56	0.56	0.56	0.56	0.57	0.57	0.57
.16	0.69	0.69	0.69	0.70	0.70	0.71	0.71	0.72	0.72	0.72	0.73	0.73	0.74	0.74	0.74	0.75	0.75	0.75	0.76	0.76	0.77	0.77
.17	0.81	0.82	0.82	0.83	0.83	0.84	0.84	0.84	0.85	0.85	0.86	0.86	0.86	0.87	0.87	0.87	0.88	0.88	0.88	0.89	0.89	0.89
.18	0.90	0.90	0.91	0.91	0.91	0.92	0.92	0.92	0.92	0.93	0.93	0.93	0.93	0.94	0.94	0.94	0.94	0.95	0.95	0.95	0.95	0.95
.19	0.95	0.95	0.95	0.95	0.96	0.96	0.96	0.96	0.96	0.97	0.97	0.97	0.97	0.97	0.97	0.97	0.98	0.98	0.98	0.98	0.98	0.98
.20	0.97	0.97	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99
.21	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	1.00	1.00	1.00	1.00	1.00	1.00	1.00
.22	0.99	0.99	0.99	0.99	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
.23	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
.24	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
.25	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
.26	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
.27	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
.28	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
.29	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
.30	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
.31	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
.32	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
.33	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
.34	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
.35	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
.36	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
.37	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
.38	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
.39	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
.40	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00

Table S19. Structural-quality adjustment as a function of the GDP-per-capita exponent and the GDP per capita.

GDPC/ γ	0.05	0.10	0.15	0.20	0.25	0.30	0.35	0.40	0.45	0.50	0.55	0.60	0.65	0.70	0.75	0.80	0.85	0.90	0.95	1.00	1.05	1.10
000	0.83	0.68	0.56	0.46	0.38	0.32	0.26	0.22	0.18	0.15	0.12	0.10	0.08	0.07	0.06	0.05	0.04	0.03	0.03	0.02	0.02	0.01
000	0.87	0.76	0.66	0.58	0.51	0.44	0.38	0.34	0.29	0.26	0.22	0.19	0.17	0.15	0.13	0.11	0.10	0.09	0.07	0.07	0.06	0.05
000	0.89	0.80	0.72	0.64	0.57	0.51	0.46	0.41	0.37	0.33	0.30	0.26	0.24	0.21	0.19	0.17	0.15	0.14	0.12	0.11	0.10	0.09
000	0.91	0.83	0.75	0.69	0.62	0.57	0.52	0.47	0.43	0.39	0.36	0.32	0.29	0.27	0.24	0.22	0.20	0.18	0.17	0.15	0.14	0.13
000	0.92	0.85	0.78	0.72	0.67	0.61	0.56	0.52	0.48	0.44	0.41	0.38	0.35	0.32	0.29	0.27	0.25	0.23	0.21	0.20	0.18	0.17
1000	0.93	0.87	0.81	0.75	0.70	0.65	0.61	0.56	0.53	0.49	0.46	0.42	0.39	0.37	0.34	0.32	0.30	0.28	0.26	0.24	0.22	0.21
3000	0.94	0.88	0.83	0.78	0.73	0.68	0.64	0.60	0.57	0.53	0.50	0.47	0.44	0.41	0.39	0.36	0.34	0.32	0.30	0.28	0.27	0.25
5000	0.95	0.89	0.85	0.80	0.76	0.71	0.68	0.64	0.60	0.57	0.54	0.51	0.48	0.46	0.43	0.41	0.39	0.36	0.34	0.33	0.31	0.29
7000	0.95	0.91	0.86	0.82	0.78	0.74	0.71	0.67	0.64	0.61	0.58	0.55	0.52	0.50	0.47	0.45	0.43	0.41	0.39	0.37	0.35	0.33
9000	0.96	0.92	0.88	0.84	0.80	0.77	0.73	0.70	0.67	0.64	0.61	0.59	0.56	0.54	0.52	0.49	0.47	0.45	0.43	0.41	0.40	0.38
1000	0.96	0.92	0.89	0.85	0.82	0.79	0.76	0.73	0.70	0.68	0.65	0.62	0.60	0.58	0.56	0.53	0.51	0.49	0.47	0.46	0.44	0.42
3000	0.97	0.93	0.90	0.87	0.84	0.81	0.78	0.76	0.73	0.71	0.68	0.66	0.64	0.62	0.59	0.57	0.55	0.54	0.52	0.50	0.48	0.47
5000	0.97	0.94	0.91	0.89	0.86	0.83	0.81	0.78	0.76	0.74	0.72	0.69	0.67	0.65	0.63	0.61	0.60	0.58	0.56	0.54	0.53	0.51
7000	0.97	0.95	0.92	0.90	0.88	0.85	0.83	0.81	0.79	0.77	0.75	0.73	0.71	0.69	0.67	0.65	0.64	0.62	0.60	0.59	0.57	0.56
9000	0.98	0.95	0.93	0.91	0.89	0.87	0.85	0.83	0.81	0.79	0.78	0.76	0.74	0.72	0.71	0.69	0.68	0.66	0.65	0.63	0.62	0.60
1000	0.98	0.96	0.94	0.92	0.91	0.89	0.87	0.85	0.84	0.82	0.80	0.79	0.77	0.76	0.74	0.73	0.72	0.70	0.69	0.67	0.66	0.65
3000	0.98	0.97	0.95	0.94	0.92	0.91	0.89	0.88	0.86	0.85	0.83	0.82	0.81	0.79	0.78	0.77	0.75	0.74	0.73	0.72	0.71	0.69
5000	0.99	0.97	0.96	0.95	0.93	0.92	0.91	0.90	0.88	0.87	0.86	0.85	0.84	0.83	0.81	0.80	0.79	0.78	0.77	0.76	0.75	0.74
0000	0.99	0.99	0.98	0.97	0.97	0.96	0.95	0.95	0.94	0.93	0.93	0.92	0.91	0.91	0.90	0.89	0.89	0.88	0.88	0.87	0.86	0.86
5000	1.00	1.00	1.00	1.00	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98
0000	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
5000	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
0000	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
5000	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
0000	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
5000	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
00000	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
10000	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
20000	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
30000	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
40000	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
50000	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
60000	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
70000	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
80000	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
90000	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
00000	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
10000	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
20000	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
30000	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
40000	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
50000	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
60000	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
70000	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00

The fraction of roof area reserved for fire access depends on two factors: whether a country has fire-access regulations, and the area reserved for access relative to the total roof area. We assume that the likelihood of a country having fire-access regulations increases sharply with GDP per capita. Regarding access area requirements, the International Fire Code (IFC), Section 605.11.1, “Access and Pathways” (ICC, 2016) specifies that PV systems on rooftops of group R-3 occupancies (in essence, one- and two-family dwelling units) with *more* than a 2:12 slope typically must allow for 3-foot-wide access paths along the eaves and ridge of each slope, although in some cases the panels may go up to the ridge. PV systems on commercial buildings with one axis of 250 feet or less must have at least a 4-foot wide path around the building perimeter; otherwise, a 6-foot wide access is required. Four-foot-wide centerline access pathways also are required. Table S20 shows the fraction of roof area required for these access pathways as a function of building type and size.

Our formal estimation represents these two effects (probability of a regulation, and the impact of regulation) as multiplicative factors, with upper and lower bounds. For the residential sector, the regulations apply only to sloped roofs:

$$FIRE_{PVroof,C,TY} = 1 - SL\%_{res,C} \cdot FRreg_{PVroof,C,TY} \cdot FRfr_{PVroof,C,TY}$$

For all other sectors,

$$FIRE_{PVroof,C,TY} = 1 - FRreg_{PVroof,C,TY} \cdot FRfr_{PVroof,C,TY}$$

$$FRreg_{PVroof,C,TY} = \max \left[FRreg_{PVroof,min}, \min \left[1.0, FRreg_{PVroof,ref} \cdot \left(\frac{GDPC_{C,TY}}{GDPC_{fire,ref}} \right)^{\phi_1} \right] \right]$$

$$FRfr_{PVroof,C,TY} = \max \left[FRfr_{PVroof,min}, \min \left[FRfr_{PVroof,max}, FRfr_{PVroof,ref} \cdot \left(\frac{RAC_{C,TY}}{RAC_{fire,ref}} \right)^{-\phi_2} \right] \right]$$

where

$FRreg_{PVroof,C,TY}$ = The likelihood having fire-access requirements in country C in year TY

$SL\%_{res,C}$ = The percentage of sloped roofs in the residential sector in country C (discussed above)

$FRfr_{PVroof,C,TY}$ = The roof area reserved for fire access in country C in year TY (fraction of total roof area)

$FRreg_{PVroof,ref}$ = The reference likelihood of having fire-access requirements, at the reference GDP per capita (we assume 80%)

$FRreg_{PVroof,min}$ = The minimum likelihood (we assume 50%)

$GDPC_{fire,ref}$ = The reference GDP per capita for the fire-access-regulation-likelihood estimate (\$45,000, year-2013 PPP; this is the approximate 139-country average in 2050)

- $FRfr_{PVroof,min}$ = The minimum fraction of roof area reserved for fire access (Table S21)
- $FRfr_{PVroof,max}$ = The maximum fraction of roof area reserved for fire access (Table S21)
- $FRfr_{PVroof,ref}$ = The reference fraction of roof area reserved for fire access, at the reference floor area per capita (Table S21)
- $RAC_{fire,ref}$ = The reference rooftop area per capita for the fire-access-area estimate (we use the 139-country average values in 2050)
- $\phi1$ = Exponent determining the relationship between $FRreg$ and changes in $GDPC$ (Table S21)
- $\phi2$ = Exponent determining the relationship between $FRfr$ and changes in RAC (Table S21)
- Other terms defined above.

Table S20. Percent of roof area for access requirements, by building type and size.

<i>Residential buildings, access on three sides</i>				
Side 1	Side 2	Access width	Roof face area (ft ²)	Access % of area
20	10	3	200	51.0%
20	20	3	400	40.5%
35	12	3	420	37.9%
45	20	3	900	26.3%
50	30	3	1500	20.8%
<i>Non-residential buildings, one side <250 ft., access on all sides, centerline pathways</i>				
Side 1	Side 2	Access width	Roof face area (ft ²)	Access % of area
100	100	4	10000	22.7%
320	100	4	32000	15.4%
<i>Large industrial buildings, access on all sides, centerline pathways</i>				
Side 1	Side 2	Access width	Roof face area (ft ²)	Access % of area
260	260	6	67600	12.0%
500	300	6	150000	8.4%

Table S21. Parameters in the estimation of the fire-access component of the useable fraction of the rooftop PV technical potential.

	Res-roof	Res-park	Com	Ind	Comment
$FRfr_{PVroof,ref}$	28%	40%	18%	10%	Based on values in Table S20.
$FRfr_{PVroof,min}$	15%	20%	8%	5%	Based on values in Table S20.
$FRfr_{PVroof,max}$	45%	55%	35%	25%	Based on values in Table S20.
$\phi 1$	2.25	2.25	2.25	2.25	Assumptions based on our examination of the relationship between $\phi 1$ and $GDPC$
$\phi 2$	0.50	0.50	0.40	0.40	We show this as a negative exponent because increasing results in decreasing $FRfr$. Assumptions based on our examination of the relationship between $\phi 2$ and RAC .

Com = commercial/institutional/government; *Res-roof* = residential rooftop; *Res-park* = residential parking; *Ind* = industrial/manufacturing

Capacity factor for rooftop PV

We use the 3-D global simulation model GATOR-GCMOM (Jacobson, 2007; 2010a,b; Ten Hoeve et al., 2012) to model the solar irradiance and capacity factor for rooftop PVs, by country (Figure S6). We start by using GATOR-GCMOM to estimate the capacity factor for a panel on a flat surface. We then adjust the capacity factor to account for the difference in the capacity factor between a panel on a sloped roof and a panel on a flat surface, using country-specific roof slopes and latitudes. Formally,

$$CF_{PVroof-high,C} = CF_{PVroof-GATORGCM,C} \cdot CF_{adj_{PVroof,C}} + \Delta CF_{hi-ave,PVroof}$$

$$CF_{PVroof-low,C} = \max \left[CF_{min,PVroof}, CF_{PVroof-high,C} - 2 \cdot \Delta CF_{hi-ave,PVroof} \right]$$

where

$CF_{PVroof-low,C}, CF_{PVroof-high,C}$ = Low and high estimates of the capacity factor for rooftop PV in country C

$CF_{PVroof-GATORGCM,C}$ = Capacity-factor estimate from GATOR-GCMOM, for a panel on a flat surface in the middle latitude of country C

$CF_{adj_{PVroof,C}}$ = Adjustment to account for the effect on the capacity factor of panels being on a sloped roof, and in a location other than the middle latitude of country C

$\Delta CF_{hi-ave,PVroof}$ = Difference between the average capacity factor (based on $CF_{PVroof-GATORGCM,C}$) and the high capacity factor (absolute percentage points; we assume 1%)

$CF_{min,PVroof}$ = The minimum allowable capacity factor for rooftop PV (we assume 1%)

The adjustment factor is calculated as a function of the optimal (maximum-output) angle of the PV panel, the percentage of flat rooftops, and the average angle of sloped roofs, for each country:

$$CFadj_{PVroof,C} = (1 - SL\%_C) + \frac{SL\%_C \cdot \cos\left(\text{abs}\left(SL\theta_C - T\theta_{PVroof,opt,C}\right)\right)}{\cos\left(\theta_{PVroof,opt,C}\right)}$$

where

$SL\%_C$ = The percentage of pitched (sloped) roofs in country C (discussed elsewhere)

$SL\theta_C$ = The average slope of pitched roofs in country C (degrees) (discussed elsewhere)

$T\theta_{PVroof,opt,C}$ = The optimal (maximum-output) angle of PV panels in country C (radians) (discussed below)

We estimate the optimal angle of PV panels as a simple a function of the absolute latitude pertinent to PV roof installation in each country and the absolute solar declination at which the optimal tilt is assumed (Despotovic and Nedic, 2016; Handoyo et al., 2013; Stanciu and Stanciu, 2014; Yadav and Chandel, 2013). (The solar declination is the angle between the rays of the sun and the plane of the equator; it is zero at the equinoxes and ± 23.45 degrees at the solstices.) The latitude pertinent to PV roof installation is estimated relative to the middle latitude of the country on the assumption that the further away from the equator the country is, the closer to the equator most buildings in the country are (e.g., Canada, Norway, Sweden, Finland, Russia, Chile, and Argentina). Formally,

$$T\theta_{PVroof,opt,C} = ALAT_{PVroof,C} - \delta_{soldec} + 10$$

$$ALAT_{PVroof,C} = \text{abs}(LAT_{mid,C}) - \left(\frac{\max\left[0, \left(\text{abs}(LAT_{mid,C}) - \theta_{shift}\right)\right]}{100 - \theta_{shift}} \right)^k \cdot \frac{\text{abs}(LAT_{high,C} - LAT_{low,C})}{2}$$

where

$ALAT_{PVroof,C}$ = The absolute latitude pertinent to the typical PV roof installation in country C (degrees away from the equator)

δ_{soldec} = The absolute solar declination at which the optimal tilt is assumed (;we assume 18 degrees, between the equinox and the solstice, but closer to the solstice)

$\text{abs}(LAT_{mid,C})$ = The absolute value of the middle latitude of country C (degrees)

$LAT_{high,C}$ = The high latitude of country C (degrees)

$LAT_{low,C}$ = The low latitude of country C (degrees)

θ_{shift} = Shift parameter (we assume 23.5 degrees)

κ = Exponent governing strength of shift towards equator (the larger the exponent, the greater the shift away from the equator; we assume 1.35 for rooftop PV and 0.85 for utility-scale PV, on the assumption that utility-scale PV plants generally will be located as close to the equator as possible)

Snow cover

An additional issue related to rooftop solar is the extent to which snow cover may reduce its power output. If snow is not removed from panels, panel output may decrease by ~5-15% in the annual average (Northern Alberta Institute of Technology, 2015). However, this is more than compensated for by the fact that at minus 43°C ambient temperature, which often occurs in the presence of snow, a PV system provides 29% more power than its rated power (Dodge and Thompson, 2016). We conservatively assume these two factors offset each other so don't modify the number of panels needed due to snow cover.

Results

Table S22 provides estimates of each country's maximum rooftop PV nameplate capacity and the percent of maximum capacity actually installed under the roadmaps proposed here. Rooftops considered include those on residential, commercial, and governmental buildings, and garages, carports, parking lots, and parking structures associated with these buildings. Commercial and governmental buildings include all non-residential buildings except manufacturing, industrial, and military buildings. Commercial buildings include schools.

Based on the foregoing analysis, 2050 residential rooftop areas (including garages and carports) are estimated to support up to 26.6 TW_{dc-peak} of installed power, of which 34.9% is proposed for use. In 2050, commercial/government rooftops (including parking lots and parking structures) may support 11.1 TW_{dc-peak} of installed power, of which 68.2% is proposed for use. Low-latitude and high GDP-per-capita countries are expected to adopt PV the fastest.

Table S22. Rooftop areas suitable for PV panels, potential capacity of suitable rooftop areas, and proposed installed capacity for both residential and commercial/government buildings, by country. See Delucchi et al. (2016) for calculations.

Country	Residential rooftop PV				Commercial/government rooftop PV			
	Rooftop area suitable for PVs in 2012 (km ²)	Potential capacity of suitable area in 2050 (MW _{dc-peak})	Proposed installed capacity in 2050 (MW _{dc-peak})	Percent of potential capacity installed	Rooftop area suitable for PVs in 2012 (km ²)	Potential capacity of suitable area in 2050 (MW _{dc-peak})	Proposed installed capacity in 2050 (MW _{dc-peak})	Percent of potential capacity installed
Albania	25	6,007	1,480	24.6	17	4,183	3,163	75.6
Algeria	688	164,609	65,461	39.8	387	92,540	77,064	83.3
Angola	856	204,819	13,924	6.8	272	65,100	26,060	40.0
Argentina	593	141,758	75,219	53.1	412	98,605	81,465	82.6
Armenia	29	6,831	2,767	40.5	16	3,813	2,276	59.7
Australia	872	208,451	86,335	41.4	529	126,438	72,216	57.1
Austria	79	18,833	12,885	68.4	66	15,743	12,167	77.3
Azerbaijan	141	33,659	13,104	38.9	85	20,367	15,577	76.5
Bahrain	11	2,610	1,496	57.3	4	1,021	722	70.7
Bangladesh	1,373	328,403	66,637	20.3	193	46,183	19,026	41.2
Belarus	37	8,858	5,963	67.3	62	14,927	6,545	43.8
Belgium	22	5,291	3,064	57.9	19	4,625	3,266	70.6

Benin	281	67,115	6,513	9.7	41	9,764	3,697	37.9
Bolivia	267	63,887	4,859	7.6	105	25,151	9,184	36.5
Bosnia and Herzegovina	43	10,250	3,281	32.0	24	5,851	4,519	77.2
Botswana	70	16,671	2,726	16.4	33	7,980	5,254	65.8
Brazil	3,729	891,827	309,645	34.7	1,641	392,587	324,096	82.6
Brunei Darussalam	19	4,657	3,190	68.5	7	1,776	1,380	77.7
Bulgaria	54	12,993	8,807	67.8	53	12,750	9,947	78.0
Cambodia	364	86,993	5,027	5.8	56	13,422	9,422	70.2
Cameroon	508	121,415	26,662	22.0	114	27,171	12,199	44.9
Canada	376	90,040	64,960	72.1	729	174,304	138,318	79.4
Chile	212	50,724	35,457	69.9	140	33,547	25,788	76.9
China	15,170	3,628,387	2,407,007	66.3	9,221	2,205,373	1,678,213	76.1
Chinese Taipei	329	78,632	52,613	66.9	138	33,059	25,147	76.1
Colombia	1,075	257,160	31,041	12.1	401	95,991	58,448	60.9
Congo	203	48,486	3,009	6.2	66	15,667	5,712	36.5
Congo, Dem. Republic	2,173	519,751	41,128	7.9	257	61,434	16,440	26.8
Costa Rica	63	15,041	1,389	9.2	26	6,316	2,597	41.1
Cote d'Ivoire	504	120,542	12,802	10.6	116	27,650	15,482	56.0
Croatia	43	10,344	6,940	67.1	35	8,255	6,204	75.2
Cuba	139	33,251	6,286	18.9	66	15,866	12,078	76.1
Cyprus	31	7,367	1,739	23.6	10	2,425	1,855	76.5
Czech Republic	60	14,321	9,561	66.8	60	14,333	10,947	76.4
Denmark	23	5,509	3,685	66.9	40	9,628	2,438	25.3
Dominican Republic	81	19,435	4,714	24.3	38	9,088	7,339	80.8
Ecuador	433	103,595	8,729	8.4	140	33,523	16,554	49.4
Egypt	1,945	465,278	95,806	20.6	694	166,024	136,356	82.1
El Salvador	67	16,074	1,277	7.9	22	5,331	2,401	45.0
Eritrea	152	36,427	733	2.0	15	3,667	1,381	37.7
Estonia	6	1,456	1,026	70.5	11	2,662	938	35.2
Ethiopia	3,856	922,271	83,788	9.1	272	65,042	24,371	37.5
Finland	30	7,097	4,926	69.4	75	17,911	2,971	16.6
France	558	133,371	87,718	65.8	488	116,637	89,126	76.4
Gabon	95	22,814	3,281	14.4	41	9,739	6,228	63.9
Georgia	40	9,649	3,409	35.3	25	5,885	4,192	71.2
Germany	452	108,151	72,159	66.7	500	119,623	91,363	76.4
Ghana	524	125,366	12,294	9.8	124	29,613	14,301	48.3
Gibraltar	0	12	6	49.3	0	6	4	64.7
Greece	85	20,365	14,219	69.8	74	17,642	13,847	78.5
Guatemala	292	69,778	5,519	7.9	88	21,022	10,419	49.6
Haiti	84	20,155	3,695	18.3	15	3,665	1,807	49.3
Honduras	160	38,369	4,053	10.6	46	10,979	7,215	65.7
Hong Kong, China	13	3,202	1,581	49.4	5	1,140	732	64.2
Hungary	69	16,525	11,795	71.4	72	17,158	12,102	70.5
Iceland	3	730	0	0.0	6	1,406	0	0.0
India	19,366	4,631,873	1,448,982	31.3	5,069	1,212,271	874,466	72.1
Indonesia	5,914	1,414,390	207,220	14.7	1,888	451,444	371,066	82.2
Iran, Islamic Republic	1,212	289,992	224,773	77.5	728	174,208	144,638	83.0
Iraq	661	158,075	28,509	18.0	363	86,809	57,880	66.7
Ireland	48	11,389	7,292	64.0	55	13,260	2,312	17.4
Israel	80	19,162	11,838	61.8	37	8,827	6,452	73.1
Italy	737	176,202	117,941	66.9	259	61,871	46,128	74.6
Jamaica	42	10,032	2,307	23.0	13	3,065	2,487	81.1
Japan	496	118,566	72,125	60.8	274	65,470	46,846	71.6
Jordan	90	21,471	7,246	33.7	48	11,571	9,475	81.9
Kazakhstan	415	99,308	71,226	71.7	363	86,701	65,048	75.0
Kenya	1,240	296,518	19,390	6.5	192	45,927	25,727	56.0
Korea, Dem. People's Rep.	145	34,772	13,825	39.8	39	9,233	3,090	33.5
Korea, Republic of	372	88,927	56,158	63.2	210	50,126	37,411	74.6
Kosovo	11	2,747	1,609	58.6	7	1,605	954	59.4

Kuwait	31	7,322	4,595	62.8	16	3,777	2,804	74.2
Kyrgyzstan	78	18,674	4,247	22.7	30	7,277	4,064	55.8
Latvia	12	2,968	2,099	70.7	22	5,189	1,605	30.9
Lebanon	23	5,467	4,027	73.7	12	2,829	2,288	80.9
Libya	208	49,642	17,293	34.8	115	27,460	22,939	83.5
Lithuania	24	5,685	4,051	71.3	43	10,346	4,631	44.8
Luxembourg	2	384	218	56.8	2	382	276	72.3
Macedonia, Republic of	23	5,555	3,163	56.9	15	3,472	2,757	79.4
Malaysia	846	202,325	107,404	53.1	326	77,871	59,124	75.9
Malta	2	387	222	57.3	1	170	118	69.6
Mexico	1,966	470,201	190,185	40.4	983	235,059	192,907	82.1
Moldova, Republic of	16	3,824	2,917	76.3	9	2,195	1,306	59.5
Mongolia	45	10,659	7,479	70.2	46	10,963	8,161	74.4
Montenegro	7	1,627	702	43.2	5	1,209	931	77.0
Morocco	452	108,126	20,817	19.3	193	46,186	37,817	81.9
Mozambique	751	179,509	15,638	8.7	92	22,054	8,905	40.4
Myanmar	946	226,163	20,955	9.3	235	56,105	39,922	71.2
Namibia	44	10,493	1,932	18.4	21	4,943	3,733	75.5
Nepal	433	103,598	27,064	26.1	54	12,935	4,180	32.3
Netherlands	29	6,916	3,941	57.0	46	10,961	3,621	33.0
Netherlands Antilles	2	519	374	72.1	1	213	163	76.3
New Zealand	83	19,813	13,842	69.9	63	14,986	11,235	75.0
Nicaragua	107	25,683	1,594	6.2	33	7,824	2,991	38.2
Nigeria	5,037	1,204,827	199,558	16.6	1,326	317,029	209,444	66.1
Norway	45	10,741	6,974	64.9	82	19,581	1,566	8.0
Oman	143	34,231	23,978	70.0	79	18,815	14,772	78.5
Pakistan	2,566	613,659	160,703	26.2	736	175,967	99,053	56.3
Panama	111	26,638	3,717	14.0	44	10,439	6,945	66.5
Paraguay	139	33,230	1,065	3.2	59	14,026	2,061	14.7
Peru	638	152,477	12,583	8.3	255	60,989	23,516	38.6
Philippines	2,292	548,258	31,658	5.8	523	125,122	59,393	47.5
Poland	202	48,290	34,173	70.8	357	85,359	68,035	79.7
Portugal	140	33,519	18,012	53.7	71	16,878	12,918	76.5
Qatar	17	4,114	2,487	60.4	8	1,990	1,458	73.3
Romania	176	42,030	27,775	66.1	89	21,188	13,720	64.8
Russian Federation	891	213,014	150,920	70.8	1,633	390,500	197,192	50.5
Saudi Arabia	1,104	264,110	187,210	70.9	614	146,955	115,777	78.8
Senegal	336	80,383	4,174	5.2	58	13,956	6,759	48.4
Serbia	61	14,701	10,655	72.5	61	14,630	11,744	80.3
Singapore	28	6,804	3,357	49.3	6	1,531	964	62.9
Slovak Republic	43	10,320	6,936	67.2	39	9,447	5,371	56.9
Slovenia	18	4,373	2,970	67.9	19	4,517	3,267	72.3
South Africa	672	160,822	124,205	77.2	344	82,302	68,233	82.9
Spain	566	135,450	88,008	65.0	257	61,369	46,052	75.0
Sri Lanka	559	133,722	11,907	8.9	111	26,622	21,674	81.4
Sudan	1,683	402,505	14,596	3.6	365	87,200	27,412	31.4
Sweden	53	12,629	8,739	69.2	97	23,149	5,139	22.2
Switzerland	79	18,937	13,051	68.9	68	16,156	12,518	77.5
Syrian Arab Republic	300	71,701	11,450	16.0	140	33,481	23,477	70.1
Tajikistan	115	27,487	320	1.2	32	7,700	674	8.8
Tanzania, United Republic	1,074	256,993	39,484	15.4	176	42,197	22,179	52.6
Thailand	1,217	291,009	183,457	63.0	486	116,139	95,411	82.2
Togo	195	46,672	3,998	8.6	20	4,717	1,446	30.7
Trinidad and Tobago	38	9,094	6,951	76.4	9	2,091	1,593	76.1
Tunisia	132	31,542	17,243	54.7	69	16,512	13,621	82.5
Turkey	908	217,268	81,284	37.4	624	149,303	123,085	82.4
Turkmenistan	125	29,832	20,737	69.5	80	19,101	14,892	78.0
Ukraine	218	52,251	40,183	76.9	191	45,800	24,196	52.8
United Arab Emirates	125	29,949	20,114	67.2	64	15,194	11,680	76.9

United Kingdom	196	46,864	29,057	62.0	334	79,790	28,506	35.7
United States of America	8,424	2,014,777	837,961	41.6	5,783	1,383,123	759,644	54.9
Uruguay	37	8,758	3,764	43.0	22	5,345	4,417	82.6
Uzbekistan	353	84,429	59,813	70.8	160	38,172	28,635	75.0
Venezuela	641	153,204	92,002	60.1	249	59,528	49,052	82.4
Vietnam	1,367	326,834	81,172	24.8	325	77,824	62,549	80.4
Yemen	666	159,196	5,198	3.3	157	37,610	9,806	26.1
Zambia	603	144,128	9,503	6.6	143	34,092	17,839	52.3
Zimbabwe	347	83,007	21,168	25.5	46	10,971	5,214	47.5
World total or average	111,046	26,559,354	9,276,861	34.9	46,505	11,122,804	7,585,920	68.2

Technical potential and actual installed capacity of utility-scale PV

The actual installed capacity of utility-scale PV plants is the larger of the potential capacity estimated on the basis of the land area with at least the minimum acceptable solar insolation, and the potential capacity based on the assumed minimum land area suitable for utility PVs. Both are a function of the total PV-system areal power density, which we estimate as a function of the module density (which increases over time) and a spacing factor (a function of population density). Formally,

$$C_{I,PVutility,C,TY} = \max \left[C_{LA_{\min},PVutility,C,TY}, C_{SI_{\min},PVutility,C,TY} \right]$$

$$C_{LA_{\min},PVutility,C,TY} = C_{AD,PVutility,C,TY} \cdot LA_{\min,PVutility}^{\%} \cdot LA_C$$

$$C_{SI_{\min},PVutility,C,TY} = C_{SI_{\min},PVutility,C,TY}^* \cdot \frac{C_{AD,PVutility,C,TY}}{C_{AD,PVutility,C,TY}^*}$$

$$C_{AD,PVutility,C,TY} = \frac{C_{AD,PVmod,TY}}{SF_{PVutility,C,TY}}$$

$$SF_{PVutility,C,TY} = \max \left[SF_{\min,PVutility}, \min \left[SF_{\max,PVutility}, SF_{ref,PVutility} \cdot \left(\frac{PD_{C,TY}}{PD_{ref}} \right)^{\epsilon} \right] \right]$$

$$C_{AD,PVmod,TY} = C_{AD,PVmod,BY} \cdot e^{\phi_{PV}(TY-BY_{PV})}$$

where

$C_{I,PVutility,C,TY}$ = Rated capacity of utility-scale PV plants in country C in year TY (MW)

$C_{LA_{min},PVutility,C,TY}$ = Rated capacity of utility-scale PV plants in country C in year TY based on the minimum suitable land area (MW)

$C_{SI_{min},PVutility,C,TY}$ = Rated capacity of utility-scale PV plants in country C in year TY based on land area with the minimum acceptable solar insolation (MW)

$C_{AD,PVutility,C,TY}$ = Rated capacity per unit area (areal power density), of utility-scale PV plants in country C in year TY (MW/km²)

$LA_{min,PVutility}^{\%}$ = Minimum land area suitable for utility-scale PVs, as a percentage of total land area (we assume 5%)

LA_C = Land area of country C (km²) (discussed elsewhere)

$C_{SI_{min},PVutility,C,TY}^*$ = Reference estimates of capacity of utility-scale PV plants in country C in year TY based on land area with the minimum acceptable solar insolation (MW) (discussed below)

$C_{AD,PVutility,C,TY}^*$ = Reference areal power density of utility-scale PV plants in country C in year TY (MW/km²) (discussed below)

$SF_{PVutility,C,TY}$ = The system/module area spacing factor for utility PV in country C in year TY

$SF_{min,PVutility}$ = The minimum spacing factor (discussed below)

$SF_{max,PVutility}$ = The maximum spacing factor (discussed below)

$SF_{ref,PVutility}$ = The reference spacing factor (discussed below)

$PD_{C,TY}$ = Population density in country C in year TY (discussed elsewhere)

PD_{ref} = Reference population density (we assume 75 persons/km²)

ε = Exponent relating changes in population density to changes in the spacing factor (we assume -0.25)

$C_{AD,PVmod,TY}$ = The areal power density of PV modules in target year TY (MW/km²)

$C_{AD,PVmod,BY}$ = The areal power density of PV modules in a base year BY_{PV} (MW/km²) (discussed below)

ϕ_{PV} = The annual rate of change in the $C_{AD,PVmod}$ (discussed below)

Reference estimates of technical potential for utility PV at minimum levels of solar insolation

The NREL Global RE Opportunity Tool (NREL, 2012a) provides estimates of the PV technical potential (in GW of rated capacity), by country, for different levels of solar insolation, given a reference areal power density. We define the utility-scale PV potential as 60% of the potential calculated from the tool in locations exceeding 4 kWh/m²/day and 40% of the potential in locations exceeding 5 kWh/m²/day. On the basis of assumptions in Denholm and Margolis (2008), we assume that the NREL reference areal power density ($C_{AD,PVutility,C,TY}^*$) is 48 MW/km².

Spacing factor for utility PV

The spacing factor is the ratio of the areal power density of the entire utility-PV facility to the areal power density of the PV modules (panels) themselves. Denholm and Margolis (2008) estimate two multiplicative components of the spacing factor. First, they assume a factor of 2.0, for fixed (non-tracking) panels, to account for space for service vehicles between rows and the need for separation to avoid tilted panels shading each other. However, it is not clear whether they have accounted for the fact that tilted panels also have a lower horizontal footprint. It also is not clear that every row needs to have a service road on both sides. We assume that their assumption of 2.0 is an upper bound (a component of our “maximum” spacing factor), and that a reasonable lower bound (a component of our “minimum” case) is 1.45.

Denholm and Margolis (2008) then apply an additional factor of 1.4 to account for the extra spacing required for single-axis tracking panels. Again, we assume this value for our maximum case; for our minimum case, we assume 1.25.

With these assumptions, the maximum spacing factor is $1.40 * 2.00 = 2.80$ and the minimum spacing factor is $1.45 * 1.25 = 1.80$. We assume that the reference factor is 2.3.

Areal power density of PV modules

For all PV systems (commercial, residential, and utility-scale), in all countries, the base-year (2015) panel is a SunPower E20-327, which has a *dc* nameplate rating of 327W for a panel of 1.046m by 1.558m (Sunpower, 2016), giving $C_{AD,PVmod,2015} = 201 \text{ W/m}^2$ in the base year of 2015. We assume that the panel efficiency and hence $C_{AD,PVmod}$ (power output at constant panel size) increases at 0.5%/year ($\phi_{PV} = 0.005$), based in part on estimates in the NREL (2012).

Capacity factor for utility-scale PV plants

We use the 3-D global simulation model GATOR-GCMOM to model the solar irradiance and capacity factor for utility-scale PVs, for each country. We start by using GATOR-GCMOM to estimate the capacity factor for a panel on a flat surface. We then adjust the capacity factor to account for the difference in the capacity factor between a panel at the optimal tilt and a panel on a flat surface, using country-specific roof slopes and latitudes. See the discussion of the capacity factor for rooftop PV for details on the method.


Technical potential of CSP


Concentrated solar power (CSP) technical potential by country is obtained by estimating the land area exposed to 5 kWh/m²/day, as determined from the NREL (2012a) Global Solar Opportunity Tool. Values used here are provided in Delucchi et al. (2016).

Existing PV and CSP installations

As of the end of 2015, 0.76% of the proposed 2050 PV (residential rooftop, commercial/government rooftop, and utility scale) installed capacity and 0.14% of the CSP installed capacity among the 139 countries from Table S7 had been installed. Figure S7 indicates that Germany, China, Japan, and Italy have installed the most PV. Spain, the United States, and India have installed the most CSP.

Figure S7. (a) Installed residential, commercial/government, plus utility PV by country and (b) installed CSP by country as of the end of 2015. Total PV is determined first from IEA (2016); the ratios of residential : commercial/government : utility PV for 20 European countries and global averages used on the remaining countries are from EPIA (2014). CSP by country is from CSP Plaza (2016).

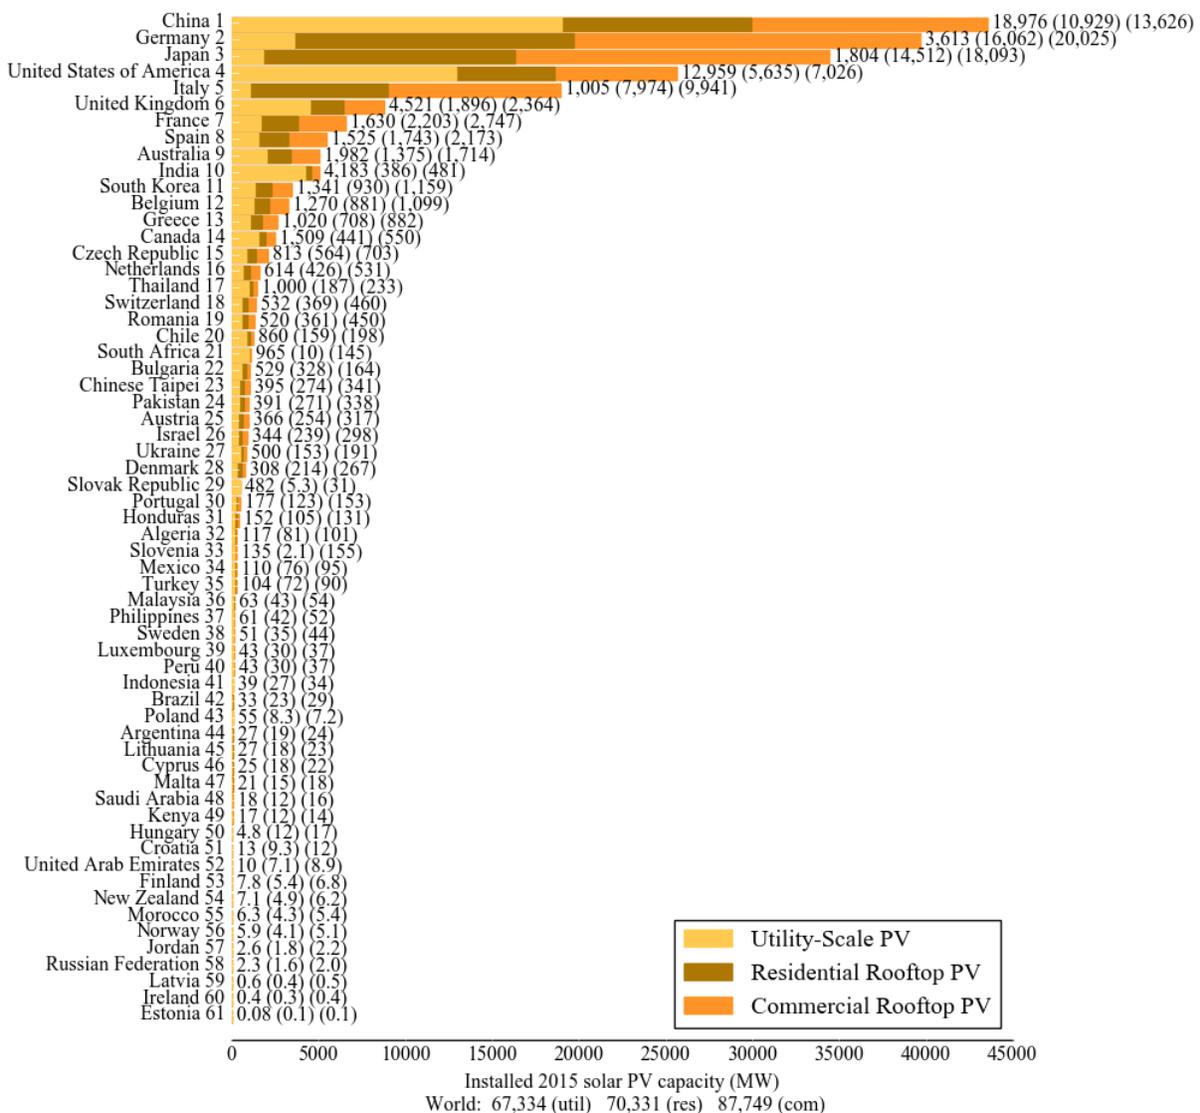

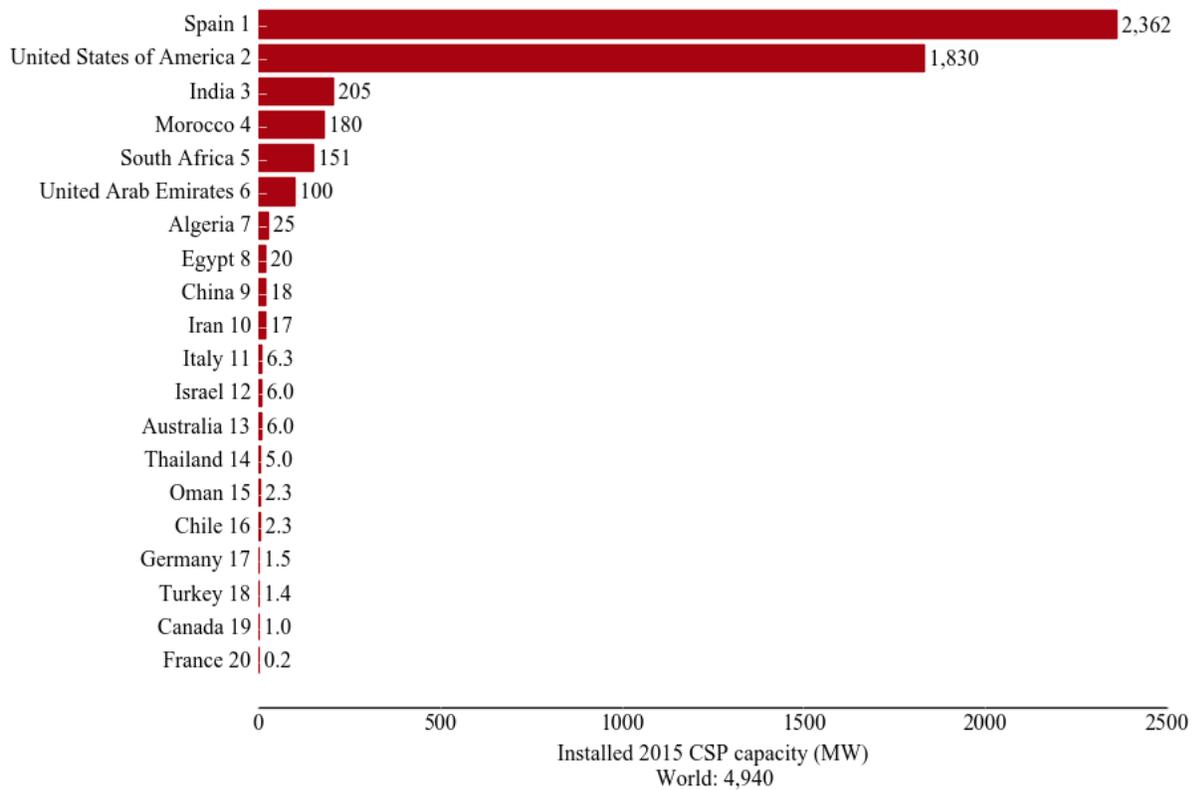


S5.3. Geothermal

Geothermal heat from volcanos, geysers, hot springs, conduction from the interior of the Earth, and solar radiation absorbed by the ground can be used to generate electricity or produce heat, depending on the temperature of the resource. All countries can extract heat from the ground for direct heating or use in heat pumps.

As of the end of 2015, 12.586 GW of geothermal has been installed for electric power and 70.339 GW has been installed for heat worldwide. The United States, Philippines, and Indonesia lead electric power installations, whereas China, the United States, and Sweden lead heat installations (Figure S8). The installed geothermal for electricity represents 13.1% of the nameplate capacity of geothermal needed for electric power generation under the plans proposed here (Table S7). The geothermal for heat already installed is 100% of the nameplate capacity of geothermal needed for heat storage under these plans (Table S7).

Figure S8. Installed geothermal power used for electricity and heat by country in 2015 (IRENA, 2016a).

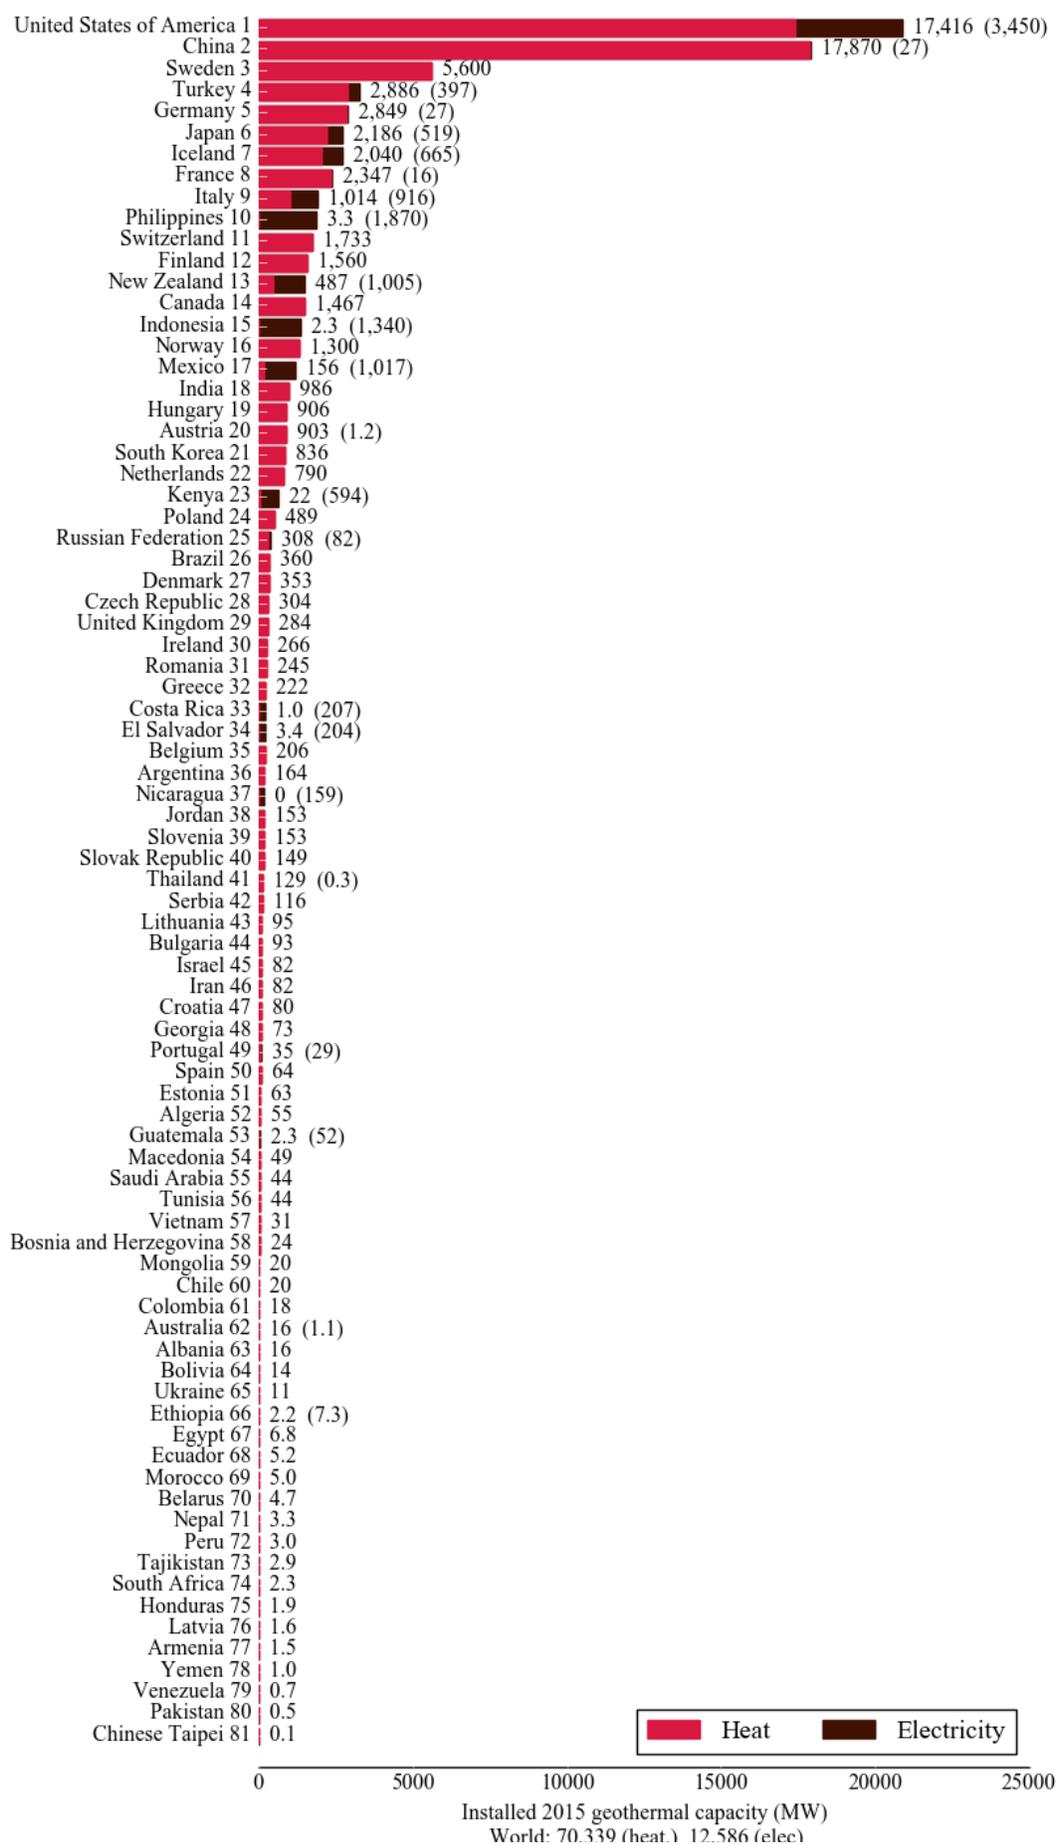


The average capacity factor of installed geothermal for electricity worldwide based on 2012 data is ~70.3% (IEA, 2015c). However, this is not a technical or economic limit, and in a 100% WWS system the capacity factor for geothermal could be higher than this. Therefore, the roadmaps here assume that the capacity factor of geothermal will increase to 90.0% by 2050. This results in a 139-country-total requirement of 96.5 GW of installed geothermal for electricity, producing 86.9 GW of actual power and 78.8 GW of delivered power after transmission, distribution, and downtime losses in 2050.

S5.4. Hydropower

In 2013, conventional (small and large) hydropower provided ~16.3% of the world electric power supply (IEA, 2015d). 2015 installations of hydropower (excluding pumped hydroelectric) were ~1.058 TW (Figure S9). Given the world-averaged capacity factor for hydropower of ~42.0% in 2013 (IEA, 2015c), this implies hydropower generated ~444.0 GW (3,889 TWh/yr) of electricity in 2015.

Figure S9 shows the distribution of installed conventional hydropower by country in 2015. China, Brazil, the United States, and Canada lead in installations. However, the countries of the world with the greatest percentage of their electric power production from hydropower in 2013 include, in order: Albania (100%), Paraguay (100%), Zambia (99.7%), Tajikistan (99.7%), Nepal (99.7%), Democratic Republic of the Congo (99.6%), Mozambique (97.7%), Norway (96.1%), Ethiopia (95.6%), Namibia (95.6%), and the Kyrgyz Republic (93.5%) (World Bank, 2016a). Thus, 6 countries already produce 99-100% of their electricity (but not total energy) from WWS hydropower. Further, ~22 countries produce more than 70% of all their electricity from hydropower and 36, of which 28 are developing countries, produce more than 50%.

Figure S9. Installed conventional hydropower by country in 2015 (IHA, 2016).

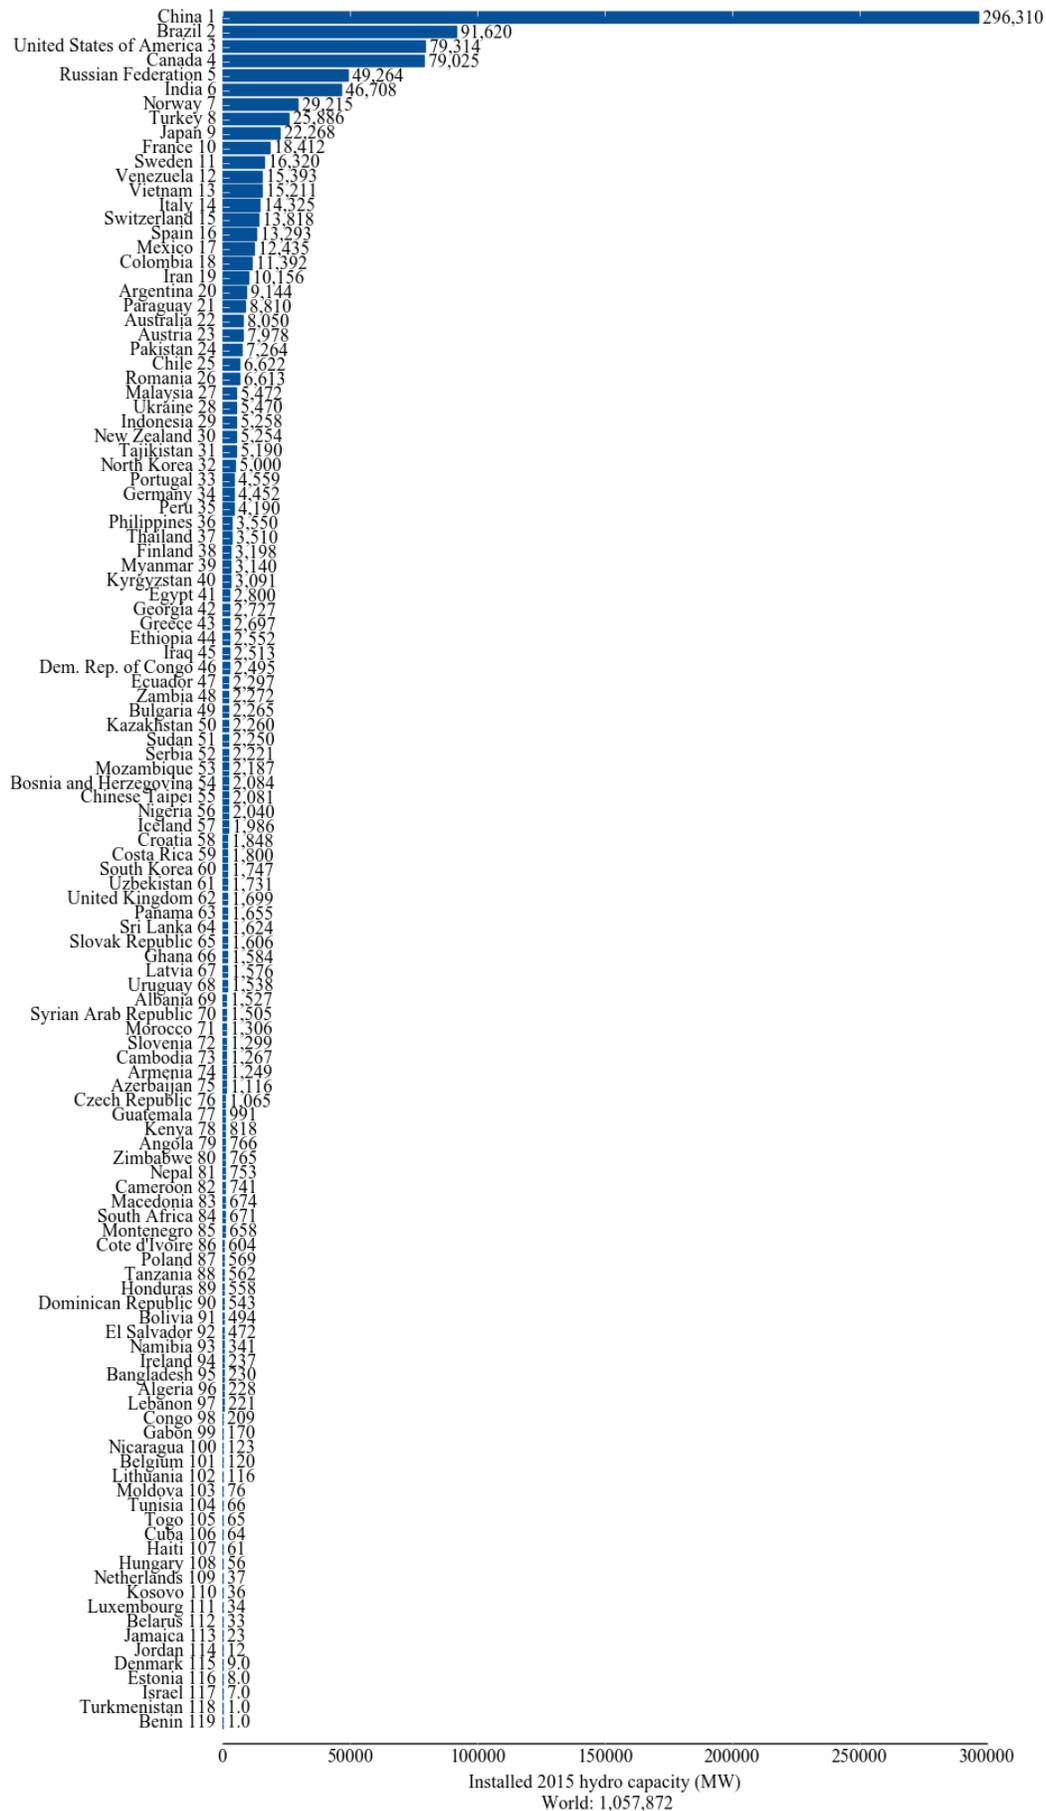

Under the roadmaps proposed here, conventional hydropower will supply ~4.004% (474.1 GW) of the 139-country 2050 end-use power demand for all purposes (Table S7). However, no new hydropower dams are proposed for installation. Instead, the capacity factor of hydropower will be increased from a 139-country average of ~42.0% to 50% by 2050. Increasing the capacity factor is feasible because existing dams currently produce less than their maximum capacity, mainly since many other dispatchable sources of electricity exist in the current energy system, greatly reducing the need for hydropower to balance supply and demand. Also, in some cases, hydropower is not used to its full extent because other priorities affect water use, and in a 100% WWS system, these other priorities will remain.

Whereas, increasing hydropower capacity factors should be possible, if it is not, additional hydropower capacity can be obtained by powering presently non-powered dams. The U.S., for example, has over 80,000 dams that are not powered at present. Although only a small fraction of these dams can feasibly be powered, DOE (2012) estimates that the potential amounts to ~12 GW of capacity in the contiguous 48 states.

S5.5. Tidal

Technical Potential

Installed tidal power worldwide as of 2015 end was only 1.8% of the installations needed under the proposed roadmaps here (Table S7). Although tidal is not widespread commercially, it is an existing clean, renewable technology that provides relatively constant power. It is proposed for deployment here only in locations with significant tidal resources and only to provide less than 0.1% of worldwide end-use energy (Table S7). Here, it's technical potential is discussed.

Atlantis Resources Ltd. (2014) provides estimates of the technical potential for tidal power in 28 countries with relatively favorable conditions. For all other countries we estimate the technical potential as a nonlinear function of the length of coastline according to the following formula:

$$C_{TP,TIDE,C} = \left(\frac{CL_C \cdot CLK_{TIDAL}}{k} \right)^\varphi$$

where

CL_C = the length of coastline of country C (km) (see discussion of offshore wind technical potential)

CLK_{TIDAL} = coastline convolution correction factor for tidal power (1.00, on the assumption that the resolution of the coastline-length data matches the resolution appropriate for estimating tidal power resources; see discussion of offshore wind technical potential)

k, φ = we assume values of $k = 10$ and $\varphi = 0.65$, which generate the following seemingly reasonable results:

CL_C	10	50	100	500	1,000	2,000	5,000	20,000	50,000	100,000	200,000
--------	----	----	-----	-----	-------	-------	-------	--------	--------	---------	---------

$$C_{TP,TIDE,C} \quad 1.0 \quad 2.8 \quad 4.5 \quad 13 \quad 20 \quad 31 \quad 57 \quad 140 \quad 254 \quad 398 \quad 625$$

These results indicate that this formulation results in relatively low technical potential (by comparison, countries with favorable conditions have 1000s of MW of potential), which is appropriate because the feasible technical potential for tidal power is a function not just of the length of coastline but of the characteristics of the tides, and presumably the estimates in the literature of the technical potential for tidal power in 28 countries (mentioned above) are for places with the most favorable tide characteristics.

For all countries, we assume that the actual installed capacity of tidal power equals its technical potential,

$$C_{I,TIDE,C} = C_{TP,TIDE,C}$$

where


$C_{I,TIDE,C}$ = Total installed capacity of tidal power in country C (MW)

$C_{TP,TIDE,C}$ = Total technical-potential capacity of tidal power in country C (MW) (discussed below)

Current installations of tidal

Worldwide by the end of 2015, a total of ~534 MW of ocean devices (mostly tidal barrages) had been installed (Figure S10). This capacity is mostly from two large plants in South Korea and France and smaller plants in Canada and the United Kingdom.

Figure S10. Installed ocean power by country in 2015 (IRENA, 2016a). Ocean power includes tidal rise and fall, ocean and tidal currents, wave power, ocean thermal energy conversion, and salinity gradients. Nearly all the existing capacity in the figure arises from tidal barrages.

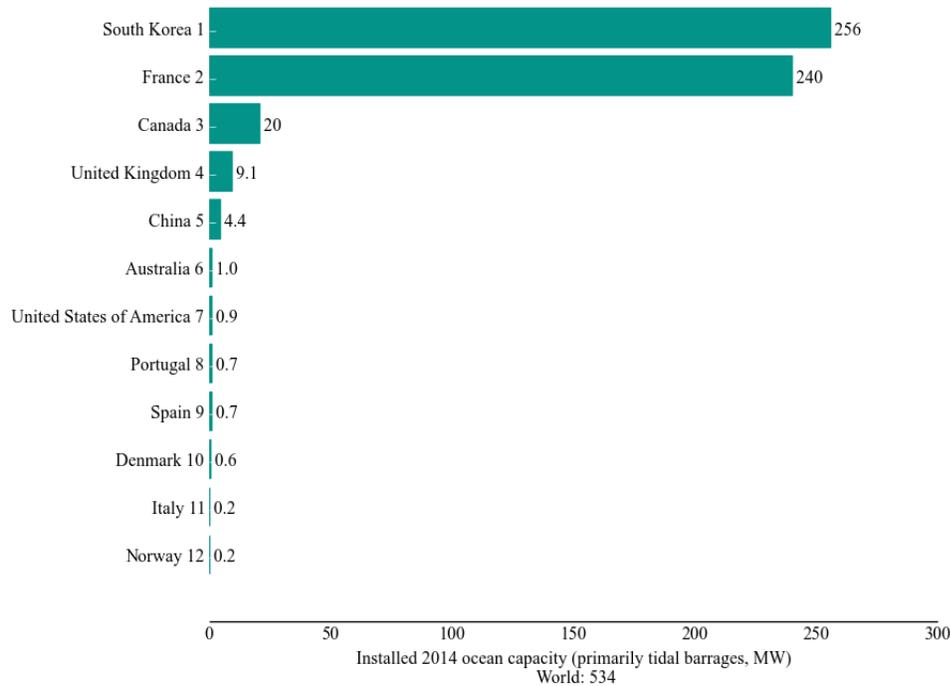

Proposed tidal installations in 100% WWS roadmaps

Under the roadmaps here, tidal is proposed to contribute ~0.057%, or ~6.73 GW, of the 139-country end-use delivered power in 2050 (Table S7). This requires a nameplate capacity of ~30.6 GW installed of which ~1.8% has been installed as of the end of 2015. The needed nameplate capacity is much less than the estimated world technical potential of ~556 GW installed (1200 TWh/yr or 137 GW delivered power) (Marine Renewables Canada, 2013). Some countries with significant tidal potential include Australia (3.8 GW nameplate capacity), Canada (171 GW), France (16 GW), Ireland (107 GW), Japan (3 GW), United Kingdom (8 GW), and the United States (116 GW) (Marine Renewables Canada, 2013).

S5.6. Wave

Technical Potential

No commercial wave power had been installed worldwide as of 2015 end (Table S7). However, numerous companies have developed and tested wave devices. It is proposed for deployment here only in locations with significant wave resources and only to provide less than 0.6% of worldwide end-use energy (Table S7). Whereas wave (and tidal) power are not essential for the roadmaps proposed here since wind and solar, in particular, could take their place, it is proposed that they be included here to increase the diversity of resource options available and because they provide relatively constant power and are on the edge of commercialization. Here, wave power’s technical potential is discussed.

The technical potential capacity for wave power is a function of the wave power available per unit of coastline, the fraction of the coastline that can be exploited for wave power, the wave-energy/electrical-energy conversion efficiency of the wave-energy converter (WEC), and the overall “gross” capacity factor for the WEC (a function of the wave power flux per unit

coastline), where “gross” means without consideration of the *availability* of the WEC. [See Falcão (2010) and López et al. (2013) for a review of WEC technologies.] We consider several classes of wave-power resources, and sum over all classes with a midpoint greater than a minimum acceptable value,

$$C_{TP,WAVE,C} = CL_C \cdot CLK_{WAVE} \cdot \cos \theta_{WAVE,C} \cdot CE_{MECH,WAVE} \cdot CE_{ELEC,WAVE} \cdot$$

$$\sum_{p \geq Pcl_{WAVE,min}} \frac{Pcl_{WAVE,p} \cdot Frcl_{p,C} \cdot Frcl_{p,C} \cdot CE_{ABS,WAVE,p}}{CF_{WAVE,gross,p}}$$

$$CF_{WAVE,gross,p} = CF_{WAVE,gross,ref} \cdot \left(\frac{Pcl_{WAVE,p}}{Pcl_{WAVE,ref}} \right)^\varphi$$

where

$Pcl_{WAVE,p}$ = The wave power impinging on the coastline (i.e., perpendicular to the coastline) per unit of coastline in wave-power-resource class p (MW/km) (discussed below)

CL_C = The length of coastline of country C (km) (discussed below)

CLK_{WAVE} = Coastline convolution correction factor for wave power (discussed below)

$\theta_{WAVE,C}$ = The angle between the prevailing wave direction and the perpendicular to the shoreline (degrees)

$Frcl_{p,C}$ = The fraction of the coastline in country C with wave-power-resource class p (discussed below)

$Frcl_{p,C}$ = The fraction of the coastline in country C that can be exploited for wave power, in wave-power-resource class p (discussed below)

$CE_{MECH,WAVE}$ = The efficiency of conversion of absorbed power to mechanical power (ratio of power at mechanical/electrical system junction to power at point that waves impinge upon the mechanical system of the WEC) (discussed below)

$CE_{ELEC,WAVE}$ = The efficiency of conversion of mechanical power to electrical power (ratio of power out of the WEC into the electrical grid to power input to the electrical system at the mechanical/electrical system junction) (discussed below)

$CE_{ABS,WAVE,p}$ = The efficiency of absorption (or capture) of wave power in wave-power-resource class p (the ratio of absorbed power, impinging upon the mechanical system of the WEC, to the incident wave-front power; also referred to as the “capture width” fraction or ratio: the power captured by the WEC as a fraction of the incident wavefront power [Yemm et al., 2012; Barbarit et al., 2012]) (discussed below)

$CF_{WAVE,gross,p}$ = The gross capacity factor for the wave-power device in wave-power-resource class p (discussed below)

$CF_{WAVE,gross,ref}$ = Reference gross capacity factor (at reference wave power)

$Pcl_{WAVE,ref}$ = Reference wave power (discussed below)

ϕ = Exponent (discussed below)

ϕ Subscript p = The midpoint of the wave-power classes (MW/km) (0, 0-10, 10-20, 20-30, 30-40, 40-50, 50-60, 60-70, 70-80, 80-90, 90-100, 100-110, 110-120)

$Pcl_{WAVE,min}$ = The minimum acceptable wave power (MW/km) (discussed below)

Generally the minimum acceptable wave power falls between two wave-power-class midpoints (i.e., the minimum is almost never *exactly* equal to one of the class midpoints). In these cases, rather than count only wave power above the upper bracketing midpoint, we give a partial weight to the lower bracketing wave-power-class midpoint, where the weight equals

$$\frac{Pcl_{WAVE,p-upper} - Pcl_{WAVE,min}}{Pcl_{WAVE,p-upper} - Pcl_{WAVE,p-lower}}$$

and $Pcl_{WAVE,p-upper}$ is the wave-power-class midpoint immediately above $Pcl_{WAVE,min}$, and $Pcl_{WAVE,p-lower}$ is the wave-power-class midpoint immediately below.

Wave power per unit of coastline, by country ($Pcl_{WAVE,p} \cdot Frcl_{p,C} \cdot \theta_{WAVE,C} \cdot Frcl_{p,C}$)

The global wave power resource near shore, defined as the energy flux per unit of wave crest length, ranges between ~10 and 100+ MW/km, depending on the latitude, orientation of the coastline, and season, with the highest values occurring at times and places receiving the heaviest storms (winter months at high north or low south latitudes on west-facing shores; e.g., western Australia in July; Pacific coast of North America in December) (López et al. 2013; Arinaga and Cheung, 2012; Reguero et al., 2011; Ocean Energy Systems, 2011; Gunn and Stock-Williams, 2012) (The mean annual exploitable energy resource (excluding extremely high-energy and hence un-exploitable sea states) in the best near-shore locations is in the range of 30 to 70 MW/km (Reguero et al., 2011; Gunn and Stock-Williams, 2012). Wave power plants need a resource of at least 20 MW/km annual median wave power to be viable (Arinaga and Cheung, 2012).

Gunn and Stock-Williams (2012) show wave-power classes, prevailing wave directions, and coastline buffer areas around the globe. We use their map to estimate $Pcl_{WAVE,p}$, $\theta_{WAVE,C}$, and $Frcl_{p,C}$. Gunn and Stock-Williams (2012) also provide estimates of the total wave-power resource for Australia, the U. S., Chile, New Zealand, Canada, South Africa, United Kingdom, Ireland, Norway, Spain, Portugal, and France; we calibrate our parameter inputs so that our estimated wave-power resources for these countries match theirs.

Gunn and Stock-Williams (2012) do not estimate resources for the Mediterranean sea; for this, we use the estimates of López et al. (2013), calibrating our assumptions to reproduce the López et al. (2013) estimate of 75 GW for the Mediterranean.

We assume that only 30% of the coastline can be used for wave power, in every country and wave-power class. (If we do get better data, we can specify $Frcl_{p,C}$ by country and wave-power class.)

Minimum acceptable wave power ($Pcl_{WAVE,min}$)

The minimum acceptable wave power is calculated from the specified minimum acceptable gross capacity factor,

$$\frac{CF_{WAVE,gross,min}}{CF_{WAVE,gross,ref}} = \left(\frac{Pcl_{WAVE,min}}{Pcl_{WAVE,ref}} \right)^\phi$$

$$Pcl_{WAVE,min,low} = Pcl_{WAVE,ref} \cdot \left(\frac{CF_{WAVE,gross,min,low}}{CF_{WAVE,gross,ref,low}} \right)^{\frac{1}{\phi}}$$

$$Pcl_{WAVE,min,high} = Pcl_{WAVE,ref} \cdot \left(\frac{CF_{WAVE,gross,min,high}}{CF_{WAVE,gross,ref,high}} \right)^{\frac{1}{\phi}}$$

where

$CF_{WAVE,gross,ref}$ = The reference gross capacity factor (discussed below)

$CF_{WAVE,gross,min}$ = The minimum acceptable capacity factor

Low refers to the low-cost, high-benefits case (high capacity factor, high resource availability)

High refers to the high-cost, low-benefits case (low capacity factor, low resource availability)

“Gross” refers to the capacity factor without considering availability; i.e., the ratio of actual output if availability were 100% to maximum potential output at 100% availability

Based on our analysis of the relationship between the capacity factor and the LCOE for wave power, we assume that $CF_{WAVE,gross,min,low} = 24\%$ and $CF_{WAVE,gross,min,high} = 30\%$. This results in

$Pcl_{WAVE,min,low} = 15.5$ MW/km and $Pcl_{WAVE,min,high} = 42$ MW/km. For comparison, Arinaga and Cheung (2012) assume that $Pcl_{WAVE,min} = 20$ MW/km.

Coastline length and coastline correction factor CL_C, CLK_{WAVE}

To define the world’s coastlines, Gunn and Stock-Williams (2012) use the Natural Earth 1:50,000,000 coastline dataset (Natural Earth, 2016), which, in turn, is derived primarily from the CIA’s World Data Bank II. Our estimates of coastline lengths are from the CIA’s *World Factbook* (CIA, 2016a). On the assumption that the coastline lengths in the CIA’s *World Factbook* are the same as the lengths in the CIA’s World Data Bank II, the correction factor to apply to our coastline length data, for the purpose of having it match the coastline length used by Gunn and Stock-Williams (2012), is 1.00

$$\text{Wave power conversion efficiency } (CE_{MECH,WAVE} \cdot CE_{ELEC,WAVE} \cdot CE_{ABS,WAVE,p})$$

So et al. (2015) model a hydraulic power-take off WEC given a wave height of 3 meters and a dominant period of 11 seconds, and find $CE_{ELEC,WAVE} = 82\%$ and $CE_{MECH,WAVE} = 74\%$, giving a “wave to wire” efficiency of $\sim 60\%$. Similarly, Carballo and Iglesias (2012) assume that the product of $CE_{MECH,WAVE}$ and $CE_{ELEC,WAVE}$ is 60%.

Yemm et al. (2012) show a graph that indicates that $CE_{ELEC,WAVE} \sim 90\%$, and write that for the Pelamis P2 line-absorber WEC, “the total combined conversion efficiency (from wave to wire) is typically approximately 70%” (p. 378), which implies that $CE_{MECH,WAVE} \sim 80\%$. We assume $CE_{ELEC,WAVE} = 85\%$ (high-cost case) to 90% (low-cost case) and $CE_{MECH,WAVE} = 70\%$ (high-cost case) to 80% (low-cost case)

The absorption efficiency $CE_{ABS,WAVE,p}$ depends on the incident wave power and on the design and operation of the wave-energy converter system. Yemm et al. (2012) show that the *theoretical* maximum capture efficiency can be as high as 73% for line absorber with a length of twice the wave front.

The absorption efficiency $CE_{ABS,WAVE,p}$ typically is estimated using a WEC “power matrix,” which shows the power generated by the device as a function of the significant wave height and the power period. Babarit et al. (2012) use numerical models to estimate the power matrix, the wave energy absorption and the “capture width ratio” (our parameter $CE_{ABS,WAVE}$) for 8 different WECs at five different sites along the Atlantic coast of Europe (Table S23). The parameter $CE_{ABS,WAVE}$ varies from a low of 2.1% for small bottom-referenced heavy buoy at the site with the highest wave-power resource to a high of 72% for a bottom-fixed oscillating flap at a site with mid-range wave-power resource. As shown in Table S23, the wave-capture efficiency depends much more heavily on the WEC technology than on the wave-power flux.

Table S23. Wave capture efficiency for 8 WECs and 5 coastal sites.

Wave MW/km	WEC							
	1	2	3	4	5	6	7	8
14	3.6	9.0	27.0	14.0	11.0	61.0	14.0	41.0
20	4.2	13.0	29.0	16.0	11.0	68.0	20.0	50.0
25	4.1	13.0	36.0	17.0	11.0	72.0	20.0	52.0
35	3.1	8.0	27.0	12.0	6.4	58.0	11.0	41.0
75	2.1	6.0	23.0	12.0	3.9	52.0	7.0	38.0

Source: Barbarit et al. (2012). The 8 WECs are 1= small bottom-referenced heaving buoy; 2 = bottom-referenced submerged heave-buoy; 3 = floating two-body heaving converter; 4 = bottom-fixed heave-buoy array; 5 = floating heave-buoy array; 6 = bottom-fixed oscillating flap; 7 = floating three-body oscillating flap device; 8 = floating oscillating water column. The MW/km values shown are in between the deep-water and shallow-water values for each of the 5 sites.

The estimates of Babarit et al. (2012) can be fit to a quadratic equation. We use linear extrapolation to extend the values of Table S23 to 5 MW/km and 100 MW/km, convert all values to a fraction of the value at 25 MW/km, and then fit the results to a quadratic, subject to minimum and maximum values w.r.t to the value at 25 MW/km:

$$CE_{ABS,WAVE,p} = CE_{ABS,WAVE,p=25} \cdot \max \left\langle CE_{fr_{ABS,WAVE,min}} \cdot \min \left[CE_{fr_{ABS,WAVE,max}} \cdot \left[b1 + b2 \cdot p_{mid} + b3 \cdot p_{mid}^2 \right] \right] \right\rangle$$

where

$CE_{ABS,WAVE,p=25}$ = The wave absorption efficiency at a wave flux of 25 MW/km (we assume a low-cost case (high capacity factor) estimate of 55% and a high-cost case 35%)

$CE_{fr_{ABS,WAVE,min}}$ = The minimum wave absorption efficiency w.r.t the efficiency at 25 MW/km
(0.20)

$CE_{fr_{ABS,WAVE,max}}$ = The maximum wave absorption efficiency w.r.t the efficiency at 25 MW/km
(0.95)

b1, b2, b3 = Coefficients from quadratic fit to Babarit et al. (2012) data (b1=0.800, b2 = 0.0128, b3 = -0.000193)

The resultant overall efficiency, the product of our three efficiency parameters, is in the range of 7% to 35%, which is consistent with other estimates of the overall efficiency. McCormick and Ertekin (2009) assume an overall conversion efficiency of 25%. Bedard et al. (2007) assume that efficiency of converting wave energy to mechanical energy is 15%, and the efficiency of converting mechanical energy to electrical energy is 90%, giving an overall conversion efficiency of 13.5%. Ocean Energy Systems (2014) report overall wave-energy-to-electrical-energy conversion efficiencies of 14%, 17%, and 55% for three different systems.

Gross capacity factor for wave-power devices ($CF_{WAVE,gross,p}$ and associated parameters)

The gross capacity factor generally will increase with increasing wave-power resources. Ocean Energy Systems (2015) plots estimates of the gross capacity factor (assuming 100% availability) as a function of the wave resource (in MW/km). The following values provide an acceptable fit to their plots:

$$CF_{WAVE,gross,ref,low} = 34\%$$

$$CF_{WAVE,gross,ref,high} = 30\%$$


$$Pcl_{WAVE,ref} = 42 \text{ MW/km}$$

$$\phi = 0.35$$

ϕ “Low” refers to low cost, high benefits and “high” refers to high cost, low benefits

These values result in the relationship shown in Figure S11.

Figure S11. Relationship between gross capacity factor and wave-power resource.

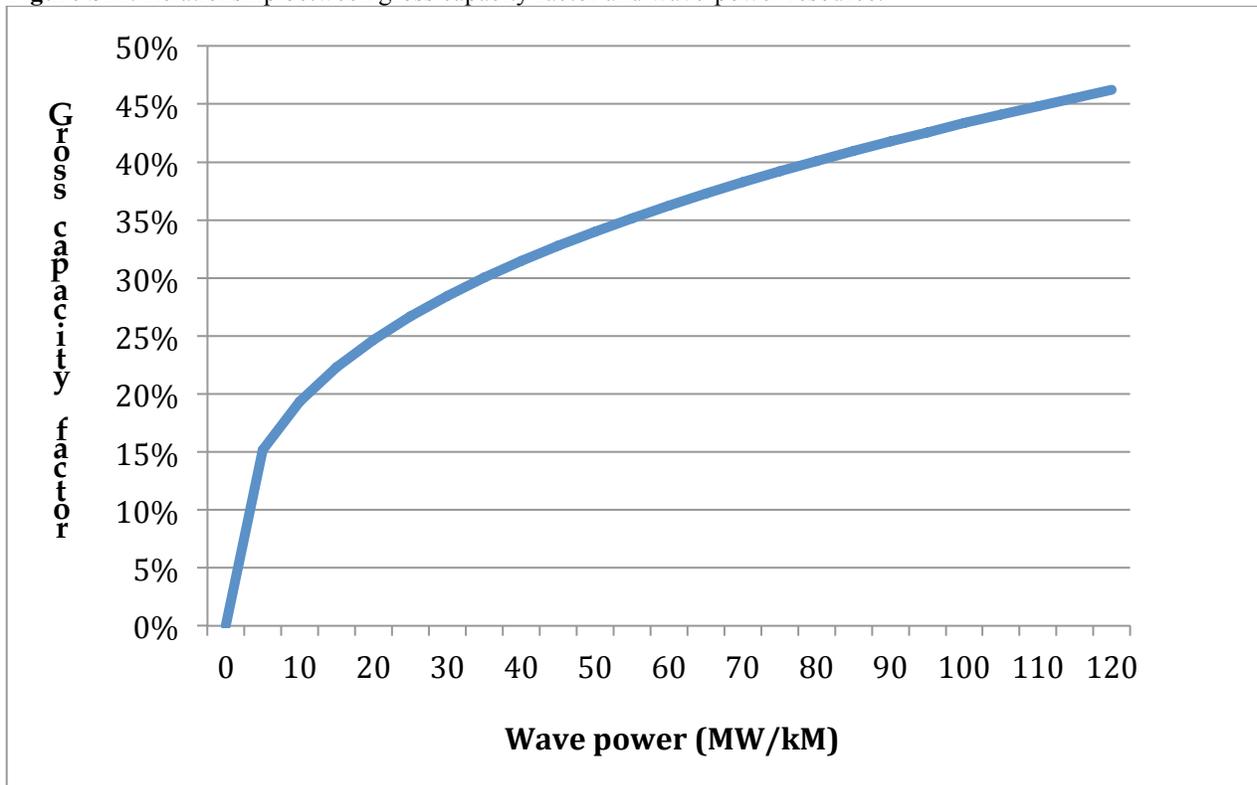

Note: based on the average of the low-cost (high-capacity-factor) and high-cost parameter values shown above.

The results shown in Figure S11 are broadly consistent with other estimates. Marine Renewables Canada (2013) estimates technical potential TWh per year from wave power in Australia, Canada, France, Japan, Ireland, Norway, the United Kingdom, and the U.S.; we back-calculate the installed capacity assuming an average capacity factor of 23.16% (Jacobson, 2009). The EOE (2010) remarks that 188 GW of installed capacity can produce 645 TWh/year, implying a capacity factor of 39%. Yemm et al. (2012) write that the target capacity factor for the Pelamis P2 wave energy converter is “25-40% depending on the conditions at the chosen wave farm site” (P. 366). Similarly, Folley and Whittaker (2009) suggest that WECs will have a “load factor” of between 25% and 40%.

Calculation of net capacity factor

We used the “gross” capacity factor (at 100% availability) to estimate installed capacity because the reference that provided information on the relationship between capacity factor and wave resource used the “gross” capacity factor. However, for the purpose of calculating actual power output and the associated LCOE, we must account for the availability of the WEC. We refer to this as the capacity factor without the subscript “gross”. Formally,

$$CF_{WAVE,C} = \frac{AP_{WAVE,C}}{C_{TP,WAVE,C}}$$

$$AP_{WAVE,C} = CL_C \cdot CLK_{WAVE} \cdot \cos\theta_{WAVE,C} \cdot CE_{MECH,WAVE} \cdot CE_{ELEC,WAVE} \cdot AV_{WAVE}$$

$$\sum_{p \geq Pcl_{WAVE,min}} Pcl_{WAVE,p} \cdot Frcl_{p,C} \cdot Frcl_{p,C} \cdot CE_{ABS,WAVE,p}$$

where

$CF_{WAVE,C}$ = the actual overall capacity factor for wave power in country C

$AP_{WAVE,C}$ = the actual continuous power output from wave power in country C (MW)

AV_{WAVE} = the availability factor for wave power (98% low cost case, 96% high cost case; Ocean Energy Systems, 2015)

other terms defined above

For all countries, we assume that the actual installed capacity equals the technical potential (because we estimate what might be called a technical “economic” potential):

$$C_{I,WAVE,C} = C_{TP,WAVE,C}$$

where

$C_{I,WAVE,C}$ = total installed capacity of wave power in country C (MW)

$C_{TP,WAVE,C}$ = total technical potential capacity of wave power in country C (MW)

Proposed wave power installations in 100% WWS roadmaps

Wave power is proposed here to contribute ~0.58%, or ~68.5 GW, of the 139-country end-use power demand in 2050 (Table S7). This requires a nameplate installation of ~307 GW, which is much less than the world technical potential for the 139 countries considered of ~4.362 GW installed (8,850 TWh/yr, or 1010 GW delivered) (Marine Renewables Canada, 2013 but assuming 70% exclusion zones). Some of countries with significant wave potential include Australia (192 GW installed), Canada (275 GW), France (14 GW), Japan (13 GW), Ireland (3 GW), Norway (59 GW), United Kingdom (6 GW), and the United States (263 GW) (Marine Renewables Canada, 2013).

Section S6. Costs of BAU and WWS Energy

In this section, current and future full social costs (including capital, land, operating, maintenance, storage, fuel, transmission, distribution, and externality costs) of WWS electric power generators versus non-WWS conventional fuel generators are estimated. These costs account for CSP storage and storage with existing conventional hydroelectric power. They do not include the costs of heat and cold storage in water, ice, or underground rocks, new pumped-

hydro storage, additional turbines to make hydroelectric power more efficient, or hydrogen production and compression necessary to keep the grid stable. However, such additional storage costs along with the costs of a fully stable grid in 20 world regions comprising the 139 countries examined here are provided in Section S7.

First, we adopt then update BAU and WWS cost estimates of Jacobson et al. (2015a) using recent analyses by IRENA (2015a), Lazard (2015), and other sources.

S6.1. Levelized Cost of Electricity From IRENA and Lazard

IRENA (2015a) provides a comprehensive review of the costs of unsubsidized and subsidized renewable electricity-generating technologies around the world. Table S24a presents their estimates for the year 2013/14, and Table S24b presents their projections for the year 2025.

IRENA (2015a) notes that costs are lower in China and India in part because of lower costs of materials (e.g., cement and steel) and labor. Costs for CSP with 6 to 9 hours of storage tend to be somewhat higher than the average shown in Table S24a.

IRENA (2015a) also provides information on O&M costs. Their Figure 4-15 shows that full-service O&M pricing for wind projects fell from above \$40/kW/year in 2008-2009 to under \$30/kW/year in 2012-2013. Elsewhere, IRENA (2015e) reports that its cost database indicates that O&M costs for utility-scale wind projects are \$20-\$40/kW/yr.

Table S24a. IRENA estimates of weighted-average total installed cost of utility-scale renewable power generation technologies, by region, 2013/2014 (year-2014 USD/kW).

	China and India	OECD	ROW
Biomass	1,200	4,200	2,700
Geothermal	n.e.	3,900	2,700
Hydro	1,250	2,400	1,700
Solar PV	1,600	2,200	2,650
CSP (w and w/out storage)	4,400	6,700	4,00
Offshore wind	1,400	4,400	n.e.
Onshore wind	1,300	2,000	2,250

Source: IRENA (2015a; their Figure 2.8). OECD = Organization for Economic Cooperation and Development; ROW = rest of world. Offshore wind costs include grid connection.

Table S24b. IRENA projections of cost reduction for renewable power generation technologies (year-2014 USD/kW or % change 2025 vs. 2014).

	China and India	US or OECD
Biomass	-10% to -15%	
Solar PV utility	n.e.	1,100 to 1,200
Solar PV rooftop	n.e.	1,600 to 2,000
CSP	-20% to -45%	
Onshore wind	no change (costs already competitive; move to larger turbines will offset any cost reductions)	1,400 to 1,600

Source: IRENA (2015a). OECD = Organization for Economic Cooperation and Development; ROW = rest of world. N.e. = not estimated.

IRENA (2015a) assumes that hydro and geothermal are mature technologies and that technology-related costs will not decline significantly in the future. However, according to IRENA (2015a) the installed capital cost of hydropower might increase in the future as smaller, more remote projects are built.

Jacobson et al. (2015a) relied heavily on Lazard’s (2014) “version 8.0” analysis of the cost of electricity-generating technologies; since then, Lazard (2015) has published version 9.0. Tables S25a and S25b show Lazard’s (2015) version 9.0 low-cost and high-cost estimates, and Tables S25c and S25d show the difference between Lazard (2015) version 9.0 and Lazard (2014) version 8.0.

Table S25a. Lazard (2015) version 9.0 low-cost-case estimates.

	CC	Build		Life	VOM	FOM	Fuel	Fuel
	(\$/kW)	(yrs)	CF	(years)	(\$/MWh)	(\$/kW/yr)	(\$/10⁶-	efficiency
							BTU)	
Advanced pulv. Coal	3000	5.0	93%	40	2.0	40	1.96	39%
IGCC coal	4000	4.8	75%	40	7.0	62.25	1.46	39%
Gas peaking	800	2.1	10%	20	4.7	5	3.45	33%
Gas combined cycle	1000	3.0	70%	20	3.5	6.2	3.45	51%
Diesel generator	500	0.3	95%	20	15.0	15	18.23	34%
Nuclear	5400	5.8	90%	40	0.5	135	0.50	33%
Geothermal	4500	3.0	90%	25	30.0	0	0.00	100%
Microturbine	2500	0.3	95%	20	7.0	6.85	3.45	31%
Biomass direct	3000	3.0	85%	25	15.0	95	1.00	24%
Wind	1250	1.0	55%	20	0.0	35	0.00	100%
Off-shore wind	3100	1.0	45%	20	13.0	60	0.00	100%
Fuel cell	3800	0.3	95%	20	30.0	0	3.45	47%
Solar thermal w/18-hr storage	10300	3.0	85%	35	0.0	115	0.00	100%
Utility PV crystalline tracking	1750	1.0	30%	30	0.0	13	0.00	100%
Utility PV thin film tracking	1600	1.0	32%	30	0.0	13	0.00	100%
Rooftop comm. Ind. PV	2600	0.3	25%	25	0.0	15	0.00	100%
Rooftop residential PV	4100	0.3	25%	20	0.0	17.5	0.00	100%

Table S25b. Lazard (2015) version 9.0 high-cost-case estimates.

	CC	Build	Life	VOM	FOM	Fuel (\$/10⁶-Fuel	efficiency
	(\$/kW)	(yrs)	CF (years)	(\$/MWh)	(\$/kW/yr)	BTU)	
Advanced pulv. Coal w/CC	8400	5.5	93%40	5.0	80	1.96	28%
IGCC coal w/CC	9800	5.3	75%40	8.5	73	0.65	29%
Gas peaking	1000	2.1	10%20	7.5	25	3.45	38%
Gas combined cycle	1300	3.0	40%20	2.0	5.5	3.45	49%
Diesel generator (intermittent)	800	0.3	10%20	15.0	15	18.23	34%
Nuclear	8200	5.8	90%40	0.8	135	0.75	33%
Geothermal	6400	3.0	85%25	40.0	0	0.00	100%
Microturbine	2700	0.3	95%20	10.0	9.12	3.45	28%
Biomass direct	4000	3.0	85%25	15.0	95	2.00	24%
Wind	1700	1.0	30%20	0.0	40	0.00	100%
Off-shore wind	5500	1.0	40%20	18.0	100	0.00	100%
Fuel cell	7500	0.3	95%20	50.0	0	3.45	52%
Solar thermal w/10-hr storage	10000	3.0	52%35	0.0	80	0.00	100%
Utility PV crystalline fixed	1500	1.0	21%30	0.0	10	0.00	100%
Utility PV thin film fixed	1400	1.0	23%30	0.0	10	0.00	100%
Rooftop comm. Ind. PV	3750	0.3	20%20	25.0	20	0.00	100%
Rooftop residential PV	5300	0.3	20%20	0.0	22.5	0.00	100%

Table S25c. Lazard (2015) version 9.0 vs. Lazard (2014) version 8.0, low-cost case.

	CC	Build	Life	VOM	FOM	Fuel (\$/10⁶-Fuel	efficiency
	(\$/kW)	(yrs)	CF (years)	(\$/MWh)	(\$/kW/yr)	BTU)	
Advanced pulv. Coal w/CC	100%	100%	100%100%	100%	100%	98%	100%
IGCC coal w/CC	100%	100%	100%100%	100%	100%	73%	99%
Gas peaking	100%	100%	100%100%	100%	100%	77%	100%
Gas combined cycle	99%	100%	100%100%	100%	100%	77%	100%
Diesel generator (intermittent)	100%	100%	100%100%	n.e. 2014	100%	63%	100%
Nuclear	100%	100%	100%100%	167%	142%	71%	99%
Geothermal	98%	100%	100%125%	100%	n.e.	n.e.	100%
Microturbine	109%	100%	100%100%	39%	n.e. 2014	77%	91%
Biomass direct	100%	100%	100%125%	100%	100%	100%	98%
Wind	89%	100%	106%100%	n.e.	100%	n.e.	100%
Off-shore wind	100%	100%	105%100%	100%	100%	n.e.	100%
Fuel cell	100%	100%	100%100%	100%	n.e.	77%	100%
Solar thermal w/10-hr storage	105%	120%	106%88%	n.e.	100%	n.e.	100%
Utility PV crystalline fixed	100%	100%	100%150%	n.e.	65%	n.e.	100%
Utility PV thin film fixed	91%	100%	107%150%	n.e.	65%	n.e.	100%
Rooftop comm. Ind. PV	104%	100%	109%125%	n.e.	115%	n.e.	100%
Rooftop residential PV	117%	100%	109%100%	n.e.	70%	n.e.	100%

Table S25d. Lazard (2015) version 9.0 vs. Lazard (2014) version 8.0, high-cost case.

	CC (\$/kW)	Build (yrs)	Life CF (years)	VOM (\$/MWh)	FOM (\$/kW/yr)	Fuel (\$/10 ⁶ -Fuel BTU)	Fuel efficiency
Advanced pulv. Coal w/CC	100%	100%	100%100%	100%	100%	98%	102%
IGCC coal w/CC	123%	100%	100%100%	100%	100%	33%	91%
Gas peaking	100%	100%	100%100%	100%	100%	77%	100%
Gas combined cycle	99%	100%	100%100%	100%	100%	77%	101%
Diesel generator (intermittent)	100%	100%	33% 100%	n.e. 2014	100%	63%	100%
Nuclear	100%	100%	100%100%	94%	117%	107%	99%
Geothermal	88%	100%	106%125%	100%	n.e.	n.e.	100%
Microturbine	71%	100%	100%100%	45%	n.e. 2014	77%	102%
Biomass direct	100%	100%	100%125%	100%	100%	100%	98%
Wind	94%	100%	100%100%	n.e.	100%	n.e.	100%
Off-shore wind	100%	100%	108%100%	100%	100%	n.e.	100%
Fuel cell	100%	100%	100%100%	100%	n.e.	77%	100%
Solar thermal w/10-hr storage	143%	120%	100%88%	n.e.	100%	n.e.	100%
Utility PV crystalline fixed	100%	100%	100%150%	n.e.	77%	n.e.	100%
Utility PV thin film fixed	93%	100%	110%150%	n.e.	77%	n.e.	100%
Rooftop comm. Ind. PV	125%	100%	100%100%	n.e. 2014	100%	n.e.	100%
Rooftop residential PV	118%	100%	100%100%	n.e.	75%	n.e.	100%

Notes for Tables S25a-S25d. CC = Capital cost; Build = build time; CF = capacity factor; VOM = variable operations and maintenance; FOM = fixed operations and maintenance; Fuel = fuel cost; n.e. = not estimated; n.e. 2014 = not estimated in Lazard (2014).

As shown in Tables S25c and S25d, Lazard (2015), compared with Lazard (2014), estimates higher capital costs for residential and commercial PV, solar thermal, and IGCC coal; lower capital costs for geothermal, onshore wind, and utility-scale thin-film PV; higher capacity factors for wind and PV; longer lifetimes for geothermal, biomass, and PVs; higher O&M costs for nuclear; and lower O&M costs for most PVs.

S6.2. Levelized Cost of Electricity From Other studies

Fu et al. (2016) report “benchmark” costs for solar PV systems in the U.S. in the first quarter of 2016 (year 2016 \$/W-dc): 2.93 for residential PV, 2.13 for commercial PV, and 1.42 for fixed-tilt utility-scale PV. Costs include modules, inverters, other hardware, labor, profit, and overhead. These costs are lower than the Lazard’s “low-cost” case.

Other recent work suggests that in the long run, CSP and ocean power may be economical. N’Tsoukpoe et al. (2016) present an analysis of a small-scale (10-kWe), low-cost CSP plant for developing countries. They expect that the use of local materials and relatively simple design and construction can result in an affordable LCOE.

Xu et al. (2015) review recent developments in CSP technologies using phase-change materials. They estimate that latent-heat thermal-energy storage systems (60 MWe system, 35% thermal efficiency, 6-to-8-hour charge) costs about \$350/kWe.

SolarReserve’s recently completed “Crescent Dunes” 110-MW CSP project in Nevada, with 10 hours of full-load molten-salt thermal-energy storage, had a private capital cost investment “in excess” of \$750 million (SolarReserve, 2016), giving a unit capital cost of at least \$6800/kW. SolarReserve states that construction cost for its “Redstone” 100-MW CSP project under development in South Africa, with 12 hours of full-load storage, is about 30% below the cost for

Crescent Dunes (Grikas, 2016), implying a capital cost of at least \$4800/kW. The O&M cost for the Crescent Dunes plant is at least \$100/kW-yr.

Shirawasa et al. (2016) propose a new marine-current turbine that uses to the middle layer of marine currents, to avoid the influence of wind and waves. Their design has relatively few parts, which they believe will make it reliable and relatively inexpensive.

Ocean Energy Systems (2015) provides estimates of cost parameters for tidal and wave power technologies, for current technologies (Table S26). The cost values generally are lower than in Jacobson et al. (2015a).

On the basis of information in Koomey and Hultman (2007) and a reconsideration of the studies cited in Jacobson et al. (2015a) we have changed the build time for APWR nuclear power to 6 to 11 years. We assume that build times for SMRs are 70% of this. Finally, upon reconsideration of the studies cited in Jacobson et al. (2015a) we have slightly increased the high-end overnight capital and lower-limit cost % for nuclear power.

Table S26. Cost parameters for tidal and wave power ~100 MW projects with current technology and commercial-scale production.

	Tidal power		Wave power	
	<i>low-cost</i>	<i>high-cost</i>	<i>low-cost</i>	<i>high-cost</i>
Capital cost (\$/kW)	\$3,400	\$6,000	\$3,000	\$7,000
Operating costs (\$/kW/year)	\$120	\$260	\$60	\$200
Capacity factor ^a	40%	35%	50%	25%
Long term LCOE w.r.t to current ^b	~25%		~10%	

Source: *Ocean Energy Systems (OES) (2015)*. LCOE = levelized cost of energy

^a The capacity factor as we define it here is the product of the “gross” capacity factor and the “availability” factor in the OES (2015) analysis. The OES estimates for tidal power account, qualitatively, for the reduction with increasing number of rows in the array, on account of the first rows extracting tidal energy and reducing the available energy for the rows behind. The OES estimates for wave power depend strongly on wave resource (MW/km), ranging from about 25% to what likely is the poorest exploitable resource to about 50% for the best wave resources.

^b For tidal power: the ratio of the LCOE at a cumulative industry deployment of 10,000 MW to the LCOE at 1 MW. For wave power: the ratio of the LCOE at a cumulative industry deployment of 100,000 MW to the LCOE at 10 MW.

In light of the recent estimates from IRENA (2015a), Lazard (2015), and the other studies summarized above, we have revised the baseline U.S. estimates of Jacobson et al. (2015a). The revisions are most significant for wave power and tidal power.

S6.3. Levelized Cost of Transmission and Distribution

Ideally, we would perform a detailed analysis of the optimal extent, capacity, and configuration of regional transmission grids for WWS systems in each country and region; however, this is beyond the scope of this study. Instead, to account simplistically for the likelihood that 100% WWS systems will require expanded regional transmission grids, we have added to the conventional transmission and distribution cost the amortized cost of *additional* HVDC lines of

6.4-GW capacity and 1500 km to 2000 km length. This amortized cost (assuming approximately a 50% average loading) is included in the total LCOE of all WWS technologies.

The cost of electricity transmission and distribution (T&D) is a significant fraction of the total levelized cost of delivered electricity. Jacobson et al. (2015) estimate that in 2013, the cost of conventional T&D was \$0.040/kWh (\$0.010 for transmission, and \$0.030 for distribution) -- about 37% of the average total delivered cost of electricity in the U.S. In the present analysis, baseline conventional T&D costs for all countries in the BAU and WWS scenarios are set to the U.S. values from Jacobson et al. (2015). Those values comprise the cost of the entire conventional T&D network from generators to end users: high-voltage ac transmission, substations, and the complete medium- and low-voltage distribution network. For the WWS scenario here we add the costs of additional high-voltage direct current (HVDC) transmission lines, discussed shortly.

As explained in Jacobson et al. (2015), the U.S. baseline T&D values are derived from projections derived in the EIA's *Annual Energy Outlook*. To check the reasonableness of the EIA's estimates of the cost of the distribution system -- the largest component of the conventional T&D system cost -- we make an independent estimate of the levelized \$/kWh cost of the U. S. distribution system in for the year 2010 and compare it with EIA's estimates of the \$/kWh cost for the U.S. Table S27 details the calculation.

The estimated capital cost in Table S27, ~\$500/kW, is consistent with value from other studies. Knapp et al. (2000) estimate that the marginal distribution capacity cost for several utilities in the U.S. ranges from ~\$200 to ~\$2000/kW. Similarly, Willis (2004) gives a number of estimates that indicate that distribution systems in the U.S. cost in the range of ~\$200/kW to more than ~\$1000/kW. Willis' (2004) estimate breaks down as follows:

- Substations cost ~\$20-\$30/kW. The \$/kW costs are much higher in urban areas, but decrease with increasing capacity.
- The feeder distribution system, up to but not including the service system, costs from \$10 to \$30/kW-mile, or \$100 to \$900/kW for 10 to 30 miles of system. (In an example calculation, Willis [2004, p. 619] assumes a feeder system with 25.6 miles.)
- The service system, including transformers for the drop to utilization voltage, local neighborhood lines at utilization voltage, and the service drop, costs about \$60/kW-transformer capacity.

Table S27. Deriving estimates of the \$/kW-electricity and \$/kWh-electricity cost of the U.S. BAU distribution system from data on total expenditures on the distribution system.

Parameter	Low cost	High cost	Notes
Inputs			
Total annual average investment in the electricity distribution system in the U. S., 1980-2010 (billion \$/year)	12.00	14.00	According to EPRI (2011), “investment in the distribution system has averaged \$12 to \$14 billion per year for last few decades, primarily to meet load growth, which includes both new connects and upgrades for existing customers” (p. 6-1). Willrich (2009) says that the “asset” value of the electricity distribution system was over \$240 billion around 2009, which implies an annual investment of at least \$6 if the system is completely replaced every 40 years. (Willrich also says that the asset value of the transmission system is 1/3 the value of the distribution system, which is consistent with EIA estimates that the cost of transmission is about 1/3 the cost of distribution.)
Average annual growth in electricity end use in the U. S. 1980-2010 (billion kWh/yr)	59.77	59.77	EIA (2016g).
Capacity factor for distribution system	60%	50%	DOE (2007) figures 1-3, 1-4, and 3-1 indicate that average continuous electricity consumption is about 55% of peak demand. Similarly, Willis (2004) provides several examples indicating that load factors for distribution systems – the ratio of average to peak demand – is in the range of 50 to 65 , with 55% being a typical value. If the maximum capacity of a distribution system is equal to the peak demand, then the capacity factor is the same as the load factor.
Distribution system efficiency	97%	96%	According to the International Electrotechnical Commission (2007), distribution losses (between the step-down substation and users) are in the range of 3% to 5% or more.
Average in-place capacity in U. S., 1980-2010 (billion kW, or TW)	0.79	0.79	EIA (2016g).
Average lifetime to replacement of in-place capacity (years)	50	65	Woo et al. (1995) write that “under normal operating conditions, a transformer can last up to 50 years” (p. 114). Brown (2009) shows curves that indicate that few substation transformers last past 60 years; few substation circuit breakers last past 50-60 years; and few wooden utility poles last past 60 years. Bumby et al. (2010) assume that for medium-voltage electricity distribution systems, overhead cables last 30 to 50 years, and

			underground cables last 20 to 40 years. Wang and J.-L. Bessède (2015) assume a life of 60 years for equipment for transmission and distribution networks. Willis (2004, p. 258) writes that, in the electricity distribution system, most electrical equipment has a service life of about 40 years (depending on ambient conditions, loading, faults, and so on); overhead conductors have a life of at least 60 years; poles have a life of 40-75 years; and steel structures last up to 100 years.
Assumed annual rate of return in utility calculations (%/year)	10.00	12.00	Powercor Australia (2012) uses a real 12% discount rate. In an example calculation, the DOE (2007, p. 3-12) assumes that Southern California Edison's fixed charge rate is 12% per year. We think this is an upper bound.
Assumed amortization period in utility calculations (years)	20	10	Woo et al. (1995) cite an example of amortizing over a 10-year period, but this seems like a low end.
O&M, annual fraction of capital cost (\$/kW/year basis)	0.05	0.10	Willis (2004) believes that the range is 3% to 12%.
Calculated results			
Implied growth in distribution system capacity (billion kW/year)	0.0114	0.0136	
Estimated replacement of old distribution system capacity (billion kW/year)	0.0158	0.0122	
Cost per kW of distribution system capacity (\$/kW)	441	542	Includes cost of expansion and cost of replacement and upgrades.
Amortized capital cost of distribution system (\$/kWh-electricity)	0.010	0.023	
Total levelized cost of distribution system (\$/kWh-electricity)	0.014	0.036	Amortized capital cost plus O&M costs.

Notes: EPRI= Electric Power Research Institute; DOE = Department of Energy; O&M = operations and maintenance.

The estimated capital cost in Table S26, along with our assumptions regarding lifetime and discount rate, result in a levelized electricity distribution cost of \$0.14 to \$0.036/kWh (Table S27), which is consistent with EIA's estimate that the average price of electricity distribution in the U.S. between 2005 and 2010 was \$0.024/kWh (EIA, 2010).

Additional long-distance HVDC transmission in the 100% WWS scenario

We assume that, in order to help balance supply and demand, a significant portion of the each country's entire WWS generation will have to be transmitted through newly-constructed (w.r.t to the BAU) onshore, long-distance, HVDC networks. (HVDC is more efficient and more economical than is HVAC to transmit very high power flows over long distances.) In the simplest terms, an HVDC transmission system comprises the following:

- A converter station that rectifies the *ac* power incoming from a generating station;
- A monopolar or bipolar HVDC cable from the rectifying converter to a load center;
- A converter station that inverts the *dc* power to *ac* for distribution to the load center.

HVDC transmission systems can use either voltage-source converters (VSCs) with insulated-gate bipolar transistors (IGBTs) or line-commutated converters (LCCs) with thyristors. Generally, LCC-HVDC transmission is more efficient and cost-effective for transferring high levels of power over long distances (Barnes and Beddard, 2012). Today, most HVDC projects use LCCs (Wikipedia, 2016c). However, with shorter distances and lower power levels, as in the case of connecting offshore wind farms to shore, VSC-HVDC transmission can be attractive (Liang and Feng, 2015; Smith et al., 2013; Flourentzou 2009; Bresesti et al., 2007; Ackermann, 2002).

Here we analyze the efficiency and cost of a land-based LCC-HVDC system, operating at very high power (6400 MW; two 800-kV cables at 4000-A each), and an offshore VSC-HVDC system operating at 2000 MW (two 400-kV cables at 2500-A each). We assume that additional HVDC transmission systems connect to conventional *ac* T&D networks. Since we account separately for the cost and efficiency of *ac* T&D, we estimate here the cost of additional HVDC per kWh transmitted out of the HVDC network and into the AC distribution system.

Specifically, we calculate the fully amortized cost of power actually sent through the additional HVDC system, and then multiply this cost per kWh-transmitted by the ratio of kWh through the additional system to total kWh required by end users, to come up with a system-wide additional transmission-cost “adder”. We assign the additional on-shore transmission cost to all generators – the entire WWS system – because the need for additional transmission is based on supply and demand balancing considerations over the entire system.

Table S28 shows the parameters in the calculation. It indicates that, for all WWS generators, including offshore wind, 50 (40-60)% of total energy generation, goes through long-distance HVDC transmission lines of 1750 (1500-2000) km length. For offshore wind generators, 68 (60-75)% of all energy generation also goes through HVDC lines of 150 (120-180) km length.

The analysis in Table S28 is further informed by data in Tables S29, S30 and S31, and other information discussed below. Table S29 shows studies of losses in HVDC systems, and Table S30 and Table S31 show job estimates resulting from the buildup of an HVDC system from NREL’s *Jobs and Economic Development Impact (JEDI)* transmission model (discussed in Section S9).

ABB (2016b) reports that a 2000-km, 800-kVDC line loses 5% of the electricity to heat. ABB (2016a) states that “converter station losses are normally as low as 0.6% per station” (presumably for LCCs) and that DC cable losses are 3-4% per 1000 km. Kjørholt (2014, p.7) states that LCCs have losses of 0.8% per converter.

Table S28. Calculation of additional long-distance HVDC transmission cost.

LAND-BASED TRANSMISSION			OFFSHORE TRANSMISSION			
<i>LCHB</i>	<i>Mid cost</i>	<i>HCLB</i>	<i>LCHB</i>	<i>Mid cost</i>	<i>HCLB</i>	
System design and operational characteristics						
800	800	800	400	400	400	Operating voltage of transmission lines (kV)
6400	6400	6400	2000	2000	2000	Actual rated maximum power capacity of entire transmission system (all cables) (MW)
2	2	2	2	2	2	Number of transmission cables (used for calculating maximum amps per cable)
1500	1750	2000	120	150	180	Average length of each new (additional) long-distance HVDC transmission system (in addition to BAU transmission system) (km)
45%	40%	35%	50%	45%	40%	Actual average current of transmission, low bin, 33% of time (fraction of current at rated capacity)
55%	50%	45%	60%	55%	50%	Actual average current of transmission, middle bin, 33% of time (fraction of current at rated capacity)
65%	60%	55%	70%	65%	60%	Actual average current of transmission, high bin, 33% of time (fraction of current at rated capacity)
99%	99%	98%	99%	99%	98%	Availability (hours available / hours per year) (only for use in calculating capacity factor)
Energy use and efficiency parameters						
0.0100	0.0115	0.0130	0.0100	0.0115	0.0130	Resistance per cable (micro-ohms per km)
0.10%	0.15%	0.20%	0.15%	0.23%	0.30%	Fixed (constant) losses for entire transmission system, lines and stations (percent of max rated INPUT power of transmission system)
1.5%	1.8%	2.0%	2.5%	2.7%	2.8%	Total losses at converter stations at maximum rated power (sum of losses at both ends -- rectifier and inverter) (percent of max rated INPUT power of transmission system)
1.65	1.60	1.55	1.65	1.60	1.55	Exponent on relationship between current level and power loss at converter stations (treating stations as single piece of equipment potentially operating at maximum transmission-system input power)
40%	50%	60%	60%	68%	75%	Ratio of: [kWh sent through the new HDVC system length] to [total kWh generated by whole system (including off-shore) or by off-shore only]
Cost parameters						
200	280	340	400	1120	2040	\$/MWts-km (where MWts=MW transmission system), line and tower cost, year 2007 US dollars
100000	105000	150000	100000	150000	100000	Reference cost for station equipment, both ends of line (transformers, power conditioners, ...)

0.75	0.75	0.75	0.75	0.75	0.75	Exponent on power in station equipment cost function
70	60	50	70	60	50	Lifetime until replacement or major overhaul (years) -- lines and poles
30	30	30	30	30	30	Lifetime until replacement or major overhaul (years) -- all other equipment
1.0%	1.3%	1.5%	1.0%	1.3%	1.5%	Maintenance cost (percent of \$/MW capital cost, per year)
70%	65%	60%	80%	75%	70%	Labor fraction of transmission line construction and operation costs (note: higher fraction gives lower costs/higher benefits for most countries relative to US, because most countries have lower labor costs)
60%	55%	50%	70%	65%	60%	Labor fraction of station construction and operation costs (note: higher fraction gives lower costs/higher benefits for most countries relative to US, because most countries have lower labor costs)
Results						
300,000	490,000	680,000	48,000	168,000	367,200	Cost of line and tower (\$/MWts), year 2007 US dollars
142,262	177,828	213,394	120,000	150,000	180,000	Cost of station equipment (\$/MWts), year 2007 US dollars
295	382	447	1,400	2,120	3,040	Cost of transmission system, including station equipment (\$MWts-km), year 2007 US dollars
2.32%	2.58%	2.72%	0.28%	0.33%	0.38%	Transmission line losses at actual current levels assumed (% of max rated input power)
0.57%	0.58%	0.59%	1.09%	1.03%	0.97%	Power-dependent station losses at actual current levels assumed (% of max rated input power) (treat station as single piece of equipment potentially operating at maximum power)
97.0%	96.7%	96.5%	98.5%	98.4%	98.4%	New HDVC system efficiency, kWh out of new system divided by kWh input to new system
98.8%	98.4%	97.9%	99.1%	98.9%	98.8%	Transmission system efficiency counting losses w.r.t to entire land-based or sea-based transmission system (multiplier to apply to entire system)
54.5%	49.3%	44.1%	59.4%	54.2%	49.0%	Capacity factor
0.0038	0.0080	0.0148	0.0016	0.0036	0.0082	Calculated cost (\$/kWh-out-of-system [into distribution system], at actual capacity factor); year 2013 US dollars
0.0015	0.0040	0.0089	0.0009	0.0024	0.0061	Calculated cost (\$/kWh-out-of grid, spread over all kWh (for land-based) or offshore kWh only (sea-based)); USD year 2013
68%	73%	76%	29%	53%	67%	<i>Note: line and tower percent of total capital cost</i>

Pickard (2013) assumes a 750 kV, 667-A cable with a resistance of 0.0263 Ω /km.

Clack et al. (2015) use linear programming to develop an optimal electrical system including HVDC transmission and storage. In an example test case involving solar PV, onshore wind, and natural gas generation with an HVDC system for the contiguous U.S., they find that the cost-optimizing (minimizing) configuration of the transmission system results in a transmission capacity of about 40% of generating capacity and an average transmission utilization (the ratio of total actual electricity throughput to potential throughput at continuous maximum capacity) of about 30%.

Table S29 presents estimates of losses in HVDC systems. In Table 29, Part A, estimates are shown from Bahrman and Johnson (2007) for the costs of and losses in HVDC systems of different power ratings and transmission lengths. Bahrman and Johnson (2007) also note that full-load converter station losses are 9.75% per station, and that total substation losses (transformers, reactors) are assumed to be 0.5% of rated power.

In Table S29, Part B, methods are given from Kalcon et al. (2013) of estimating losses from HVDC transmission based on VSCs using IGBTs. That study considers several components and losses for a system with a nominal input power of 200 MW.

Negra et al. (2006) estimate transmission-system losses for an HVAC transmission system, an LCC-HVDC system, and a VSC-HVDC system connecting 500 and 1000 MW off-shore wind farms up to 200 km from shore. Table S29, Part C shows their estimates for the LCC-HVDC system.

Table S29. Estimates of losses in HVDC systems.

S29.A. Bahrman and Johnson (2007).

	500 kV bipole	2-500 kV bipoles	600 kV bipole	800 kV bipole
Rated power (MW)	3,000	4,000	3,000	3,000
Maximum voltage (kV)	500	500	600	800
Number of cables	2	4	2	2
Max amps per cable	3,000	2,000	2,500	1,875
Trans. Distance (miles)	750	1500	750	750
Station cost incl. reactive compensation (million \$)	\$420	\$680	\$465	\$510
Transmission line cost (million-\$/mile)	\$1,200	\$2,400	\$1,350	\$1,463
Losses at full load (%)	6.44%	3.35%	4.93%	3.43%

Source: Bahrman and Johnson (2007, p. 39). We assume their cost estimates are in year-2006 U.S. dollars. Maximum amps per cable is our calculation; all other figures from Bahrman and Johnson (2007).

S29.B. Kalcon et al. (2013).

Component	Loss function	Loss	Comments
Transformers and AC filters	general form $i^2 \cdot r$	0.6 MW (0.3% of input) each end	Transformer resistance 0.2178Ω
2-level VSCs with IGBTs	switching and conduction losses (general form $i \cdot v + i^2 \cdot r$)	2.4 MW (1.2% of input) each end	We note that Barnes and Beddard (2012) show losses of 1% to 1.4% per converter for recent VSC systems
DC cables	joule heating ($i^2 \cdot r$)	1.5 MW (5% of input per 1000 km)	DC cable (~ 400 kV) resistance 0.0125 Ω/km; 150 km cable

Source: Kalcon et al. (2013).

S29.C. Negra et al. (2006), analysis for LCC-HVDC system.

Component	Loss function	Loss	Comments
LCC converter stations (filters, transformers, thyristor converters, smoothing reactor, other)	not used	0.11% (no load) to 0.7% (100% load) of rated power, each end	It appears that losses from VSC stations are at least twice as high
DC cables	$i^2 \cdot r$ and temperature function	~3% of the cable rated power per 1000 km	450 kV, 1333 amp DC cable resistance 0.011 Ω/km

Source: Negra et al. (2006).

Table S30. Costs and jobs per km of high-voltage transmission line.

SYSTEM CHARACTERISTICS										
Transmission line voltage (kV)	230	230	765	500	500	500	500	345	345	345
Transmission line type	AC	AC	AC	DC	DC	DC	DC	AC	AC	AC
Transmission line length (km)	32.2	1287	1287	1287	3218	3218	1931	644	644	644
Terrain classification	Flat w/access	Rollin g	Flat w/access Near town							
Population density classification	Rural	Rural	Rural							
Construction period (months)	5.0	200	100	100	250	250	150	67	67	67
Voltage grid side of transformer (kV)	69	69	69	69	69	230	115	69	69	69
JOBS (jobs/km except as noted)										
During construction period										
Direct: project development, onsite-labor	2.1	1.8	5.9	4.0	3.9	3.9	3.9	3.3	3.7	3.8
Indirect: equipment, supply-chain	0.5	0.4	1.1	0.7	0.7	0.7	0.7	0.6	0.7	0.7
Induced Impacts	0.7	0.6	1.5	1.1	1.0	1.0	1.1	0.9	0.9	1.0
Total construction jobs	3.3	2.8	8.5	5.8	5.7	5.7	5.8	4.8	5.3	5.5
Multiplier for induced jobs	1.28	1.25	1.21	1.24	1.23	1.23	1.23	1.22	1.22	1.22
During operating years (annual)										
Direct: onsite labor impacts	0.04	0.04	0.04	0.04	0.04	0.04	0.04	0.04	0.04	0.04
Indirect: local revenue, supply-chain	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01
Induced Impacts	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01
Total operations jobs	0.063	0.062	0.063	0.063	0.063	0.063	0.063	0.062	0.062	0.062
Multiplier for induced jobs	1.21	1.22	1.24	1.24	1.24	1.24	1.24	1.22	1.22	1.22

Table S30, continued.

COST (million \$/km)										
Line cost	\$0.50	\$0.50	\$1.28	\$0.82	\$0.82	\$0.82	\$0.82	\$0.69	\$0.76	\$0.81
Total system cost	\$0.96	\$0.57	\$1.47	\$1.50	\$1.14	\$1.14	\$1.30	\$0.81	\$0.89	\$0.94
Annual direct O&M (% of total cost)	0.78%	1.20%	0.46%	0.45%	0.59%	0.59%	0.52%	0.84%	0.77%	0.73%
Difference w.r.t prior column			Increase length of line	Increase line voltage	Switch to HVDC (and lower voltage)	Increase line length	Increase grid-side voltage	Base case for HVDC (reduce length, reduce grid-side voltage)	Base case for AC, change to AC, reduce length, terrain rolling	Change terrain back to flat, population density to near town

From NREL’s *JEDI* transmission model (NREL, 2013).

Costs are millions of dollars in year 2012 dollars. Construction period related jobs are full time equivalent jobs for one year. “During operating years” represent impacts that occur from maintenance and repair operations/expenditures. All model cases are for a project located in Texas, starting construction in 2014.

Table S31. NREL’s *JEDI* transmission line model construction cost multipliers.

Terrain Class	Multiplier
Desert/remote	1.1
Farmland	1.0
Flat w/access	1.0
Mountainous	1.3
Rolling	1.1
Population Density Class	
In town	1.3
Near town	1.2
Rural	1.0
Line Length Cost Multiplier	
Equal to or greater than 20 miles	1.0
less than 20 miles	1.0

From NREL’s *JEDI* transmission-line model (NREL, 2013). All of the multipliers pertain to the construction of the transmission line itself; i.e., not to the substations and the rest of the transmission system, and not to O&M costs.

Note on T&D system optimization in the 100% WWS scenario

We emphasize that we have not attempted to find the least-cost configuration of transmission and distribution, generator location and mix, storage, demand management, and so on. Instead, we have estimated the cost of a system that we think plausibly, reliably will match supply and demand. Because we are considering 100% WWS systems, rather than WWS systems integrated with conventional fossil and nuclear generators, that there are no system “integration” costs as estimated in other studies (e.g., Hirth et al., 2015; IRENA 2015d; Ueckerdt et al., 2013).

S6.4. Transmission and distribution efficiency in the BAU scenario

We estimate transmission and distribution efficiency in the BAU using IEA estimates of

historical electricity transmission and distribution losses by country and EIA *IEO* projections of transmission and distribution efficiency by region.

BAU scenario through 2012

The IEA reports data on electricity consumption, electricity “own use” in industry, and transmission and distribution losses, by country, through the year 2012 (IEA, 2015c).⁸ We use the IEA data to calculate the efficiency of transmission and distribution through 2012 as the ratio of electricity end-use to net generation, as follows:

$$eff_{ETD,C,Y_{to2012}} = \frac{E_{El,TFC,C,Y_{to2012}} + E_{El,EIOU,C,Y_{to2012}}}{E_{El,TFC,C,Y_{to2012}} + E_{El,EIOU,C,Y_{to2012}} + E_{El,TD-loss,C,Y_{to2012}}}$$

where

$eff_{ETD,C,Y_{to2012}}$ = Efficiency of electricity transmission and distribution in country C through 2012

$E_{El,TFC,C,Y_{to2012}}$ = Total final consumption of electricity in country C through 2012 (GWh) (IEA data)

$E_{El,EIOU,C,Y_{to2012}}$ = Energy-industry “own use” of electricity in country C through 2012 (GWh) (IEA data; we count energy-industry “own use” because it really is ordinary end-use consumption)

$E_{El,TD-loss,C,Y_{to2012}}$ = Losses in electricity transmission and distribution in country C through 2012 (GWh) (IEA data)

BAU scenario, 2013-2030

The EIA’s *IEO 2016* projects T&D efficiency by *IEO* region (EIA, 2016a). The EIA starts with *IEA* data on annual T&D losses by country for the period 2001 to 2012 (the same data we use above), and then estimates regional T&D efficiencies for 2001 to 2012. EIA then uses its judgment to project regional T&D efficiency for the period 2013 to 2050 (EIA, 2016c). However, EIA assumes no changes in T&D efficiency for any region after the year 2030.

We use the EIA’s projections as the basis for our estimates of T&D efficiency for the period 2013 to 2030. We adjust the EIA regional projections so that the efficiency improvement in countries with a relatively low T&D efficiency is greater than the regional-average improvement, and the efficiency improvement in countries with a relatively high T&D efficiency is less than the regional average. We also make sure that T&D efficiency stays within upper and lower limits. Formally,

$$eff_{ETD,C,Y} = \min \left[eff_{ETD,max}, \max \left[ff_{ETD,min}, eff_{ETD,C,Y-1} \cdot \left(\frac{eff_{ETD,R:CeR,Y}}{eff_{ETD,R:CeR,Y-1}} \right)^{\left(\frac{eff_{ETD,C,Y-1}}{\beta_{eff-ETD}} \right)^{\alpha_{eff-ETD}}} \right] \right]$$

where

$eff_{ETD,C,Y}$ = T&D efficiency in country C in year Y

$eff_{ETD,max}$ = The maximum allowable T&D efficiency (98.0%, based on the assumption that minimum possible losses from a distribution system are 2.0%)

$ff_{ETD,min}$ = The minimum allowable T&D efficiency (65%)

$eff_{ETD,C,Y-1}$ = T&D efficiency in country C in year $Y-1$ (note that the first year $Y-1$ is the last year of historical data)

$eff_{ETD,R;C\in R,Y}$ = T&D efficiency in IEO region R (containing country C) in year Y (EIA, 2016c)

$eff_{ETD,R;C\in R,Y-1}$ = T&D efficiency in IEO region R (containing country C) in year $Y-1$ (EIA, 2016c)

$\alpha_{eff-ETD}$ = Exponent to amplify or dampen efficiency improvement relative to a reference value (see discussion below)

$\beta_{eff-ETD}$ = Reference value for determining “flex” point in amplification (see discussion below)

The parameter $\beta_{eff-ETD}$ is the reference “flex” efficiency: for any $eff_{ETD,C,Y-1} < \beta_{eff-ETD}$, the effect of $\left(\frac{eff_{ETD,C,Y-1}}{\beta_{eff-ETD}}\right)^{\alpha_{eff-ETD}}$ is to amplify the efficiency improvement relative to the regional average, and vice versa. We choose a value of 90% for $\beta_{eff-ETD}$. To specify $\alpha_{eff-ETD}$, we first estimate the T&D efficiency after 10 years as a function of different values of $\alpha_{eff-ETD}$ and different T&D

efficiencies at the start of the 10 years ($eff_{ETD,0}$), assuming $\beta_{eff-ETD} = 90\%$ and $\frac{eff_{ETD,R;C\in R,Y}}{eff_{ETD,R;C\in R,Y-1}} =$

1.001 or 1.004, which spans the range of values in the EIA IEO projections. Table S32 shows the results.

Table S32. T&D efficiency after 10 years as a function of $eff_{ETD,0}$ and $\alpha_{eff-ETD}$, for $\beta_{eff-ETD} = 90\%$.

Table S32.A. $\frac{eff_{ETD,R;C\in R,Y}}{eff_{ETD,R;C\in R,Y-1}} = 1.001$

$eff_{ETD,0}$	$\alpha_{eff-ETD}$						
	-3.00	-4.00	-4.50	-5.00	-5.50	-6.00	0.00
65.0%	66.7%	67.4%	67.9%	68.4%	69.0%	69.7%	65.7%
70.0%	71.5%	71.9%	72.2%	72.5%	72.8%	73.2%	70.7%
80.0%	81.1%	81.3%	81.4%	81.5%	81.5%	81.6%	80.8%
85.0%	86.0%	86.1%	86.1%	86.1%	86.2%	86.2%	85.9%
88.0%	88.9%	89.0%	89.0%	89.0%	89.0%	89.0%	88.9%
90.0%	90.9%	90.9%	90.9%	90.9%	90.9%	90.9%	90.9%
92.0%	92.9%	92.8%	92.8%	92.8%	92.8%	92.8%	92.9%
95.0%	95.8%	95.8%	95.7%	95.7%	95.7%	95.7%	96.0%

98.0%	98.8%	98.7%	98.7%	98.6%	98.6%	98.6%	99.0%
-------	-------	-------	-------	-------	-------	-------	-------

Table S32.B. $\frac{eff_{ETD,R:CeR,Y}}{eff_{ETD,R:CeR,Y-1}} = 1.004$

$eff_{ETD,0}$	$\alpha_{eff-ETD}$						
	-3.00	-4.00	-4.50	-5.00	-5.50	-6.00	0.00
65.0%	72.3%	75.3%	77.2%	79.6%	82.6%	86.1%	67.6%
70.0%	76.2%	78.1%	79.2%	80.5%	82.1%	83.8%	72.9%
80.0%	84.7%	85.3%	85.6%	86.0%	86.3%	86.7%	83.3%
85.0%	89.1%	89.4%	89.5%	89.6%	89.8%	89.9%	88.5%
88.0%	91.8%	91.9%	92.0%	92.0%	92.1%	92.1%	91.6%
90.0%	93.7%	93.7%	93.7%	93.7%	93.7%	93.7%	93.7%
92.0%	95.5%	95.4%	95.4%	95.3%	95.3%	95.3%	95.7%
95.0%	98.3%	98.1%	98.0%	97.9%	97.9%	97.8%	98.9%
98.0%	101.1%	100.8%	100.7%	100.6%	100.5%	100.4%	102.0%

Table S32 also shows the results when $\alpha_{eff-ETD} = 0$, which eliminates the effect of amplification or dampening. On the basis of the results shown in Table S32, we believe $\alpha_{eff-ETD} = -5.00$ gives reasonable results.

BAU scenario, beyond 2030

We estimate the T&D efficiency over the period 2030 to 2040 based on a 3-year moving linear extrapolation, subject to the same minimum and maximum values used above. Beyond 2040 we assume that the efficiency remains at the year 2040 value.

S6.5. Transmission and distribution efficiency in the WWS scenario

The T&D-system efficiency in the WWS scenario equals the efficiency in the BAU scenario multiplied by the efficiency of additional HVDC and additional conventional *ac* transmission, where the latter two efficiencies are expressed per unit of all kWh of consumption.

S6.6. Overall Energy, Health, and Climate Costs in the BAU Versus WWS Cases

Table S33 presents 2013 and 2050 139-country weighted average estimates of fully annualized levelized business costs of electric power generation for conventional fuels and WWS technologies. The table indicates that the 2013 business costs of hydropower, onshore wind, utility-scale solar PV, and solar thermal for heat are already similar to or less than the costs of natural gas combined cycle. Residential and commercial PV, offshore wind, tidal, and wave are more expensive. However, residential rooftop PV costs are given as if PV is purchased for an individual household; a common business model today involves multiple households entering a contract together with a solar provider to decrease the average cost.

By 2050, the costs of all WWS technologies are expected to drop, most significantly for offshore wind, tidal, wave, rooftop PV, CSP, and utility PV, whereas conventional fuel costs are expected to drop less significantly or rise. Because WWS technologies have zero fuel costs, the drop in their costs over time is due primarily to technology improvements. WWS costs are expected to decline also due to less expensive manufacturing and streamlined project deployment from increased economies of scale. Conventional fuels, on the other hand, face rising costs over time due to higher labor and transport costs for mining, transporting, and processing fuels continuously over the lifetime of fossil-fuel plants.

Table S33. Approximate fully annualized, unsubsidized 2013 and 2050 U.S.-averaged costs of delivered electricity, including generation, short- and long-distance transmission, distribution, and storage, but not including external costs, for conventional fuels and WWS power (2013 USD/MWh-delivered-electricity or USD/MWh-delivered-thermal).

Technology	Technology year 2013			Technology year 2050		
	LCHB	HCLB	Average	LCHB	HCLB	Average
Advanced pulverized coal	81.5	104.0	92.8	77.4	101.2	89.3
Advanced pulverized coal w/CC	112.3	157.5	134.9	97.9	137.5	117.7
IGCC coal	93.0	120.7	106.9	83.3	108.6	96.0
IGCC coal w/CC	138.3	214.9	176.6	95.5	134.2	114.9
Diesel generator (for steam turbine)	185.5	245.3	215.4	247.3	372.1	309.7
Gas combustion turbine	182.7	386.2	284.5	186.9	374.0	280.5
Combined cycle conventional	81.2	93.9	87.6	103.9	133.0	118.5
Combined cycle advanced	n.a.	n.a.	n.a.	95.2	117.2	106.2
Combined cycle advanced w/CC	n.a.	n.a.	n.a.	111.2	140.2	125.7
Fuel cell (using natural gas)	120.7	189.1	154.9	132.6	199.3	166.0
Microturbine (using natural gas)	122.6	145.0	133.8	151.7	190.7	171.2
Nuclear, APWR	80.9	125.0	103.0	73.2	108.5	90.9
Nuclear, SMR	92.9	123.1	108.0	79.6	103.1	91.4
Distributed gen. (using natural gas)	n.a.	n.a.	n.a.	246.9	383.4	315.2
Municipal solid waste	202.3	256.7	229.5	179.1	213.1	196.1
Biomass direct	130.9	167.5	149.2	104.8	126.4	115.6
Geothermal	86.3	127.4	106.9	79.2	108.6	93.9
Hydropower	61.1	83.6	72.4	54.2	72.3	63.3
On-shore wind	74.1	100.8	87.5	66.1	88.4	77.3
Off-shore wind	108.9	198.0	153.5	100.8	179.6	140.2
CSP no storage	124.3	191.6	158.0	90.1	141.2	115.7
CSP with storage	80.8	113.3	97.1	64.2	91.6	77.9
PV utility crystalline tracking	71.1	94.7	82.9	64.5	85.3	74.9
PV utility crystalline fixed	75.3	104.1	89.7	59.9	78.4	69.2
PV utility thin-film tracking	70.5	92.7	81.6	64.0	83.5	73.8
PV utility thin-film fixed	74.5	104.1	89.3	59.3	78.4	68.9
PV commercial rooftop	95.4	142.4	118.9	83.5	122.1	102.8
PV residential rooftop	130.4	193.4	161.9	113.1	164.1	138.6
Wave power	131.0	277.5	204.3	125.2	269.8	197.5
Tidal power	102.6	215.6	159.1	97.3	208.8	153.1
Solar thermal for heat (\$/MWh-th)	56.7	67.0	61.9	52.3	62.6	57.5

LCHB = low cost, high benefits case; HCLB = high cost, low benefits case; n.a = not available. The methodology for calculating the costs is described in Jacobson et al. (2015a).

For the year 2050 100% WWS scenario, costs are shown for WWS technologies; for the year 2050 BAU case, costs of WWS are slightly different. Short-distance transmission and all distribution costs are described in Section S6.3; Long-distance HVDC transmission costs are given in Table S28. Transmission and distribution losses are accounted for in the energy available.

CC = carbon capture; IGCC = integrated gasification combined cycle; APWR = advanced pressurized-water reactor; SMR = small modular reactor; PV = photovoltaics.

CSP w/storage assumes a maximum charge to discharge rate (storage size to generator size ratio) of 2.62:1.

Solar thermal for heat assumes \$3,600-\$4,000 per 3.716 m² collector and 0.7 kW-th/m² maximum power (Jacobson et al., 2015a). MWh-th = MWh-thermal.

Table S33 does not include externality costs. These are estimated as follows. The 2050 139-country air pollution cost (Table S36) plus global climate cost (Table S40) per unit energy (converted to kWh) produced in all sectors in all countries in the 2050 BAU case (from Table S6) corresponds to a mean 2050 externality cost (in 2013 USD) due to conventional fuels of ~28.5 (11.2-72) ¢/kWh-BAU-all-energy, with ~12.7 (2.3-38) ¢/kWh-BAU-all-energy due to air pollution impacts and ~15.8 (8.9-34) ¢/kWh-BAU-all-energy due to climate impacts. The mean air pollution cost, which applies across all BAU sectors, is well within the 1.4-17 ¢/kWh-BAU-electricity range of Buonocore et al. (2016) for the retail electricity sector only. Externality costs arise due to air pollution damages (mortality, morbidity, and non-health damages) and global warming damage (e.g. coastline losses, fishery losses, agricultural losses, heat stress mortality and morbidity, famine, drought, wildfires, and severe weather) due to conventional fuels. When externality costs are added to the business costs of conventional fuels, all WWS technologies cost less than conventional technologies in 2050.

Table S34 provides the mean value of the 2013 and 2050 LCOEs weighted among all conventional electric power generators (BAU cases) and WWS electric power generators (WWS case) by country. The table also gives the 2050 energy (retail electricity sector only), air-pollution, and global climate cost savings per person.

The electric power cost of WWS in 2050 is not directly comparable with the BAU electric power cost, because the latter does not integrate transportation, heating/cooling, or industry energy costs. Conventional vehicle fuel costs, for example, are a factor of 4-5 higher than those of electric vehicles, yet the cost of BAU electricity cost in 2050 does not include the transportation cost, whereas the WWS electricity cost does.

The 2050 LCOEs, weighted among all electricity generators and countries in the BAU and WWS cases, are 9.73 ¢/kWh-BAU-electricity and 8.86 ¢/kWh-WWS-all-energy, respectively (Table S34). Taking the product of the first number and the kWh-BAU in the retail electricity sector, subtracting the product of the second number and the kWh-WWS-electricity replacing BAU electricity, and subtracting the amortized cost of energy efficiency improvements beyond BAU improvements in the WWS case, gives a 2050 business cost savings due to switching BAU electricity to WWS electricity of ~\$113/yr per capita (\$2013 USD). Adding 0.8 ¢/kWh-WWS-all-energy for additional storage described above gives a WWS business cost of ~9.66 ¢/kWh-WWS-all-energy, still providing ~\$85/yr per capita savings for WWS relative to just BAU's retail electricity sector.

Whereas, the cost per kWh-WWS above applies across all energy sectors, the cost per kWh-BAU applies only to the retail electricity sector. We have not calculated the cost per kWh-BAU across the transportation, heating/cooling, industrial, or agriculture/forestry/fishing sectors. We suspect, though, that such a calculation will result in an additional energy-expenditure-reduction benefit per capita for WWS beyond that in the retail electricity sector, particularly because far fewer kWh-WWS are needed than are kWh-BAU in the transportation sector (due to the greater energy:work ratio of electricity over combustion) and the industrial sector (due to eliminating the energy required to mine, transport, and refine fossil fuels).

In addition, WWS will save ~\$2,600/yr per person in health costs plus ~\$3,200/yr per person in global climate costs, for a total of ~\$5,800/yr per person in externality costs. The total up-front capital cost of the 2050 WWS system (for both average annual power and peaking storage in Table S7) for the 139 countries is ~\$125 trillion for the 49.9 TW of new installed capacity needed (~\$2.50 million/MW).

Table S34. Mean values of the levelized cost of energy (LCOE) for conventional fuels (BAU) in 2013 and 2050 in the electricity sector and for WWS in all energy sectors (which are now electrified) in 2050. The LCOE estimates do not include externality costs. The 2013 and 2050 values are used to calculate energy cost savings per person per year in each country due to switching from BAU to WWS in the electricity sector only (see footnotes). Health and climate cost savings per person per year among all sectors are derived from data in Section S8. All costs are in 2013 USD.

Country	(a) 2013 LCOE of BAU (¢/kWh- elec- tricity)	(b) 2050 LCOE of BAU (¢/kWh- elec- tricity)	(c) 2050 LCOE of WWS (¢/kWh- all- energy)	(d) 2050 Average BAU retail electricity cost savings to country due to switching to WWS electricity (\$/per- son/yr)	(e) 2050 Average air pollution damage cost savings to country among all sectors due to switching to WWS in country (\$/person/yr)	(f) 2050 Average climate cost savings to world among all sectors due to switching to WWS in country (\$/person/yr)	(g) 2050 Average electricity + country health + world climate cost savings due to switching to WWS in country (\$/person/yr)
Albania	7.24	6.33	7.96	16	1,552	1,229	2,797
Algeria	8.74	11.79	9.61	106	1,177	4,332	5,615
Angola	7.68	7.93	8.17	6	2,097	911	3,013
Argentina	8.66	10.34	11.01	72	1,271	3,529	4,871
Armenia	8.95	9.07	7.52	115	2,926	1,016	4,057
Australia	10.24	10.01	9.26	507	808	10,070	11,385
Austria	8.86	8.64	7.09	411	4,194	5,616	10,221
Azerbaijan	8.55	11.11	8.07	172	3,447	3,518	7,137
Bahrain	8.75	11.84	8.13	1,646	3,582	17,083	22,311
Bangladesh	8.77	11.70	6.99	25	1,678	346	2,049
Belarus	8.76	11.82	7.81	442	9,090	6,055	15,588
Belgium	10.53	10.24	6.81	638	4,459	6,751	11,849
Benin	8.80	11.85	8.48	7	1,648	329	1,984
Bolivia	8.51	10.12	8.95	23	437	1,101	1,561
Bosnia and Herzegovina	9.67	8.66	8.03	124	1,974	6,155	8,253
Botswana	10.68	9.60	9.52	66	1,156	2,399	3,622
Brazil	8.12	7.39	8.54	21	432	1,854	2,307
Brunei Darussalam	8.77	11.86	7.80	1,008	248	21,973	23,229
Bulgaria	10.53	9.43	8.04	482	5,338	6,697	12,517
Cambodia	8.91	11.58	9.88	16	617	292	925
Cameroon	7.71	7.81	6.74	10	1,804	290	2,105
Canada	8.62	7.96	9.71	41	2,677	9,626	12,344
Chile	9.42	9.57	10.67	83	1,479	4,501	6,063
China	10.24	9.22	8.59	164	4,730	5,513	10,407
Chinese Taipei	10.24	9.22	8.93	541	4,823	17,440	22,804
Colombia	7.88	7.48	7.29	31	228	1,506	1,766
Congo	7.83	8.47	8.11	6	1,009	326	1,341
Congo, Dem. Republic	7.25	6.36	6.49	2	196	28	225
Costa Rica	9.05	8.23	8.29	55	136	1,248	1,440
Cote d'Ivoire	8.38	10.25	8.17	17	299	221	537
Croatia	8.76	9.03	6.93	358	4,267	3,988	8,613

Cuba	5.27	6.90	10.84	-47	553	4,124	4,630
Cyprus	9.02	11.92	9.81	350	3,550	4,130	8,030
Czech Republic	10.94	9.65	7.03	474	4,926	7,962	13,361
Denmark	12.31	11.49	9.73	364	4,687	4,856	9,907
Dominican Republic	8.90	10.86	9.93	61	338	1,532	1,930
Ecuador	8.12	8.86	8.87	30	253	1,655	1,938
Egypt	8.73	11.42	10.23	114	1,764	2,082	3,960
El Salvador	10.56	10.57	9.04	50	157	977	1,184
Eritrea	8.80	11.85	10.11	4	627	74	704
Estonia	11.04	9.94	8.47	522	7,211	14,711	22,444
Ethiopia	7.28	6.39	8.90	0	449	33	481
Finland	9.89	9.10	9.12	472	6,200	7,052	13,724
France	10.54	9.19	9.82	164	3,153	3,323	6,640
Gabon	8.09	9.32	8.30	48	1,188	1,127	2,363
Georgia	7.58	7.57	8.60	40	3,147	1,214	4,401
Germany	11.12	10.36	8.28	467	5,033	7,147	12,646
Ghana	7.01	7.15	7.91	6	2,166	324	2,497
Gibraltar	10.69	10.71	6.11	390	8,055	10,983	19,428
Greece	10.18	10.42	8.64	352	3,491	4,971	8,814
Guatemala	10.44	9.87	8.47	20	180	470	670
Haiti	8.82	11.01	9.52	3	106	152	261
Honduras	8.49	9.70	8.74	23	71	598	693
Hong Kong, China	10.13	10.24	7.15	1,084	8,319	8,422	17,825
Hungary	10.47	10.31	6.44	366	5,325	3,280	8,971
Iceland	9.68	8.38	8.92	511	1,021	3,776	5,309
India	10.31	9.65	9.04	40	2,928	2,069	5,037
Indonesia	9.89	10.56	8.74	59	532	2,097	2,688
Iran, Islamic Republic	8.69	11.56	9.22	209	2,479	7,736	10,424
Iraq	7.12	9.36	9.81	24	1,827	2,758	4,609
Ireland	9.61	10.71	10.46	152	1,676	3,909	5,736
Israel	9.90	10.50	8.97	287	2,502	4,452	7,242
Italy	9.68	10.76	7.66	378	3,481	3,870	7,729
Jamaica	9.18	11.86	9.88	68	166	1,935	2,169
Japan	9.23	10.02	6.54	530	2,575	5,788	8,893
Jordan	8.75	11.82	10.26	127	907	2,534	3,568
Kazakhstan	10.18	9.52	8.72	131	3,598	10,387	14,117
Kenya	9.82	9.89	8.98	7	260	251	519
Korea, Dem. People's Rep.	8.53	7.66	8.55	1	589	3,770	4,360
Korea, Republic of	10.23	10.03	6.57	1,058	2,985	11,708	15,751
Kosovo	10.61	9.55	8.93	189	851	4,096	5,136
Kuwait	8.75	11.84	7.49	2,183	2,831	32,974	37,988
Kyrgyzstan	7.40	6.62	8.16	14	914	591	1,519
Latvia	8.27	9.29	8.13	301	10,626	3,592	14,519
Lebanon	8.68	11.57	9.23	354	1,670	6,665	8,689
Libya	8.75	11.84	10.12	231	649	7,359	8,239
Lithuania	9.16	10.80	8.98	285	10,674	3,479	14,439
Luxembourg	9.04	11.59	5.04	1,114	6,110	9,989	17,213
Macedonia, Republic of	9.92	8.97	8.00	229	2,131	4,158	6,518
Malaysia	9.52	10.62	7.93	338	463	7,097	7,898
Malta	8.78	11.84	6.74	656	3,855	4,884	9,395
Mexico	9.13	10.89	9.69	123	624	3,076	3,824
Moldova, Republic of	8.66	11.51	8.95	205	4,203	1,604	6,012
Mongolia	10.59	9.71	9.10	49	1,182	3,841	5,073
Montenegro	9.12	8.12	8.15	172	236	3,419	3,827
Morocco	9.76	10.43	10.46	42	1,016	1,662	2,721
Mozambique	7.24	6.33	9.67	-8	125	72	189
Myanmar	7.83	7.79	9.38	2	1,229	195	1,426
Namibia	7.29	6.39	9.69	-89	1,289	2,039	3,239
Nepal	7.24	6.33	7.33	1	1,231	123	1,356

Netherlands	9.93	11.29	9.30	389	4,374	6,205	10,969
Netherlands Antilles	7.59	9.19	6.28	98	227	11,882	12,208
New Zealand	9.43	9.00	9.52	267	342	5,336	5,945
Nicaragua	10.24	11.65	8.52	41	98	608	748
Nigeria	8.44	10.69	7.46	11	6,006	276	6,293
Norway	7.39	6.59	8.48	-19	4,522	7,859	12,363
Oman	8.75	11.84	9.76	473	13,306	13,865	27,644
Pakistan	8.41	10.03	9.02	21	2,615	752	3,388
Panama	8.12	8.84	8.17	82	125	1,855	2,062
Paraguay	7.24	6.33	6.60	25	455	541	1,021
Peru	8.09	8.81	8.44	34	433	1,684	2,151
Philippines	10.32	10.53	9.37	32	160	721	914
Poland	10.88	9.93	9.24	187	5,210	6,543	11,939
Portugal	10.52	10.60	9.90	216	3,332	3,524	7,071
Qatar	8.75	11.84	7.31	1,784	2,304	43,229	47,316
Romania	9.75	9.17	9.55	83	6,038	3,137	9,258
Russian Federation	9.12	10.14	10.28	214	9,687	10,102	20,003
Saudi Arabia	6.11	8.27	9.94	126	2,527	16,336	18,989
Senegal	8.63	11.22	9.66	12	2,371	366	2,749
Serbia	9.87	8.89	6.93	401	4,602	4,859	9,863
Singapore	8.81	11.74	6.35	1,033	1,105	2,702	4,841
Slovak Republic	10.24	9.36	8.22	227	4,882	4,629	9,738
Slovenia	10.02	8.85	7.94	323	4,003	6,532	10,859
South Africa	10.68	9.57	9.58	206	1,442	12,127	13,774
Spain	10.69	10.71	9.30	263	3,410	3,080	6,753
Sri Lanka	8.41	9.48	9.62	24	725	769	1,517
Sudan	7.61	7.69	9.68	1	2,429	209	2,639
Sweden	9.66	8.35	9.02	266	5,354	3,348	8,968
Switzerland	8.89	7.70	6.70	325	2,702	3,720	6,747
Syrian Arab Republic	8.63	11.40	10.10	67	907	2,417	3,391
Tajikistan	7.26	6.39	6.24	21	964	173	1,158
Tanzania, United Republic	8.03	9.10	8.31	6	201	146	352
Thailand	9.30	11.10	8.88	269	2,056	6,245	8,570
Togo	7.73	7.78	8.13	3	995	140	1,138
Trinidad and Tobago	8.75	11.84	7.75	782	762	45,828	47,373
Tunisia	8.80	11.84	10.15	140	1,072	2,963	4,176
Turkey	9.15	9.99	8.82	88	1,590	2,171	3,849
Turkmenistan	8.75	11.84	9.05	117	2,907	6,137	9,161
Ukraine	10.36	9.42	10.53	91	6,387	6,746	13,224
United Arab Emirates	8.75	11.84	7.97	1,712	3,194	29,219	34,126
United Kingdom	10.25	10.68	9.24	261	3,239	4,377	7,876
United States of America	10.19	10.00	9.62	304	1,425	7,434	9,164
Uruguay	8.50	8.58	9.67	62	999	1,841	2,902
Uzbekistan	8.54	10.67	8.99	64	1,481	2,202	3,748
Venezuela	7.72	8.06	8.28	64	216	5,264	5,544
Vietnam	8.71	9.71	9.28	57	939	2,024	3,019
Yemen	8.75	11.84	9.98	11	1,657	651	2,319
Zambia	7.24	6.34	8.24	-2	591	89	678
Zimbabwe	8.19	7.23	8.64	4	364	480	848
World total or average	9.68	9.73	8.86	113	2,597	3,241	5,951

- a) The 2013 LCOE cost of retail electricity for conventional fuels in each country combines the percentage mix of conventional electricity generators in 2013 with 2013 mean LCOEs for each generator from Table S33. Such costs include all-distance transmission, pipelines, and distribution (Section S6.3), but they exclude externalities.
- b) Same as (a), but for a 2050 BAU case and 2050 LCOEs for each generator from Table S33. The 2050 BAU case includes some existing WWS (mostly hydropower) plus future increases in WWS electricity in the BAU case and energy efficiency.
- c) The 2050 LCOE of WWS in the country combines the 2050 mix of WWS generators among all energy sectors from Table S8 with the 2050 mean LCOEs for each WWS generator from Table S33. The LCOEs of individual generators account for all-distance transmission and distribution.

- d) The 2050 average BAU retail electricity sectors cost savings per capita per year due to switching to WWS is calculated as the cost of electricity use in the electricity sector in the BAU case (the product of BAU electricity use and the 2050 BAU LCOE) less the annualized cost of the assumed efficiency improvements in the WWS case beyond BAU improvements and less the total cost of BAU retail electricity converted to WWS (product of WWS electricity use replacing BAU electricity and the 2050 WWS LCOE), all divided by 2050 population. (See Delucchi et al., 2016 for details.)
- e) Total cost of air pollution per year in the country from Table S36 divided by the 2050 population of the country.
- f) Total climate cost per year to the world due to country's emissions from Table S40 divided by the 2050 population of the country.
- g) The sum of columns (d), (e), and (f).

Section S7. Matching Electric Power Supply with Demand

An important requirement for 100% WWS roadmaps is that the grid remains reliable. To that end, Jacobson et al. (2015b) developed and applied a grid integration model (LOADMATCH) to determine the quantities and costs of storage devices needed to ensure that a 100% WWS system developed for each of the 48 contiguous United States could match load without loss when integrated every 30 s for 6 years (2050-2055) across all such states. The study accounted for the extreme variability and uncertainty of WWS resources.

In that study, wind and solar time-series were derived from 3-D GATOR-GCMOM (Jacobson et al., 2007; 2010a,b; Ten Hoeve et al., 2012) global model simulations that accounted for extreme events and competition among wind turbines for kinetic energy and the feedback of extracted solar radiation to roof and surface temperatures. Solutions were obtained by prioritizing storage for excess low-temperature heat (in underground rocks and water), cold (in water and ice), and electricity (in phase-change material tied to CSP, pumped hydro, hydropower, and hydrogen), and using demand response. Grid reliability was maintained even without demand response by increasing electricity generation, but at a slightly higher cost. No stationary storage batteries, biomass, nuclear power, or natural gas were needed.

In this study, we calculate the baseline numbers of generators of each type needed to power each country based on the 2050 annually-averaged WWS load in the country after all sectors have been electrified but before considering grid reliability and neglecting energy imports and exports. We then estimate the additional electricity and heat generators needed in each country to ensure a reliable electric power grid by region. Each of the 139 countries and the number of generators in each country is then allocated to one of 20 world regions. The same grid model used in Ref. (4) is then used to obtain low-cost, zero-load loss grid solutions for each grid region²⁸ following some minor updates to the numbers of generators.

In the follow-up grid integration study to the It uses wind and solar time-series at 30-s resolution from global model simulations that account for extreme events, competition among wind turbines for kinetic energy, and the feedback of extracted solar radiation to roof and surface temperatures. It also uses 1-hour load data for 128 countries and derived data for 11 countries but load shifts at 30-s intervals during the demand response calculation.

The model estimates the quantities and costs of storage devices needed to ensure that a 100% WWS system, when integrated across a region, matches load every 30 s for several years while accounting for the variability and uncertainty of WWS resources. It uses wind and solar time-series at 30-s resolution from global model simulations that account for extreme events, competition among wind turbines for kinetic energy, and the feedback of extracted solar

radiation to roof and surface temperatures. It also uses 1-hour load data for 128 countries and derived data for 11 countries but load shifts at 30-s intervals during the demand response calculation. Options for balancing supply and demand include the use of demand response to shave periods of excess demand over supply, storage for low-temperature heat (in rocks and water), cold (in ice and water), and electricity (in phase-change material tied to CSP, pumped hydro, and hydrogen), and hydropower⁴. All proposed storage options are existing technologies. In the application to 20 world regions, no stationary storage batteries, biomass, nuclear power, carbon capture, or natural gas were needed. Stationary batteries could be used but at a higher cost than other storage types.

The resulting total costs of delivered 100% WWS energy, including generation, storage, short- and long-distance transmission, distribution, and maintenance, are 10.7 (6.5-14) ¢/kWh-all-energy (USD 2013) and 9.8 (6.3-12.2) ¢/kWh-WWS-electricity across all 139 countries in all 20 regions²⁸.

The LOADMATCH grid integration model used in Jacobson et al. (2015b) was applied to the numbers of WWS generators of each type considered here for each country (summarized among all countries in Table S7) after separating the 139 countries among 20 world regions. Zero-load-loss solutions with LOADMATCH were obtained for each world region. The methodology and results are discussed in Jacobson et al. (2017). The 2050-2053 levelized energy costs among all 20 world regions was 10.7 (7.3-13.8) ¢/kWh-all-energy (USD 2013) and 9.8 (7.2-12.2) ¢/kWh-WWS-electricity. These costs accounted for generation, storage, short- and long-distance transmission, distribution, and maintenance. Around 0.8-1.3 ¢/kWh-all-energy was needed for storage, additional hydropower turbine capacity (without changing reservoir size), and producing/compressing/using hydrogen. Given the robust results of grid stability across all 20 world regions, we believe a 100% WWS system may be viable worldwide.

Section S8. Air Pollution and Global Warming Damage Costs Avoided by WWS

Conversion to a 100% WWS energy infrastructure in the 139 countries eliminates energy-related air pollution mortality, morbidity, and non-health environmental impacts and their associated costs. Conversion also eliminates energy-related climate change costs for individual countries and the world. This section discusses these topics.

S8.1. Air Pollution Cost Reductions due to WWS

The benefits of reducing air pollution mortality and its costs in each U.S. country are quantified here as follows.

First, the premature human mortality rate worldwide due to cardiovascular disease, respiratory disease, and complications from asthma arising from air pollution has been estimated previously by combining computer model estimates of human exposure to particulate matter (PM_{2.5}) and ozone (O₃) with the relative risk of mortality from these chemicals and population. Results suggest that an estimated 4-7 million people currently perish prematurely each year worldwide from outdoor plus indoor air pollution (e.g., Shindell et al., 2012; Anenberg et al., 2012; WHO, 2014a,b; Forouzanfar et al., 2015). These mortalities represent ~0.7-1.2% of the 570 million deaths/year worldwide in 2015. Here, modeled concentrations of PM_{2.5} and O₃ in each of 139 countries are combined with the relative risk of mortality as a function of concentration and with

population in a health-effects equation (e.g., Jacobson, 2010a) to estimate low, medium, and high mortalities due to PM_{2.5} and O₃ by country. Results are then extrapolated to 2050 while accounting for efficiencies and emission reductions that occur under the BAU scenario.

General method

Here we follow the health cost method of Jacobson et al. (2015a), with a new adjustment to the estimation of the value of statistical life (VOSL):

$$APcost_{C,Y} = N_{D,C,Y} \cdot V_{P/D,C,Y}$$

$$N_{D,C,Y} = N_{D,C,2010-12} \cdot \exp^{\Delta A_C \cdot (Y-2011)} \cdot \left(\frac{P_{C,Y}}{P_{C,2011}} \right)^\kappa$$

$$V_{P/D,C,Y} = V_{D,C,Y} \cdot F_1 \cdot F_2$$

where

$APcost_{C,Y}$ = The damage cost of fossil-fuel air pollution in country C year Y

$N_{D,C,Y}$ = The number of premature deaths D from air pollution in country C in year Y

$V_{P/D,C,Y}$ = The total cost of pollution per premature death in country C in year Y (includes mortality, morbidity, and non-health costs)

$N_{D,C,2010-12}$ = The number of premature deaths in country C over the period 2010-2012 (see discussion in the main text)

ΔA_C = The annual rate of change in the damage-weighted ambient pollution levels, in country C ; although it is possible to specify country-specific values, presently we assume the same values for all countries (Jacobson et al., 2015a):

<i>LCHB</i>	<i>Middle</i>	<i>HCLB</i>
-1.0%/yr	-1.5%/yr	-2.0%/yr

κ = The change in exposed population per change in population (Jacobson et al., 2015a):

<i>LCHB</i>	<i>Middle</i>	<i>HCLB</i>
1.14	1.11	1.08

$P_{C,Y}$ = The population in country C in year Y (see Appendix S3)

$V_{D,C,Y}$ = The value per death *per se* (VOSL) in country C in year Y (see discussion below)

F_1 = Adjustment factor that accounts for morbidity effects of air pollution, relative to the mortality effect (see F_2)

F_2 = Adjustment factor that accounts for the non-health effects of air pollution, relative to the mortality effect; assumed to be the same for all countries and years, as follows (based on Jacobson et al., 2015a):

	<i>LCHB</i>	<i>Middle</i>	<i>HCLB</i>
F_1	1.25	1.15	1.05
F_2	1.10	1.10	1.05

The value of statistical life (VOSL)

As Lindhjem and Navrud (2015) note, many analyses assume that the VOSL for country C can be calculated as a function of the VOSL for a reference country (e.g., the U.S.) and the GDP/capita for country C relative to the GDP/capita for the reference country, where GDP/capita is expressed in terms of Purchasing Power Parity (PPP). Lindhjem and Navrud's (2015) own meta-analysis indicate that this simple relationship can be a good approximation. We follow this approach, with two adjustments.

First, we assume that in the high-benefits case, a small portion of the VOSL is constant across all countries in terms of *utility*. This constant term represents the fraction of the VOSL that is independent of relative wealth, productivity, or consumption; i.e., the fraction that represents the cross-country constant utility of enjoying life and avoiding pain and suffering.

Second, we follow the findings of Milligan et al. (2014) and Hammit and Robinson (2011) and assume that the GDP/capita elasticity γ of the VOSL is itself a function of the relative GDP/capita (based on PPP).

Formally,

$$V_{D,C,Y} = V_{D,US,Y} \cdot \left(D + (1-D) \cdot (GDPC'_{C,TY})^{\gamma_{GDP,US,TY}} \cdot (GDPC'_{C,TY})^{\gamma_{GDP}} \right)$$

$$GDPC'_{C,TY} = \frac{GDPC_{C,TY}}{GDPC_{US,TY}}$$

$$\gamma_{GDP,US,TY} = \gamma_{GDP,US,BY} \cdot \left(\frac{GDPC_{US,TY}}{GDPC_{US,BY}} \right)^{\gamma_{GDP}}$$

where

Subscript BY = the base-year for the US data (2006)

D = The portion of the VOSL that is independent of GDP/capita (constant across all countries):

<i>LCHB</i>	<i>Middle</i>	<i>HCLB</i>
0.60	0.50	0.40

γ_{GDP} , $\gamma_{GDP,US,BY}$ = elasticity exponents (see discussion below)

Elasticity exponents

Jacobson et al. (2015a) review several estimates pertinent to $\gamma_{GDP,US,BY}$, and settle upon

	<i>LCHB</i>	<i>Middle</i>	<i>HCLB</i>
$\gamma_{GDP,US,BY}$	0.75	0.50	0.25

We adopt those values here. Analyses in Milligan et al. (2014) and Hammit and Robinson (2011) indicate that γ_{GDP} decreases with increasing GDP/capita, and can exceed 1.0 for relatively poor countries. Table S35 shows how our estimate of $\gamma_{GDP,US,TY}$ varies with different assumptions for γ_{GDP} , given the values above for $\gamma_{GDP,US,BY}$, at different values of GDPC'.

Table S35. Estimated GDP/capita elasticity of VOSSL as a function of relative GDP/capita (GDPC') and baseline elasticity parameters.

	LCHB	mid	HCLB	LCHB	mid	HCLB	LCHB	mid	HCLB
$\gamma_{GDP,US,BY}$	0.75	0.50	0.25	0.75	0.50	0.25	0.75	0.50	0.25
γ_{GDP}	-0.20	-0.20	-0.20	-0.17	-0.17	-0.17	-0.15	-0.15	-0.15
GDPC'									
0.05	1.37	0.91	0.46	1.25	0.83	0.42	1.18	0.78	0.39
0.10	1.19	0.79	0.40	1.11	0.74	0.37	1.06	0.71	0.35
0.33	0.93	0.62	0.31	0.90	0.60	0.30	0.88	0.59	0.29
0.50	0.86	0.57	0.29	0.84	0.56	0.28	0.83	0.55	0.28
0.80	0.78	0.52	0.26	0.78	0.52	0.26	0.78	0.52	0.26
1.00	0.75	0.50	0.25	0.75	0.50	0.25	0.75	0.50	0.25
1.50	0.69	0.46	0.23	0.70	0.47	0.23	0.71	0.47	0.24
2.00	0.65	0.44	0.22	0.67	0.44	0.22	0.68	0.45	0.23
2.50	0.62	0.42	0.21	0.64	0.43	0.21	0.65	0.44	0.22
3.00	0.60	0.40	0.20	0.62	0.41	0.21	0.64	0.42	0.21

Considering the results of Table S35, we think the following assumptions give results consistent with the findings of Milligan et al. (2014) and Hammit and Robinson (2011):

	<i>LCHB</i>	<i>Middle</i>	<i>HCLB</i>
γ_{GDP}	-0.15	-0.15	-0.15


Comparison of our premature mortality estimates with recent comprehensive estimates

We estimate 4.6 (1.3-8.0) million premature mortalities in the 139 countries averaged from 2010-2012 due to indoor and outdoor pollution related to the combustion of fossil fuels and biofuels. These are broken into premature mortalities due to PM_{2.5} of ~4.28 (1.19-7.56) million/yr, and those due to O₃ of ~279,000 (140,000-417,000)/yr. For all countries of the world, the total PM_{2.5}+O₃ premature mortality rate is ~4.97 (1.45-8.65) million/yr (Figure S12).

Recently, Forouzanfar et al. (2015) performed a comprehensive analysis and estimated 5.1 to 5.9 million deaths worldwide in 2013 from ambient and indoor pollution (2.8 to 3.1 million from ambient PM_{2.5} pollution, 0.2 to 0.3 million from ambient ozone pollution, and 2.5 to 3.3 million from indoor air pollution from solid fuel burning). This range is in the middle of our wider range.

A presentation based on the Forouzanfar et al. (2015) work estimated 1.6 million air-pollution premature mortalities in China and 1.4 million in India in 2013 (University of British Columbia, 2016). By comparison, we estimate 0.3 to 2.1 million in China and 0.3 to 1.7 million in India in 2011. The UBC (2016) presentation also projects that air pollution deaths in China will decline 19% to 38% by 2030. By comparison, our methods result in a decline of 15% to 30% by 2030.

Figure S12. Worldwide (all countries, including the 139 discussed in this paper) (a) PM_{2.5} and (b) O₃ premature mortalities averaged 2010-2012 as estimated with GATOR-GCMOM (Jacobson, 2010b), a 3-dimensional global computer model.

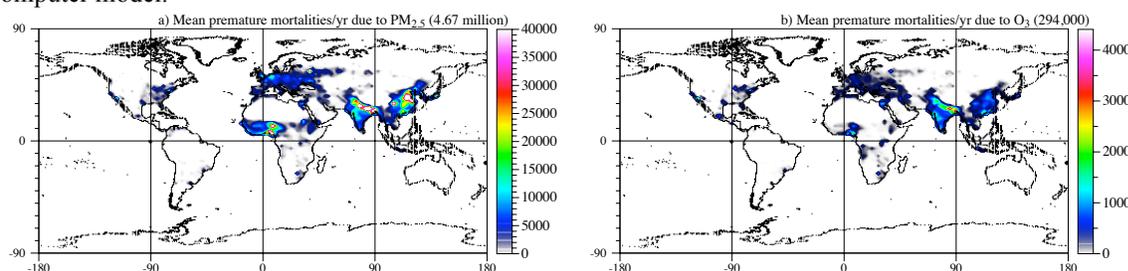

Premature mortalities by country in 2050

Table S36 shows estimated air pollution premature mortality and the cost avoided by country in 2050 due to replacing BAU with WWS, projected forward from the 2010-2012 average with the method just described. This method estimates future pollution from contemporary levels by considering an annual rate of pollution change that considers increasing emission controls and more sources over time. The number of premature mortalities in 2050 accounts for the growth of population by country and a nonlinear relationship between exposure and population. The resulting number of 2050 air pollution mortalities avoided in the 139 countries due to WWS is ~3.5 (0.84-7.4) million/yr.

Table S36. 2050 avoided air pollution PM_{2.5} plus ozone premature mortalities by country and corresponding mean avoided costs (in 2013 USD) arising from all air-pollution damage (mortalities, morbidities and non-air pollution effects).

Country	2050 High avoided premature mortalities /yr	2050 Mean avoided premature mortalities/yr	2050 Low avoided premature mortalities /yr	2050 Mean avoided cost (\$2013 mil./yr)	2050 Mean avoided cost as percent of 2050 GDP	2050 Mean avoided cost (\$2013) ¢/kWh-BAU-

						all- energy
Albania	1,215	546	142	4,384	4.1	12.2
Algeria	16,794	7,546	1,899	51,964	4.0	4.1
Angola	47,748	20,588	4,928	96,206	12.5	36.8
Argentina	19,973	8,462	1,815	68,017	3.4	4.7
Armenia	2,751	1,230	298	8,610	9.7	20.1
Australia	4,966	2,073	447	23,449	1.2	1.3
Austria	6,163	2,718	639	31,540	5.7	7.1
Azerbaijan	8,646	3,867	922	38,636	6.3	22.7
Bahrain	1,133	549	135	6,615	4.5	4.9
Bangladesh	280,467	130,598	30,780	419,857	16.0	67.6
Belarus	15,555	7,055	1,605	70,348	16.5	19.6
Belgium	8,940	3,899	866	44,072	6.4	7.4
Benin	36,830	18,606	4,622	36,443	27.1	46.0
Bolivia	4,054	1,706	365	6,997	3.1	5.0
Bosnia and Herzegovina	2,203	973	237	7,683	5.4	13.3
Botswana	1,081	464	108	3,320	3.7	6.4
Brazil	37,924	15,954	3,480	112,642	1.4	2.3
Brunei Darussalam	26	11	2	158	0.2	0.3
Bulgaria	5,530	2,468	586	24,826	9.6	12.7
Cambodia	9,631	4,162	967	13,789	5.7	12.8
Cameroon	49,217	23,873	5,712	62,971	21.6	28.3
Canada	22,895	9,884	2,251	110,116	3.9	3.2
Chile	7,143	3,079	672	28,676	3.0	4.2
China	1,380,050	638,165	148,273	6,166,179	9.1	13.0
Chinese Taipei	13,939	6,236	1,481	97,232	3.4	6.6
Colombia	4,969	2,074	447	12,812	0.9	2.2
Congo	5,259	2,269	521	9,688	6.8	23.6
Congo, Dem. Republic	79,577	34,549	7,880	28,367	7.2	7.4
Costa Rica	295	126	30	827	0.5	1.2
Cote d'Ivoire	9,343	3,879	817	11,100	3.3	7.8
Croatia	3,430	1,515	362	16,488	6.6	13.1
Cuba	1,496	659	167	5,062	1.6	4.9
Cyprus	870	388	96	4,942	4.0	13.4
Czech Republic	9,619	4,263	973	42,064	9.1	11.1
Denmark	5,184	2,262	509	26,130	6.4	11.1
Dominican Republic	1,673	736	190	4,622	1.3	4.2
Ecuador	2,275	963	217	5,347	1.2	2.3
Egypt	89,901	41,491	10,136	243,256	7.7	13.0
El Salvador	466	207	54	973	0.9	2.0
Eritrea	9,948	4,587	1,059	7,133	13.0	72.7
Estonia	1,454	659	150	6,216	14.5	12.0
Ethiopia	182,850	78,819	17,493	124,909	9.1	20.0
Finland	6,093	2,712	603	29,883	9.3	7.9
France	46,399	20,258	4,660	219,990	4.9	9.4
Gabon	1,136	477	103	3,837	3.2	7.8
Georgia	3,536	1,582	384	11,913	9.3	21.1
Germany	70,669	30,984	7,011	360,057	6.8	10.8
Ghana	53,822	26,807	6,568	87,183	20.4	52.6
Gibraltar	41	18	4	226	9.9	0.4
Greece	8,707	3,869	951	35,037	7.6	11.3
Guatemala	2,151	940	242	4,139	1.2	3.2
Haiti	2,140	943	246	1,420	2.3	3.6
Honduras	647	275	65	925	0.6	1.3
Hong Kong, China	8,102	3,763	893	51,353	8.0	7.6
Hungary	11,253	5,005	1,151	45,206	11.6	19.0
Iceland	72	31	8	358	1.4	0.9
India	1,667,221	805,227	195,433	4,849,682	12.2	32.4

Indonesia	58,638	25,086	5,737	166,408	1.9	4.4
Iran, Islamic Republic	68,163	31,322	7,629	248,052	6.8	6.5
Iraq	31,140	14,277	3,566	102,864	5.8	19.4
Ireland	2,011	856	194	10,613	2.0	7.2
Israel	5,897	2,674	653	27,094	4.4	11.3
Italy	46,543	20,577	5,071	213,785	5.9	10.1
Jamaica	269	121	34	588	0.9	1.6
Japan	66,670	28,854	6,486	276,019	5.1	7.7
Jordan	3,693	1,671	415	10,199	3.7	7.9
Kazakhstan	15,580	6,844	1,593	80,019	4.8	8.0
Kenya	16,653	7,052	1,585	18,427	3.1	6.7
Korea, Dem. People's Rep.	20,159	8,931	1,998	15,877	10.7	5.6
Korea, Republic of	27,728	12,249	2,724	129,449	4.9	4.5
Kosovo	340	240	138	1,321	4.1	5.1
Kuwait	1,641	777	192	10,938	2.5	2.1
Kyrgyzstan	4,073	1,795	429	7,531	6.3	11.5
Latvia	3,137	1,445	333	16,407	15.1	21.2
Lebanon	2,196	997	249	6,941	5.6	7.0
Libya	2,345	1,044	267	7,052	2.3	2.2
Lithuania	5,350	2,466	567	29,760	13.4	28.9
Luxembourg	668	288	64	4,405	4.5	7.8
Macedonia, Republic of	1,085	480	120	4,244	4.8	12.0
Malaysia	4,500	1,956	490	19,873	0.8	1.4
Malta	271	122	31	1,526	4.5	4.9
Mexico	25,972	11,377	2,807	92,359	1.6	3.2
Moldova, Republic of	3,911	1,794	416	9,502	21.1	24.8
Mongolia	1,677	734	175	5,131	3.9	6.5
Montenegro	34	14	3	136	0.5	1.0
Morocco	19,572	8,821	2,160	42,718	5.8	10.8
Mozambique	14,734	6,128	1,375	7,399	3.3	4.0
Myanmar	50,932	22,334	5,079	86,829	9.3	29.5
Namibia	1,104	485	117	2,772	5.8	6.9
Nepal	46,833	21,851	5,150	56,608	15.0	31.4
Netherlands	15,212	6,605	1,460	78,332	5.7	7.8
Netherlands Antilles	24	10	2	87	0.5	0.1
New Zealand	364	153	35	1,778	0.5	0.7
Nicaragua	388	165	39	710	0.7	2.0
Nigeria	984,287	514,900	132,376	2,416,900	35.6	106.0
Norway	3,812	1,671	388	22,459	4.5	5.5
Oman	13,105	6,473	1,592	71,879	19.7	15.0
Pakistan	361,391	180,243	44,816	760,604	17.8	42.2
Panama	179	77	19	606	0.3	0.4
Paraguay	1,936	821	181	4,023	2.5	5.3
Peru	6,547	2,744	583	15,985	1.9	4.5
Philippines	12,164	5,193	1,238	27,531	0.8	4.1
Poland	40,992	18,382	4,180	167,156	11.2	16.0
Portugal	8,016	3,523	825	33,095	6.8	12.8
Qatar	671	334	83	5,896	1.2	1.0
Romania	22,747	10,121	2,337	109,044	9.5	24.5
Russian Federation	225,543	102,559	23,534	1,057,711	16.6	16.6
Saudi Arabia	16,860	8,026	1,957	101,706	2.9	3.4
Senegal	53,610	29,530	7,857	64,585	34.7	93.9
Serbia	6,873	3,039	726	27,011	10.3	16.3
Singapore	1,385	606	155	9,517	0.8	0.5
Slovak Republic	5,720	2,539	582	24,135	9.7	12.5
Slovenia	1,481	656	159	6,393	7.6	9.0
South Africa	25,497	10,955	2,467	71,219	5.4	3.3
Spain	39,487	17,402	4,163	179,009	5.9	12.1
Sri Lanka	6,179	2,661	622	18,237	2.5	7.7

Sudan	151,527	72,899	17,302	236,027	23.0	97.7
Sweden	9,420	4,140	932	48,640	7.1	9.2
Switzerland	3,535	1,555	383	19,712	3.0	6.2
Syrian Arab Republic	13,329	6,019	1,506	30,515	4.8	14.1
Tajikistan	7,088	3,189	768	11,695	7.8	38.2
Tanzania, United Republic	13,575	5,715	1,283	13,413	2.7	3.5
Thailand	40,325	17,709	4,100	143,145	5.4	5.8
Togo	22,400	11,403	2,840	16,503	22.0	38.0
Trinidad and Tobago	196	83	18	781	1.5	0.5
Tunisia	4,860	2,173	548	13,063	4.5	3.5
Turkey	45,007	20,054	4,995	160,548	4.3	13.0
Turkmenistan	4,427	1,984	475	19,204	5.6	5.4
Ukraine	69,690	31,576	7,261	214,452	22.3	16.5
United Arab Emirates	3,548	1,829	466	25,616	2.9	1.5
United Kingdom	48,833	20,910	4,542	230,441	4.9	10.5
United States of America	103,679	45,761	11,734	602,239	1.5	2.9
Uruguay	1,073	452	97	3,491	2.8	4.6
Uzbekistan	19,721	8,899	2,122	52,016	6.5	8.1
Venezuela	3,035	1,278	291	8,712	0.8	0.8
Vietnam	49,906	22,169	5,259	104,382	5.5	9.1
Yemen	47,561	22,541	5,404	75,875	15.0	83.2
Zambia	17,437	7,397	1,748	22,664	6.0	15.2
Zimbabwe	12,550	5,334	1,248	9,168	6.8	4.6
All-country sum/average	7,376,181	3,487,163	838,205	22,836,625	7.6	12.7

High, medium, and low estimates of premature mortalities in each country in 2050 are estimated by combining computer-modeled changes in PM_{2.5} and ozone averaged from 2010-2012 due to anthropogenic sources in each country (Figure S12) with low, medium, and high relative risks and country population, as in Jacobson (2010a). 2010-2012-averaged premature mortalities are then extrapolated forward to 2050 as described in this section. Human exposure is based on daily-averaged PM_{2.5} exposure and 8-hr maximum ozone each day. Relative risks for long-term health impacts of PM_{2.5} and ozone are as in Jacobson (2010a). However, the relative risks of PM_{2.5} from Pope et al. (2002) are applied to all ages as in Lepeule et al. (2012) rather than to those over 30 years old as in Pope et al. (2002). The threshold for PM_{2.5} is zero but concentrations below 8 µg/m³ are down-weighted as in Jacobson (2010a). The low ambient concentration threshold for ozone premature mortality is assumed to be 35 ppbv. Air pollution costs are determined as described in this section.

Overall air pollution cost in the BAU case (or avoided air pollution cost in the WWS case)

The total damage cost of air pollution due to conventional fuels (fossil fuel and biofuel combustion and evaporative emissions) in a country is the sum of mortality costs, morbidity costs, and non-health costs such as lost visibility and agricultural output in the country. The mortality cost equals the number of mortalities in the country multiplied by the value of statistical life (VSL). The methodology for determining the VSL by country is described earlier in this section. The morbidity plus non-health cost per country is estimated as the mortality cost multiplied by the ratio of the value of total air-pollution damages (mortality plus morbidity plus other non-health damages) to mortality costs alone, also described earlier. The result of the calculation is that the 139-country avoided cost of air pollution in 2050 is ~\$23 (\$4.0-\$69) trillion/yr in 2013 USD, equivalent to ~7.6 (1.4-23) percent of the 2050 139-country gross domestic product on a purchasing power parity (PPP) basis, or ~12.7 (2.3-38) ¢/kWh-BAU-all-energy.

S8.2. Global-Warming Damage Costs Avoided With 100% WWS in Each Country

This section provides estimates of climate change avoided costs due to eliminating greenhouse gas (GHG) emissions from energy use (Table S40). GHG emissions are defined here to include a wide range of pollutants (see subsection "Pollutants/GHG" below), with all emissions converted

to that of CO₂ that causes an equivalent amount of climate-change damage. A 100% WWS system in each country will eliminate such damages. The cost calculated is the cost of climate change impacts to the world *attributable to* emissions of GHGs from each country.

Costs of climate change include coastal flood and real estate damage costs, agricultural loss costs, energy-sector costs, water costs, health costs due to heat stress and heat stroke, influenza and malaria costs, famine costs, ocean acidification costs, increased drought and wildfire costs, severe weather costs, and increased air pollution health costs. These costs are partly offset by fewer extreme cold events and associated reductions in illnesses and mortalities and gains in agriculture in some regions. (We don't estimate all of these effects individually, but rather use overall damage factors, in dollars per unit of CO₂-equivalent emissions, that include most of these effects.)

The cost of climate-change impacts attributable to each country's GHG emissions is the product of three factors: 1) estimated CO₂ combustion emissions from energy use; 2) the ratio of total lifecycle (LC) CO₂-equivalent (CO₂e) GHG emissions to lifecycle CO₂ combustion emissions; and 3) the damage cost per unit of CO₂e emission. All three factors can vary over time.

The main challenge here is in calculating climate-change damage costs attributable to each country's GHG emissions. Here, we calculate this formally as

$$CC_{GHG,C,Y} = EM_{GHG,C,Y} \cdot D_{GHG,Y}$$

$$EM_{GHG,C,Y} = EM_{CO_2,C,Y^*} \cdot \frac{EM_{GHG,R:CeR,Y}}{E_{CO_2,R:CeR,Y^*}}$$

$$EM_{CO_2,R:CeR,Y^*} = \sum_i EM_{i,CO_2,R:CeR,Y}$$

$$EM_{i,CO_2,R:CeR,Y} = \left[\begin{array}{l} Y \leq 2040 : \text{EIA (2016a)} \\ Y > 2040 : EMI_{i,CO_2,R:CeR,Y>2040} \cdot E_{i,R:CeR,Y>2040} \end{array} \right]$$

$$E_{i,R:CeR,Y>2040} = \left[\text{trend}(10\text{yr}) : E_{i,R:CeR,Y \leq 2040} \right]$$

$$EMI_{i,CO_2,R:CeR,Y>2040} = \left[\text{trend}(10\text{yr}) : \frac{EM_{i,CO_2,R:CeR,Y \leq 2040}}{E_{i,R:CeR,Y \leq 2040}} \right]$$

$$EM_{GHG,R:C \in R,Y} = \sum_i EM_{i,CO_2,R:C \in R,Y} \cdot \frac{EM_{i,LC-CO_2e,Y}}{EM_{i,LC-CO_2-EN,Y}}$$

$$D_{GHG,Y} = D^{\wedge}_{GHG,Y^{\wedge}} \cdot \exp^{d(Y-Y^{\wedge})} \cdot \frac{P_{GDP-IPD,Y'}}{P_{GDP-IPD,Y\#}}$$

where

$CC_{GHG,C,Y}$ = Global climate-change damages attributable to energy-related, lifecycle, CO₂-equivalent (LC-CO₂e) GHG emissions from country C in year Y (\$)

$EM_{GHG,C,Y}$ = Emissions of LC-CO₂e GHGs from country C in year Y (metric-tons)

$D_{GHG,Y}$ = The year- Y present worth of climate change damages per unit of CO₂e-GHG emission in year Y (\$/metric-ton-GHG)

EM_{CO_2,C,Y^*} = Emissions of CO₂ from energy use (fuel combustion) in country C in base year Y^* (metric tons) (World Bank, 2013, estimates for 2013)

$EM_{GHG,R:C \in R,Y}$ = LC-CO₂e GHG emissions from world region R (containing country C) in year Y (metric-tons)

$EM_{CO_2,R:C \in R,Y^*}$ = Emissions of CO₂ from energy use (fuel combustion) in region R in base year Y^* (metric-tons)

$EM_{i,CO_2,R:C \in R,Y \leq 2040}$ = Energy-related emissions of CO₂ from use of fuel i in region R in year $Y \leq 2040$ (metric-tons) (EIA, 2016a)

$EMI_{i,CO_2,R:C \in R,Y > 2040}$ = CO₂-emissions intensity of fuel i in region R for $Y > 2040$ (metric-tons CO₂ per energy unit of fuel i)

$E_{i,R:C \in R,Y > 2040}$ = Energy use of fuel i in region R for $Y > 2040$

$E_{i,R:C \in R,Y \leq 2040}$ = Energy use of fuel i in region R for $Y \leq 2040$ (EIA, 2016a; see discussion above)

$trend(10yr)$ = 10-year average moving linear extrapolation

$\frac{EM_{i,GHG,Y}}{EM_{i,LC-CO_2-EN,Y}}$ = The ratio LC-CO₂e GHG emissions from fuel i to life-cycle combustion emissions of CO₂ from fuel i , in target year Y (see discussion below)

$D^{\wedge}_{GHG,Y^{\wedge}}$ = Reference global climate-change damages in year Y^{\wedge} per unit of GHG emission in year Y^{\wedge} (\$/metric-ton) (see discussion below)

d = The rate of growth over time of damages per unit of GHG emissions (see discussion below)

Y^{\wedge} = The reference year of estimates of damages per unit of CO₂e emission (see discussion below)

Y' = Designated price year (2013 here, but can be any date for which the GDP implicit price deflator is known)

$\frac{P_{GDP-IPD,Y'}}{P_{GDP-IPD,Y\#}}$ = The ratio of prices in our designated price year Y' to prices in the price-year $Y\#$ of the reference CO₂ damage-cost analysis (calculated using GDP implicit price deflators)

Subscripts:

GHG = Lifecycle CO₂-equivalent emissions of all greenhouse gases

CO_2 = Carbon dioxide per se (as distinguished from other GHGs, or the CO₂-equivalent of GHGs)

Y^* = The base year of World Bank CO₂ emissions data (2013)

R = Regions of the world in the EIA's *IEO* (see discussion above)

LC = Lifecycle of a fuel from feedstock production through end use

i = Fuels for which the EIA estimates CO₂ emissions (liquids, natural gas, coal)

GDP-IPD = GDP implicit price deflator

When we say "climate change damages in year Y," we mean "the year-Y present worth of the future stream of damages from emissions in year Y."

Lifecycle CO₂e emissions of all GHGs from all sources relative to those from energy use

The EIA projects CO₂ emissions from the combustion of liquids, natural gas, and coal in 16 regions of the world from 2010 to 2040. However, the use of fossil fuels also produces a range of GHGs other than CO₂ and a small amount of CO₂ from non-combustion processes. To account fully for the climate impact of all GHG and warming aerosol particle emissions associated with fossil-fuel energy use, we use the Lifecycle Emissions Model (LEM) (Delucchi et al., 2003, and unpublished updates) to estimate the ratio of lifecycle CO₂e GHG and particle emissions to lifecycle combustion-CO₂ emissions for coal, oil, and natural gas. The LEM calculates emissions of greenhouse gases and urban air pollutants over the complete lifecycle of fuels, materials, vehicles, and infrastructure for the use of transportation fuels and electricity, accounting for the following:

Lifecycle stages

Electricity end use; electricity transmission and distribution; electricity generation; transportation of electricity-generation feedstocks (e.g., coal); and production of electricity generation feedstocks.

Sources of emissions

Combustion of fuels; evaporation or leakage of energy feedstocks or finished fuels; venting, leaking or flaring of gas mixtures (e.g., venting of coal bed gas from coal mines); fugitive dust emissions; and chemical transformations that are not associated with burning process fuels (for example, the scrubbing of sulfur oxides from the flue gas of coal-fired power plants).

Pollutants/GHGs

Carbon dioxide (CO ₂)	Particulate-matter (PM) combustion, black carbon (BC)
Carbon in (in NMOC, CO, CH ₄ , soil)	PM combustion, organic matter (OM)

Nonmethane organic compounds (NMOCs) (weighted by O ₃ formation potential)	PM combustion, dust-like
Methane (CH ₄)	PM all else
Carbon monoxide (CO)	PM non-combustion, dust
Nitrous oxide (N ₂ O)	Hydrogen (H ₂)
Nitrogen oxides (NO ₂)	Sodium hexafluoride (SF ₆)
Sulfur oxides (SO ₂)	Chlorofluorocarbons (CFC-12)
Ammonia (NH ₃)	Hydrofluorocarbons (HFC-134a)

The LEM estimates emissions of each pollutant individually, and also converts all of the pollutants into CO₂-equivalent greenhouse-gas emissions. To calculate total CO₂-equivalent emissions, the model uses internally developed CO₂-equivalency factors (CEFs) that convert mass emissions of all of the non- CO₂ gases into the mass amount of CO₂ with the equivalent present worth of damages from climate change.

For this study, we first use the LEM to calculate two quantities for each year from 2011 to 2050 (the last year of data in the LEM): #1) total lifecycle CO₂e emissions of GHGs from generic coal, oil, and natural-gas use; and #2) lifecycle combustion emissions of CO₂ from generic coal, oil, and natural-gas use. (In the LEM, CO₂ equivalency is calculated nominally on the basis of damages, not radiative forcing.) For generic coal we use the lifecycle of coal for electricity generation; for generic liquids we used the average of the lifecycle of oil for gasoline and oil for distillate fuel; and for generic natural gas we use the lifecycle of natural gas for commercial heating. The ratio of quantity #1 to quantity #2 is the parameter $\frac{E_{i,LC-CO_2e,Y}}{E_{i,LC-CO_2-EN,Y}}$. The resultant LEM-calculated ratios for 5-year intervals from 2011 to 2050 are shown in Table S37.

Table S37. Ratio of CO₂e to CO₂ emissions, United States.

	2011	2015	2020	2025	2030	2035	2040	2045	2050
Petroleum	1.21	1.11	1.11	1.11	1.11	1.09	1.09	1.09	1.09
Natural Gas	1.43	1.44	1.44	1.43	1.43	1.42	1.41	1.40	1.39
Coal	0.81	0.88	0.94	0.97	1.00	1.01	1.02	1.02	1.02

We then extend the results of Table S37 to 2075 using a 10-year moving linear extrapolation. We assume that the ratios in Table S37, derived for the U.S., apply to all regions of the world.

The ratio for petroleum decreases as black-carbon emissions from vehicles and fuel-cycle methane emissions decrease over time. The ratio for coal is less than one until the year 2030 because of the negative forcing caused by sulfur oxide and nitrogen oxide emissions from coal power plants. As these emissions decline with improved emission controls over time, the negative forcing decreases and the ratio increases.

Damage costs per unit CO₂e GHG emission

Several studies, including some important recent meta-analyses, estimate the damage cost of CO₂e GHG emissions, often referred to as the Social Cost of Carbon (SCC) (Table S38). Most studies recognize, even if only informally or qualitatively, that there is some non-trivial possibility of severe impacts of climate change and a correspondingly very high SCC. The main point of contention is the plausible lower bound on the SCC. Although the Interagency Working Group on Social Cost of Greenhouse Gases (2016) recommends a central value of only \$31/metric-ton-CO₂ (year 2007 dollars, year 2010 emissions, 3% discount rate), we agree with a recent commentary by a group of distinguished economists and scientists: “the bulk of the literature and arguments indicates that social-cost models are underestimating climate-change harms” (Revesz et al., 2014, p. 175)

As shown in Table S38, the widely referenced FUND and DICE models estimate very small lower-bound estimates under some sets of assumptions regarding discount rates, risk aversion, equity weighting, extreme impacts, uncertainty, and other factors. However, in a recent review and meta-analysis, van den Bergh and Botzen’s (2014) argue against the assumptions that lead to the lowest estimates of SCC, and make a persuasive case that the *lower* bound of the SCC should not be less than \$125/tonne-CO₂. They conclude that “the lower bound...of U.S. 125 per tCO₂ is far below various estimates found in the literature that attribute a high weight to potentially large climate change impacts...[and} therefore can be considered a realistic and conservative value” (p. 256). In support of this, Moore and Diaz (2015), in another recent re-analysis of the SCC, find that incorporating the effect of climate change on the rate of economic growth – a feedback typically not included in standard low-end estimates of the SCC – can dramatically increase the SCC to hundreds of dollars per ton and higher (Table S38). Similarly, Burke et al. (2015) find that accounting for the long-run, non-linear effects of temperature increases on economic productivity results in overall estimates of climate change damages that are 2.5 to 100 times higher than the estimates produced by IAMs such as PAGE, FUND, and DICE.

Table S38. Studies of the Social Cost of Carbon (SCC).

Authors	Moore and Diaz (2015)			Ackerman and Stanton (2012)			van den Bergh and Botzen (2014)			Johnson and Hope (2012)			Howarth et al. (2014)			Antoff et al. (2011)			Tol (2010)			
Model	gro-DICE			DICE			meta-analysis			DICE			IAM using DICE			FUND			FUND			
Emission year	2015-2100			2010, 2050			near term?			2010			2010			2010-2019			2010?			
Dollar year	2005			2007			2010?			2007			2005			1995			1995			
	<i>Low</i>	<i>Mid</i>	<i>High</i>	<i>Low</i>	<i>Mid</i>	<i>High</i>	<i>Low</i>	<i>Mid</i>	<i>High</i>	<i>Low</i>	<i>Mid</i>	<i>High</i>	<i>Low</i>	<i>Mid</i>	<i>High</i>	<i>Low</i>	<i>Mid</i>	<i>High</i>	<i>Low</i>	<i>Mid</i>	<i>High</i>	
World SCC (\$/tonne-CO ₂)	~200		1000+	~45, ~100	~230, ~430	~890, ~1520	125	--	--	-1	145	--	10	--	>500	0.5	10	~180	~0	1.3	11	
Discount rate (DR)	n.r.	n.r.	n.r.	3%	1.5% or 3%	1.5%	avg.	--	--	5%	2.5%	--	n.r.	--	n.r.	n.r.	n.r.	n.r.	n.r.	n.r.	n.r.	n.r.
Pure rate of time preference	3%	1.5%	0.1%	n.r.	n.r.	n.r.	n.r.	--	--	3.2%	1.1%	--	1.5%	--	1.5%	3%	1%	0.1%	3%	1%	0%	
Equity weighting?	no	no	no	n.r.	n.r.	n.r.	no?	--	--	no	yes	--	no?	--	no?	no	no	ave.*	no	no	yes	
Risk aversion rate	no?	no?	no?	n.r.	n.r.	n.r.	n.r.	--	--	no	no	--	2.0	--	5.6	no	no	no	1.5	1.5	15	
Extreme climate impacts?	part.			no	part.	yes	part.	--	--	no	no	--	no (thin tail)	--	yes (fat tail)	no	no	no	no	no	no	
U.S. % of world SCC	n.r.			n.r.			n.r.			n.r.			n.r.			33%	13%	< 10%	n.r.	8.5%	n.r.	
Remarks	Authors did not estimate explicit low, mid, and high values, but rather estimated the importance of including feedbacks between climate change and the rate of economic growth.			SCC estimated as a function of the DR, climate sensitivity (CS), and form of damage function (DF). Our mid case includes all combos of DR, CS, and DF except low-low (our low) and high-high (our high).			SCC is equal to \$41/tonne – the average reported in a meta-analysis – plus the average of separate “surcharges” for uncertainty, extreme damages, and risk aversion.			Authors did not analyze what would be a “high” cost case (a low rate of time preference with equity weights).			With high risk aversion rate, SCC decreases with increasing emission control rate (ECR): when ECR > 40%, SCC <10.			SCC is higher with U.S.-based equity weights than with global equity weights. (*= global equity weights)			High estimates are based on “illustrative” parameter values.			

Another justification for the higher estimates of the SCC is that people lower-income countries suffer disproportionate damage due to their lesser ability to afford adaptation measures that should be weighted more heavily. Harrington et al. (2016) find that the given global emissions patterns, the lowest-income countries experience daily temperature extremes due to climate change earlier than do higher-income countries. As Green (2016) notes in the title of her review of Harrington et al. (2016), this means that “the spatial distribution of extreme climate events [is] another climate inequity for the world’s most vulnerable people.” This inequity can be accounted for in estimates of the SCC by formalizing the standard economic assumption that a dollar’s worth of damages to a poor person causes a greater loss of utility than does a dollar’s worth of damage to a rich person. The resultant “equity weighting” increases estimates of the SCC (Anthoff et al., 2009).

The SCC of emissions in a given year is also likely to increase over time as atmospheric GHG levels, and average temperatures increase (Ackerman and Stanton, 2012; Moore and Diaz, 2015). The Ackerman and Stanton (2012) estimates shown in Table S38 increase from 2010 to 2050 at 2.0%/year in the low-SCC case, 1.6%/year in the mid-SCC case, and 1.4%/year in the high-SCC case. The Interagency Working Group on Social Costs of Greenhouse Gases (2016) also estimates that the SCC doubles in 30-40 years, implying a growth rate of about 2%/year.

Van den Bergh and Botzen (2015), Pindyck (2013), and Stern (2013) provide critical reviews of the main models used to generate estimates of the SCC. On the basis of these estimates in Table S38 and the discussion above, we assume and calculate the values shown in Table S39.

Table S39. Assumptions (A) for and calculations (C) of the social cost of carbon (\$/metric-tonne-CO₂e)

	<i>LCHB</i>	<i>Medium</i>	<i>HCLB</i>
Global SCC in 2010 (2007-\$) (A)	600	250	125
Annual change in SCC (A)	1.2%	1.5%	1.8%
Global SCC in 2050 (2013-\$) (C)	1,063	500	282

Note that a high value of the SCC results in higher benefits for the 100% WWS scenario. However, if the SCC is at its high value in 2010, then a numerically high annual rate of change results in unreasonably high values in the future. Hence the high starting value of the SCC is paired with the low rate of change. The numbers in Table S39 give a range of 2050 social cost of carbon as \$500 (282-1,063)/metric tonne-CO₂e in 2013 USD. This range is used to derive the costs in Table S40.

Table S40. Percent of 2013 world CO₂ emissions by country (GCP, 2014) and low, medium, and high estimates of avoided 2050 global climate-change costs due to converting each country to 100% WWS purposes. All costs are in 2013 USD.

Country	2013 Percent of world CO ₂ emissions	2050 avoided global climate cost (\$2013)			
		Low cost, high benefit (\$bil./yr)	Mean (\$bil./yr)	High cost, low benefit (\$bil./yr)	Mean ¢/kWh- BAU-all- energy
Albania	0.014	7.4	3.5	2.0	9.7

Algeria	0.419	407.2	191.3	107.9	15.1
Angola	0.092	89.0	41.8	23.6	16.0
Argentina	0.577	401.9	188.8	106.4	13.0
Armenia	0.012	6.4	3.0	1.7	7.0
Australia	1.000	621.9	292.2	164.7	15.7
Austria	0.184	89.9	42.2	23.8	9.5
Azerbaijan	0.154	83.9	39.4	22.2	23.2
Bahrain	0.073	67.2	31.6	17.8	23.4
Bangladesh	0.191	184.0	86.4	48.7	13.9
Belarus	0.183	99.8	46.9	26.4	13.1
Belgium	0.290	142.0	66.7	37.6	11.2
Benin	0.016	15.5	7.3	4.1	9.2
Bolivia	0.054	37.5	17.6	9.9	12.5
Bosnia and Herzegovina	0.094	51.0	24.0	13.5	41.6
Botswana	0.015	14.7	6.9	3.9	13.3
Brazil	1.413	1028.7	483.3	272.4	10.0
Brunei Darussalam	0.031	29.8	14.0	7.9	25.7
Bulgaria	0.122	66.3	31.1	17.6	15.9
Cambodia	0.014	13.9	6.5	3.7	6.1
Cameroon	0.022	21.6	10.1	5.7	4.6
Canada	1.476	842.9	396.0	223.2	11.6
Chile	0.262	185.7	87.3	49.2	12.8
China	29.265	15300.6	7188.1	4052.3	15.2
Chinese Taipei	0.776	748.4	351.6	198.2	24.0
Colombia	0.259	180.3	84.7	47.8	14.3
Congo	0.007	6.7	3.1	1.8	7.6
Congo, Dem. Republic	0.009	8.6	4.0	2.3	1.1
Costa Rica	0.023	16.1	7.6	4.3	11.2
Cote d'Ivoire	0.018	17.5	8.2	4.6	5.8
Croatia	0.060	32.8	15.4	8.7	12.3
Cuba	0.116	80.4	37.8	21.3	36.9
Cyprus	0.022	12.2	5.7	3.2	15.6
Czech Republic	0.296	144.7	68.0	38.3	17.9
Denmark	0.118	57.6	27.1	15.3	11.5
Dominican Republic	0.064	44.6	21.0	11.8	19.0
Ecuador	0.107	74.3	34.9	19.7	14.7
Egypt	0.629	610.9	287.0	161.8	15.3
El Salvador	0.018	12.9	6.0	3.4	12.7
Eritrea	0.002	1.8	0.8	0.5	8.5
Estonia	0.055	27.0	12.7	7.1	24.6
Ethiopia	0.020	19.3	9.1	5.1	1.4
Finland	0.148	72.4	34.0	19.2	8.9
France	1.009	493.4	231.8	130.7	9.9
Gabon	0.008	7.7	3.6	2.1	7.3
Georgia	0.018	9.8	4.6	2.6	8.1
Germany	2.225	1088.3	511.3	288.2	15.4
Ghana	0.029	27.8	13.1	7.4	7.9
Gibraltar	0.001	0.7	0.3	0.2	0.6
Greece	0.217	106.2	49.9	28.1	16.0
Guatemala	0.033	23.0	10.8	6.1	8.2
Haiti	0.006	4.3	2.0	1.1	5.2
Honduras	0.024	16.5	7.7	4.4	10.9
Hong Kong, China	0.115	110.7	52.0	29.3	7.7
Hungary	0.121	59.3	27.9	15.7	11.7
Iceland	0.006	2.8	1.3	0.7	3.4
India	7.059	7295.7	3427.4	1932.2	22.9
Indonesia	1.448	1397.1	656.3	370.0	17.5
Iran, Islamic Republic	1.793	1647.5	774.0	436.3	20.3
Iraq	0.360	330.7	155.3	87.6	29.3

Ireland	0.108	52.7	24.8	14.0	16.8
Israel	0.210	102.6	48.2	27.2	20.2
Italy	1.034	506.0	237.7	134.0	11.3
Jamaica	0.021	14.6	6.9	3.9	19.1
Japan	3.655	1321.0	620.6	349.9	17.2
Jordan	0.066	60.6	28.5	16.1	22.2
Kazakhstan	0.903	491.7	231.0	130.2	23.1
Kenya	0.039	37.9	17.8	10.0	6.5
Korea, Dem. People's Rep.	0.224	216.4	101.7	57.3	36.0
Korea, Republic of	1.805	1080.9	507.8	286.3	17.7
Kosovo	0.025	13.5	6.4	3.6	24.3
Kuwait	0.295	271.1	127.4	71.8	24.2
Kyrgyzstan	0.019	10.4	4.9	2.7	7.4
Latvia	0.022	11.8	5.5	3.1	7.2
Lebanon	0.064	58.9	27.7	15.6	28.1
Libya	0.175	170.3	80.0	45.1	25.4
Lithuania	0.038	20.6	9.7	5.5	9.4
Luxembourg	0.031	15.3	7.2	4.1	12.7
Macedonia, Republic of	0.032	17.6	8.3	4.7	23.5
Malaysia	0.672	648.5	304.7	171.8	22.0
Malta	0.008	4.1	1.9	1.1	6.2
Mexico	1.366	968.5	455.0	256.5	15.9
Moldova, Republic of	0.014	7.7	3.6	2.0	9.5
Mongolia	0.037	35.5	16.7	9.4	21.1
Montenegro	0.008	4.2	2.0	1.1	15.2
Morocco	0.153	148.7	69.9	39.4	17.6
Mozambique	0.009	9.0	4.2	2.4	2.3
Myanmar	0.030	29.4	13.8	7.8	4.7
Namibia	0.010	9.3	4.4	2.5	10.9
Nepal	0.013	12.1	5.7	3.2	3.1
Netherlands	0.484	236.5	111.1	62.6	11.1
Netherlands Antilles	0.014	9.6	4.5	2.6	7.6
New Zealand	0.095	59.1	27.7	15.6	10.2
Nicaragua	0.013	9.4	4.4	2.5	12.4
Nigeria	0.244	236.8	111.3	62.7	4.9
Norway	0.170	83.1	39.0	22.0	9.6
Oman	0.174	159.4	74.9	42.2	15.7
Pakistan	0.482	465.4	218.6	123.3	12.1
Panama	0.028	19.2	9.0	5.1	6.7
Paraguay	0.015	10.2	4.8	2.7	6.3
Peru	0.190	132.4	62.2	35.1	17.4
Philippines	0.274	264.1	124.1	69.9	18.4
Poland	0.914	446.8	209.9	118.3	20.0
Portugal	0.152	74.5	35.0	19.7	13.5
Qatar	0.256	235.5	110.6	62.4	18.4
Romania	0.221	120.6	56.7	31.9	12.8
Russian Federation	5.315	2347.9	1103.0	621.8	17.4
Saudi Arabia	1.523	1399.6	657.5	370.7	22.2
Senegal	0.022	21.2	10.0	5.6	14.5
Serbia	0.111	60.7	28.5	16.1	17.2
Singapore	0.051	49.5	23.3	13.1	1.3
Slovak Republic	0.100	48.7	22.9	12.9	11.8
Slovenia	0.045	22.2	10.4	5.9	14.7
South Africa	1.314	1275.2	599.1	337.7	27.7
Spain	0.704	344.1	161.7	91.1	10.9
Sri Lanka	0.043	41.2	19.3	10.9	8.2
Sudan	0.045	43.2	20.3	11.4	8.4
Sweden	0.132	64.7	30.4	17.1	5.8
Switzerland	0.118	57.8	27.1	15.3	8.6

Syrian Arab Republic	0.188	173.1	81.3	45.9	37.6
Tajikistan	0.008	4.5	2.1	1.2	6.8
Tanzania, United Republic	0.021	20.7	9.7	5.5	2.5
Thailand	0.959	925.3	434.7	245.1	17.6
Togo	0.005	4.9	2.3	1.3	5.3
Trinidad and Tobago	0.143	99.9	46.9	26.5	27.6
Tunisia	0.079	76.8	36.1	20.3	9.7
Turkey	0.954	466.4	219.1	123.5	17.8
Turkmenistan	0.158	86.3	40.6	22.9	11.4
Ukraine	0.885	482.1	226.5	127.7	17.4
United Arab Emirates	0.543	498.8	234.3	132.1	13.6
United Kingdom	1.355	662.9	311.4	175.6	14.1
United States of America	15.350	6686.5	3141.3	1770.9	15.2
Uruguay	0.020	13.7	6.4	3.6	8.6
Uzbekistan	0.302	164.6	77.3	43.6	12.0
Venezuela	0.648	451.0	211.9	119.5	18.5
Vietnam	0.496	478.9	225.0	126.8	19.6
Yemen	0.069	63.4	29.8	16.8	32.7
Zambia	0.007	7.3	3.4	1.9	2.3
Zimbabwe	0.027	25.8	12.1	6.8	6.0
World total or average	99.747	60,681.4	28,507.5	16,071.1	15.8

Table S40 indicates that the sum of the 139-country greenhouse gas and particle emissions may cause, in 2050, ~\$28.5 (16.1-60.7) trillion/year in climate damage to the world. Thus, the global climate cost savings per person, averaged among these countries, to reducing all climate-relevant emissions through a 100% WWS system, is ~\$3,200/person/year (in 2013 USD), or ~15.8 (8.9-34) ¢/kWh-BAU-all-energy (Table S34).

Section S9. Impacts of WWS on Jobs and Earnings in the Energy Power Sector

This section provides estimates of job and revenue creation and job loss due to implementing WWS electricity. The analysis does not include the job changes in industries outside of electric power generation, such as in the manufacture of electric vehicles, fuel cells or electricity storage because of the additional complexity required and greater uncertainty as to where those jobs will be located.

Our estimates of jobs lost and of jobs gained in the WWS scenario boils down to the product of jobs per unit energy output and a change in output. Jobs per unit energy output are based on data or models for the U.S. Jobs/energy-unit for other countries, relative to the U.S., are estimated as a function of energy output and GDP/capita in each country relative to energy output and GDP/capita in the U.S. We assume that as energy output increases, jobs/energy-unit decrease slightly because of economies of scale and efficiencies in the use of labor, and that as GDP/capita increases, jobs/energy-unit decrease slightly because of substitution of capital for labor. However, we do not account for the effect on jobs/energy-unit of changes in wages or prices that might result from changes in the amount and type of energy produced and consumed.

Our estimates of the number of jobs include “direct” jobs (for project development and on-site labor), “indirect jobs” (related to local employment and the supply chain), and “induced jobs” (arising from spending and re-investment or earnings from direct and indirect jobs). However, estimates of induced jobs do not, as mentioned above, account for changes in wages or prices of goods and services.

All construction jobs (and associated indirect plus induced jobs) are defined as full-time annual equivalents, or 2080-hour units of labor. Construction as well as operations jobs are continuous and indefinite so long as the system is in steady state or expanding, because new construction is required continuously to replace retiring capacity.

We estimate jobs created in the 100% WWS scenario with the same general methods used to estimate BAU jobs lost in the WWS scenario. Differences between the WWS scenario and the BAU scenario in the definition or estimation of parameter values are discussed in subsections below.

S9.1. Jobs Created and Changes in Earnings in the 100% WWS Scenario

Overview

In the analysis of jobs created in the 100% WWS scenario, the job sectors are associated with the generation, transmission, and storage of WWS power, namely onshore wind, offshore wind, wave power, geothermal, hydropower, tidal, residential PV, commercial PV, utility PV, CSP, CSP for storage, solar thermal storage, geothermal heat plants, additional conventional transmission, extra conventional distribution, and long-distance HVDC lines. In this subsection, we estimate jobs created for the entire WWS generation capacity in place in the target year, *not* the difference between WWS capacity in the 100% WWS scenario and WWS capacity in the BAU scenario, since we calculate the difference in Section S9.3 after calculating job losses in Section S9.2.

Jobs per energy unit

Our estimates of baseline jobs per unit energy in the 100% WWS scenario are based on NREL’ *JEDI* models (NREL, 2013). These are economic input-output models with several assumptions and uncertainties (e.g. Linowes, 2012). The *JEDI* models estimate the economic impacts of constructing and operating power plants, fuel production facilities,

electricity transmission lines, and other projects. *JEDI* models estimate jobs in three categories:

- Project development and onsite labor, or “direct” jobs;
- Local revenue and supply chain, or “indirect” jobs; and
- Induced jobs, driven by the spending and reinvestment of earnings from direct and indirect jobs.

Scenarios for WWS powered electricity generation are run for each country assuming that the WWS electricity sector is fully developed by 2050. The calculations account for only new WWS jobs associated with new WWS generator capacity as identified in Table S7 and corresponding new transmission lines.

Job numbers and revenues are reported for two phases of development: construction and operation. All jobs estimated here are ongoing, full-time equivalent (FTE) positions (2080 hours/yr) (NREL, 2013). Annual construction jobs are estimated by assuming that $1/L$ of total installed capacity is replaced every year, where L is the life of the facility until replacement. Thus, the jobs are effectively permanent, because new jobs will be needed to replace the WWS facilities at the end of their lifetimes.

Job estimates do not include job changes in industries outside of electric power generation (e.g., the manufacture of electric vehicles, fuel cells or electricity storage), as it is uncertain where those jobs will be located and the extent to which they will be offset by losses in BAU-equivalent industries.

Table S41 gives the average job numbers per unit energy or distance ($J/E_{I,US,BY}$) in each energy or transmission/distribution sector I , in the U.S. in base year BY . This baseline value is adjusted by the parameter $E^{\wedge}_{E_{TY,I,C,TY}}$ to account for differences in labor intensity at energy-sector outputs different from those from the baseline value (see Section S9.2).

Here we note two differences in the specification of $E^{\wedge}_{E_{TY,I,C,TY}}$ in the 100% WWS scenario relative to the BAU scenario. First, the parameter ∂ , which is the exponent relating changes in total energy to changes in jobs/energy unit in Section S9.2, is assumed to be -0.05 in the 100% WWS scenario, which is smaller than in the BAU jobs lost scenario because we assume that WWS jobs are less sensitive to the scale of output, because of greater modularity in production.

Second, the baseline quantity of energy-sector output in the denominator of the expression for $E^{\wedge}_{E_{TY,I,C,TY}}$ (Section S9.2) is specified differently in some cases. For electricity generation, we assume that the baseline energy-sector output equals 70% of the 139-country average in the target year. For electricity distribution, the baseline (denominator) is 10% of the U.S. electricity distribution system.

Table S41. Baseline continuous or 1-year full-time (2080 hrs/yr) jobs created per installed capacity or distance in the 100% WWS scenario.

	On-shore wind	Off-shore wind	Wave	Geo-thermal electric plant	Hydro-electric plant	Tidal turbine	Residential roof PV	Commercial roof PV
<i>Full-time jobs per unit:</i>	<i>MW-cap</i>	<i>MW-cap</i>	<i>MW-cap</i>	<i>MW-cap</i>	<i>MW-cap</i>	<i>MW-cap</i>	<i>MW-cap</i>	<i>MW-cap</i>
Continuous operation low	0.35	0.60	0.56	0.44	0.30	0.60	0.31	0.16
Continuous operation high	0.38	0.66	0.58	0.48	0.30	0.62	0.33	0.16
Continuous operation average	0.37	0.63	0.57	0.46	0.30	0.61	0.32	0.16
One-year construction low	5.54	7.30	6.73	24.88	12.00	6.81	35.59	28.10
One-year construction high	8.58	11.31	7.18	38.68	12.00	7.25	40.87	31.42
One-year construction average	7.06	9.30	6.95	31.78	12.00	7.03	38.23	29.76
Continuous construction average	0.24	0.31	0.15	0.71	0.14	0.16	0.88	0.65

	Utility PV	CSP plant	CSP plant for storage	Solar thermal for heat	Geo-thermal heat plant	Additional transmission lines	Additional electric distribution	HVDC transmission
<i>Full-time jobs per unit:</i>	<i>MW-cap</i>	<i>MW-cap</i>	<i>MW-cap</i>	<i>MW-cap</i>	<i>MW-cap</i>	<i>km</i>	<i>km</i>	<i>km</i>
Continuous operation low	0.84	0.83	0.83	0.84	0.44	0.062	0.028	0.063
Continuous operation high	0.87	0.89	0.89	0.87	0.48	0.062	0.028	0.100
Continuous operation average	0.85	0.86	0.86	0.85	0.46	0.062	0.028	0.082
One-year construction low	20.60	10.68	10.68	20.60	24.88	4.94	2.25	5.97
One-year construction high	21.98	11.57	11.57	21.98	38.68	5.28	2.41	6.38
One-year construction average	21.29	11.13	11.13	21.29	31.78	5.11	2.33	6.18
Continuous construction average	0.24	0.31	0.15	0.71	0.14			

Notes:

Extra transmission = extra conventional electricity transmission network; extra distribution = extra conventional electricity distribution system; MW-cap = MW of installed capacity; km = kilometers. Multiply the total MW installed capacity in 2050 by the number of continuous construction plus operation jobs per MW-cap and the other factors delineated in the text to get the total number of continuous, full-time construction plus operation jobs. The number of continuous construction jobs per MW-cap equals the number

of one-year construction jobs per MW-cap divided by the lifetime of the device. Multiply the number of one-year construction jobs per MW-cap by the total MW installed capacity in 2050 and the other factors as delineated in the text to get the number of 1-year jobs for all WWS installations.

Onshore wind, offshore wind, wave, geothermal, hydro, tidal, PV, and CSP: based on our runs of NREL's *JEDI* models.

CSP plant for storage: We assume jobs/MW for is the same as for *CSP plant*.

Solar thermal for heat: We assume jobs/MW for is the same as for *utility PV*.

Geothermal heat plant: We assume jobs/MW for is the same as for *geothermal electric*.

Extra transmission: based on the *JEDI* analysis presented in Tables S30 and S31. The estimates of construction jobs are equal to the base-case value for AC transmission from Table S30 multiplied by 1.03 (low case) or 1.10 (high case).

Extra distribution: Operations jobs/km are equal to the total jobs in the sector *Electric power distribution* (U.S. Bureau of Labor Statistics, 2016; same source used to estimate BAU jobs lost) in 2012 divided by the total km of the U.S. distribution system in 2012. Weeks (2010) gives 8.9 million km for the U. S., and Harris Williams & Co. (2014) gives 9.7 million km for all of North America, which implies 8.6 million km for the U.S. on the basis of the U.S. electricity share of total North American electricity consumption. We assume 8.9 million km for the U. S. in 2012. We assume that construction jobs/MW are equal to operations jobs/MW multiplied by the construction/operations ratio for extra transmission lines.

HVDC Grid: based on the *JEDI* results from Table S30 and on Clean Line Energy Partners (2010), which estimates about 5 construction and 0.5 operations jobs/km.

Estimate of transmission distances and capacity additions in the WWS scenario

The parameter $E_{I,C,Y}$ is the additional conventional transmission and distribution distance or HVDC transmission distance (km) or additional installed capacity (MW) associated with sector I in country C in year Y , used in the denominator of the jobs per unit distance or per unit capacity calculation in Table S41 We estimate the distances as follows:

Additional conventional transmission lines

We assume a simple nonlinear relationship between the length of transmission lines and the total generating capacity of each country, and then integrate this function over the difference in generating capacity between the BAU scenario and WWS scenario in the target year. Formally,

$$E_{i-atrans,C,TY} \equiv D_{atrans,C,TY}$$

$$D_{atrans,C,TY} = \int_{El_{cap-total,C,TY,BAU}}^{El_{cap-total,C,TY,WWS}} D / MW_{trans,C,Y} (El_{cap-total,C,Y}) \cdot El_{cap-total,C,Y}$$

$$D / MW_{trans,C,Y} (El_{cap-total,C,Y}) = D / MW_{trans,ref} \cdot \left(\frac{El_{cap-total,C,Y}}{El_{cap-total,ref}} \right)^\varphi$$

$$\frac{El_{cap-total,C,TY,WWS}}{El_{cap-total,C,TY,BAU}} \int D / MW_{trans,ref} \cdot El_{cap-total,C,Y} \cdot \left(\frac{El_{cap-total,C,Y}}{El_{cap-total,ref}} \right)^\varphi =$$

$$\frac{D / MW_{trans,ref}}{\varphi + 1} \cdot \left(El_{cap-total,C,TY,WWS} \cdot \left(\frac{El_{cap-total,C,TY,WWS}}{El_{cap-total,ref}} \right)^\varphi - El_{cap-total,C,TY,BAU} \cdot \left(\frac{El_{cap-total,C,TY,BAU}}{El_{cap-total,ref}} \right)^\varphi \right)$$

where

$E_{i-trans,C,TY}$ = The quantity units associated with additional conventional transmission lines in country C in target year TY

$D_{atrans,C,TY}$ = The length of additional conventional transmission lines units in country C in target year TY (km)

$D / MW_{trans,C,Y}$ = The length of additional conventional transmission lines units per MW of generating capacity in country C in target year TY (km/MW)

$D / MW_{trans,ref}$ = The reference length of additional conventional transmission lines per MW of generating capacity, at the reference generating capacity (km/MW) (discussed below)

$El_{cap-total,C,Y}$ = Total electricity-generating capacity in country C in year TY in scenario S (MW) (discussed below)

$El_{cap-total,ref}$ = The reference electricity-generating capacity (MW) (we assume the 139-country average additional generating capacity needed in the year 2050 [difference between the WWS scenario and the BAU scenario])

φ = Exponent determining how changes in generating capacity affect transmission-system distance (discussed below)

To estimate the reference length of additional conventional transmission line per MW of generating capacity, we start with 0.483 million km of transmission lines in the U.S. in 2012 (based on Weeks [2010] and Harris Williams & Co. [2014]) divided by 1.12 million MW of generating capacity in the U.S. in 2012, giving $D / MW_{trans,US,2012} = 0.431$ km/MW. We then solve for the value of $D / MW_{trans,ref}$ corresponding to $D / MW_{trans,US,2012} = 0.431$ km/MW, $El_{cap-total,US,2012} = 1.12$ million MW, and $El_{cap-total,ref}$ (given above):

$$D / MW_{trans,US,2012} = \frac{D / MW_{trans,ref}}{\varphi + 1} \cdot \left(\frac{El_{cap-total,US,2012}}{El_{cap-total,ref}} \right)^\varphi$$

$$D / MW_{trans,ref} = D / MW_{trans,US,2012} \cdot (\varphi + 1) \cdot \left(\frac{El_{cap-total,US,2012}}{El_{cap-total,ref}} \right)^{-\varphi}$$

Estimates of generating capacity by country and year are based on estimates of total electricity generation and total electricity-system capacity factors (see Section S9.2).

We assume that as the capacity of the electricity generation increases, the average transmission distance per unit capacity decreases moderately. Our analysis of the effect of the parameter φ on the estimated $D_{trans,C,T,Y}$ suggests that -0.25 is a reasonable value.

Additional electricity distribution network

We assume that in the WWS scenario the average *capacity* but not the *extent* of the electricity distribution network will be higher than in the BAU scenario. If we further assume that components of the distribution system will be upgraded to higher capacity in the normal course of repair, retirement, and replacement, then there will be no significant additional labor associated with building or operating the electricity distribution system in the WWS scenario.

HVDC transmission lines

Although the present analysis accounts for the costs and energy losses due to additional HVDC lines needed with WWS (Section S6), it does not account for the additional jobs associated with building and operating the additional lines. The primary reason is because, on the BAU side, we do not estimate job losses due to no longer constructing oil tankers or oil tanker trucks upon conversion to WWS.

Changes to other parameter values

The jobs-per-unit-energy calculation (Section S9.2) contains other terms that differ between the BAU and WWS cases. These are listed here.

JM_I , the omitted jobs *multiplier*, is 1.0 for all WWS job sectors because we assume that the JEDI results we use capture all relevant direct and indirect jobs.

IJM_I , the induced jobs multiplier, is 1.0 for all WWS job sectors because the *JEDI* results we use already included jobs induced in the broader economy.

$L_{G-wws-ave}$, the average lifetime of WWS technologies, is the average of our high and low estimates of generator lifetimes.

Changes in earnings in the 100% WWS scenario

These are calculated using the same methods and parameter values as in the analysis of changes in earnings in the BAU scenario (Section S9.2).

Summary of Job Creation

Results of the job creation analysis are given in Table S42. The table indicates that 100% conversion to WWS across 139 countries may create ~25.4 million new permanent, full-time construction jobs and ~26.6 million new permanent, full-time operation and maintenance jobs, or a total of 52.0 million permanent jobs for WWS generators and transmission. These employment numbers do not include all external jobs created in areas such as research and development, storage development, and local economy improvement.

Table S42. Estimated new permanent, full-time construction and operation jobs, permanent, full-time construction plus operation jobs minus jobs lost, annual earnings corresponding to new construction and operation jobs, and net earnings from new construction plus operation jobs minus jobs lost, by country, due to converting to 100% WWS. Monetary values are in 2013 USD.

Country	Permanent, full-time construction jobs	Permanent, full-time operation jobs	Job losses in fossil-fuel and nuclear energy industries	Permanent, full-time net construction plus operation jobs created minus jobs lost	Annual earnings from new construction jobs (bil \$/yr)	Earnings from new operation jobs (bil \$/yr)	Net earnings from new construction plus operation jobs minus jobs lost (bil \$/yr)
Albania	6,426	4,854	6,061	5,219	0.41	0.31	0.33
Algeria	171,214	126,717	436,847	(138,916)	9.20	6.81	-7.46
Angola	59,657	46,495	332,687	(226,535)	2.31	1.80	-8.76
Argentina	183,992	144,324	206,006	122,310	11.60	9.10	7.71
Armenia	9,026	8,034	3,351	13,709	0.49	0.44	0.75
Australia	232,544	252,558	307,664	177,438	22.74	24.70	17.35
Austria	57,929	69,830	47,163	80,597	5.89	7.10	8.19
Azerbaijan	39,091	34,505	89,491	(15,894)	3.21	2.83	-1.30
Bahrain	19,162	31,287	53,337	(2,888)	2.07	3.38	-0.31
Bangladesh	195,199	210,508	169,833	235,875	5.89	6.36	7.12
Belarus	44,319	59,540	33,518	70,342	3.63	4.87	5.76
Belgium	92,015	153,991	50,819	195,188	8.99	15.04	19.06
Benin	22,984	19,286	29,877	12,394	0.54	0.45	0.29
Bolivia	23,848	17,797	52,507	(10,862)	0.84	0.63	-0.38
Bosnia and Herzegovina	11,108	8,744	7,468	12,384	0.69	0.54	0.77
Botswana	11,128	8,022	8,445	10,706	0.62	0.45	0.60
Brazil	775,269	668,859	824,570	619,557	42.70	36.83	34.12
Brunei Darussalam	10,241	12,281	42,244	(19,721)	1.58	1.90	-3.05
Bulgaria	30,108	28,782	22,693	36,197	2.49	2.38	3.00
Cambodia	24,490	18,692	42,502	680	0.75	0.57	0.02
Cameroon	92,094	92,578	70,521	114,151	2.49	2.50	3.09

Canada	315,138	367,889	604,242	78,785	30.12	35.16	7.53
Chile	77,731	65,076	93,481	49,326	5.83	4.88	3.70
China	5,806,725	6,675,881	3,374,787	9,107,819	456.05	524.31	715.31
Chinese Taipei	162,165	192,324	110,502	243,988	28.12	33.35	42.31
Colombia	114,649	89,838	188,798	15,688	5.57	4.36	0.76
Congo	14,986	11,385	66,732	(40,361)	0.54	0.41	-1.46
Congo, Dem. Republic	152,862	139,298	218,765	73,394	2.60	2.36	1.25
Costa Rica	8,090	7,397	9,752	5,736	0.41	0.38	0.29
Cote d'Ivoire	51,848	43,092	106,622	(11,682)	1.47	1.22	-0.33
Croatia	25,875	29,317	14,952	40,239	2.39	2.71	3.72
Cuba	23,419	17,873	20,525	20,767	1.41	1.07	1.25
Cyprus	5,278	4,777	2,494	7,561	0.62	0.56	0.89
Czech Republic	65,393	87,211	44,382	108,223	5.28	7.04	8.73
Denmark	30,639	45,461	41,049	35,050	3.09	4.59	3.54
Dominican Republic	18,569	15,155	12,551	21,173	0.91	0.75	1.04
Ecuador	39,531	33,301	76,251	(3,419)	1.75	1.47	-0.15
Egypt	277,146	206,184	363,323	120,008	12.85	9.56	5.56
El Salvador	7,365	5,858	8,881	4,342	0.29	0.23	0.17
Eritrea	4,709	3,369	8,342	(264)	0.10	0.07	-0.01
Estonia	7,341	9,362	8,464	8,239	0.56	0.71	0.63
Ethiopia	222,094	186,940	389,663	19,370	4.75	4.00	0.41
Finland	38,247	54,736	45,857	47,125	3.60	5.15	4.43
France	257,193	280,551	205,141	332,603	23.68	25.83	30.63
Gabon	14,019	11,280	49,024	(23,726)	0.88	0.71	-1.50
Georgia	10,617	7,650	6,619	11,648	0.62	0.45	0.68
Germany	437,008	608,547	281,873	763,683	44.51	61.98	77.78
Ghana	45,678	36,865	69,806	12,737	1.39	1.12	0.39
Gibraltar	3,204	5,161	2,205	6,160	0.35	0.57	0.68
Greece	41,818	39,203	32,198	48,823	3.03	2.84	3.54
Guatemala	28,429	22,535	38,453	12,511	1.05	0.83	0.46
Haiti	16,031	15,463	19,323	12,172	0.34	0.32	0.25
Honduras	20,644	16,623	16,136	21,131	0.64	0.52	0.66
Hong Kong, China	42,305	75,299	27,468	90,136	5.64	10.04	12.02
Hungary	59,810	73,818	28,739	104,888	4.32	5.33	7.57
Iceland	12,087	19,931	4,058	27,960	1.20	1.98	2.78
India	2,619,000	2,052,951	2,376,515	2,295,436	124.29	97.43	108.94
Indonesia	675,325	555,237	882,362	348,201	35.01	28.78	18.05
Iran, Islamic Republic	559,595	576,814	799,029	337,380	34.72	35.79	20.93
Iraq	99,085	71,098	358,690	(188,508)	5.57	4.00	-10.59
Ireland	17,350	18,194	13,262	22,281	1.96	2.05	2.51
Israel	38,849	46,679	22,268	63,259	3.25	3.90	5.29
Italy	299,649	350,627	164,419	485,857	25.93	30.34	42.04
Jamaica	9,207	8,131	5,404	11,934	0.37	0.32	0.48
Japan	568,920	885,310	255,975	1,198,256	44.11	68.64	92.90
Jordan	23,773	18,057	13,160	28,671	1.14	0.87	1.38
Kazakhstan	168,105	149,916	207,360	110,660	17.28	15.41	11.38
Kenya	78,117	60,300	147,073	(8,655)	2.10	1.62	-0.23
Korea, Dem. People's Rep.	68,543	80,700	38,903	110,340	1.54	1.81	2.47
Korea, Republic of	432,100	680,146	204,351	907,895	38.28	60.26	80.44
Kosovo	5,383	4,279	3,789	5,874	0.24	0.19	0.26
Kuwait	73,107	122,418	309,612	(114,086)	10.33	17.30	-16.13
Kyrgyzstan	14,713	12,049	8,453	18,309	0.53	0.43	0.66
Latvia	9,686	11,251	12,355	8,582	0.95	1.11	0.84
Lebanon	16,059	19,251	12,076	23,234	0.87	1.05	1.26
Libya	51,764	38,448	258,485	(168,274)	2.73	2.03	-8.88
Lithuania	15,356	15,545	12,482	18,419	1.66	1.68	1.99
Luxembourg	8,824	14,243	4,095	18,972	1.47	2.37	3.16
Macedonia, Republic of	9,572	8,355	3,582	14,344	0.67	0.59	1.01
Malaysia	242,817	251,429	286,715	207,532	20.38	21.11	17.42

Malta	3,245	4,935	2,163	6,017	0.37	0.57	0.69
Mexico	446,073	369,399	547,968	267,504	28.44	23.55	17.06
Moldova, Republic of	9,363	8,442	4,765	13,040	0.40	0.36	0.56
Mongolia	22,291	16,705	22,731	16,265	1.22	0.91	0.89
Montenegro	2,535	2,043	2,075	2,504	0.20	0.16	0.19
Morocco	76,995	56,379	44,568	88,806	3.06	2.24	3.53
Mozambique	56,498	49,864	121,563	(15,201)	1.09	0.96	-0.29
Myanmar	87,521	65,786	125,005	28,302	2.98	2.24	0.96
Namibia	8,746	6,609	27,348	(11,993)	0.40	0.30	-0.54
Nepal	78,639	80,905	68,718	90,825	2.11	2.17	2.43
Netherlands	107,221	186,432	134,413	159,241	11.27	19.60	16.74
Netherlands Antilles	8,800	13,894	6,788	15,907	0.60	0.95	1.09
New Zealand	34,730	31,716	44,005	22,442	3.53	3.22	2.28
Nicaragua	8,875	7,359	9,463	6,770	0.32	0.27	0.25
Nigeria	636,109	607,966	1,193,984	50,090	24.67	23.58	1.94
Norway	26,529	37,598	214,913	(150,785)	3.44	4.87	-19.55
Oman	63,106	63,986	158,289	(31,196)	6.00	6.09	-2.97
Pakistan	397,512	347,904	387,699	357,716	14.28	12.50	12.85
Panama	16,605	14,800	11,537	19,868	1.03	0.92	1.23
Paraguay	7,379	7,546	29,283	(14,358)	0.30	0.30	-0.58
Peru	54,985	45,827	75,934	24,878	2.53	2.11	1.15
Philippines	126,421	102,463	119,799	109,085	5.39	4.37	4.65
Poland	144,573	137,717	100,440	181,850	10.52	10.02	13.23
Portugal	40,559	34,536	30,084	45,011	3.07	2.62	3.41
Qatar	75,608	130,194	323,634	(117,833)	17.54	30.21	-27.34
Romania	63,265	60,012	63,208	60,069	5.76	5.46	5.47
Russian Federation	624,683	748,415	1,119,520	253,578	53.50	64.10	21.72
Saudi Arabia	337,839	292,350	1,074,084	(443,896)	39.55	34.23	-51.97
Senegal	20,031	15,001	28,950	6,081	0.49	0.37	0.15
Serbia	42,833	46,621	22,778	66,676	3.03	3.30	4.72
Singapore	87,261	153,542	88,553	152,251	15.35	27.01	26.78
Slovak Republic	24,981	25,736	16,398	34,319	1.92	1.98	2.64
Slovenia	10,891	10,056	9,148	11,799	0.86	0.80	0.94
South Africa	303,700	298,643	305,294	297,049	15.45	15.19	15.11
Spain	184,796	179,790	129,310	235,276	15.77	15.34	20.08
Sri Lanka	43,956	33,897	50,962	26,890	2.35	1.81	1.44
Sudan	61,870	44,028	116,258	(10,361)	1.88	1.34	-0.31
Sweden	46,855	64,351	72,569	38,637	4.85	6.67	4.00
Switzerland	44,535	48,873	28,610	64,798	5.22	5.73	7.59
Syrian Arab Republic	46,207	33,489	65,150	14,547	1.90	1.38	0.60
Tajikistan	2,889	3,354	5,418	825	0.09	0.11	0.03
Tanzania, United Republic	120,481	102,885	185,696	37,670	3.07	2.62	0.96
Thailand	408,753	409,351	369,771	448,333	25.94	25.98	28.45
Togo	14,958	13,488	31,034	(2,588)	0.31	0.28	-0.05
Trinidad and Tobago	31,680	44,074	81,095	(5,341)	2.42	3.37	-0.41
Tunisia	45,561	36,716	48,035	34,242	2.16	1.74	1.62
Turkey	226,108	169,724	100,732	295,100	14.20	10.66	18.53
Turkmenistan	57,899	55,767	104,524	9,141	4.56	4.39	0.72
Ukraine	155,985	185,719	124,638	217,066	8.27	9.85	11.51
United Arab Emirates	187,851	302,657	379,484	111,024	26.29	42.35	15.54
United Kingdom	257,519	400,689	247,025	411,183	24.22	37.69	38.68
United States of America	1,983,745	2,154,051	2,246,764	1,891,031	247.84	269.12	236.26
Uruguay	12,115	9,941	12,078	9,979	0.73	0.60	0.60
Uzbekistan	140,636	126,031	125,053	141,615	6.50	5.83	6.55
Venezuela	213,985	195,899	381,852	28,031	11.38	10.42	1.49
Vietnam	239,811	234,827	264,209	210,429	9.32	9.13	8.18
Yemen	26,053	21,965	51,463	(3,444)	0.81	0.68	-0.11
Zambia	44,686	33,524	75,377	2,833	1.31	0.98	0.08
Zimbabwe	61,627	54,112	82,887	32,851	1.36	1.20	0.73

World total or average	25,392,348	26,614,346	27,744,572	24,262,122	1863.89	2061.70	1862.13
------------------------	------------	------------	------------	------------	---------	---------	---------

Jobs lost includes current jobs lost plus future jobs lost due to not growing fossil-fuel infrastructure. Calculations are based on the number of new generators needed of each type for annual average power and peaking/storage (Table S7). Earnings include wages, services, and supply-chain impacts.

S9.2. BAU Jobs Foregone (Lost) in the 100% WWS Scenario

This section describes the calculation of jobs foregone (lost) upon conversion to 100% WWS.

General method

Total BAU jobs foregone

The total number of BAU jobs foregone in country C in year TY is the sum of jobs foregone in the country over all affected energy-industry categories I :

$$J_{T,C,TY} = \sum_I J_{I,C,TY}$$

where

$J_{T,C,TY}$ = Total number of BAU jobs foregone in country C in year TY

$J_{I,C,TY}$ = Jobs foregone in the BAU scenario in industry-employment sector I in country C in target year TY

Jobs foregone by energy industry

We estimate full-time operations jobs for most energy industries and full-time construction jobs for the power-plant sector and the petroleum-refinery sector in the BAU in the target year. Jobs are calculated for each industry (I) employment category as the product of jobs per unit of energy and total energy-sector output foregone (lost) in the target year in the WWS scenario. Total energy-sector output foregone is the product of total energy-sector output in 2012, the ratio of energy in the target year to energy in 2012, and the fraction of energy-sector output foregone in the target year in the WWS scenario. In the case of operations jobs, the relevant “energy-sector output” metric (hereafter referred to as “energy”) refers to the amount of energy produced, or processed, throughput, distributed, consumed in end use, or embodied in products, as appropriate for the sector. In the case of power-plant construction jobs, the relevant energy metric is the amount of generating capacity installed in the target year, which we assume is the amount required to replace retiring plants. In the case of petroleum-refinery construction jobs, the relevant energy metric is the amount of output from plants that we assume are replaced or majorly upgraded in the target year. Note that these methods are consistent with those used to estimate jobs created in the WWS scenario.

Jobs per energy unit are calculated as the product of jobs/energy in the U.S. in 2012, the fraction of BAU jobs foregone in the WWS scenario, a multiplier for jobs omitted from our base data, a multiplier for “induced” jobs in the broader economy, and country-specific adjustment factors accounting for the relationship between jobs/energy and GDP/capita, and between jobs/energy and total energy-sector output.

Formally,

$$J_{I,C,TY} = J / E_{I,US,BY} \cdot E_{I,C,TY} \cdot GDPC^{\wedge}_{C,TY} \cdot JM_I \cdot IJM_I \cdot \left(E^{\wedge}_{E_{TY},I,C,TY} - (1 - ESOLfr_{I,TY}) \cdot E^{\wedge}_{E'_{TY},I,C,TY} \right)$$

$$J / E_{I,US,BY} = \frac{J^*_{I,US,BY}}{E_{I,US,BY}}$$

$$E_{I,C,TY} = E_{I,C,BY} \cdot E_{C,I,TY/BY}$$

where (all parameter values not discussed here were defined in the previous subsection)

$J / E_{I,US,BY}$ = Jobs per energy unit in sector I in the U.S. in the base year BY

$E_{I,C,Y}$ = Energy associated with sector I in country C in year Y (BY or TY) (KTOE)

$GDPC^{\wedge}_{C,TY}$ = Adjustment factor accounting for the effect on jobs/energy unit of differences in GDP per capita between country C in year TY and the U.S.

JM_I = Omitted jobs multiplier: the ratio of total jobs actually in or related to sector I , to the jobs counted in our data $J^*_{I,US,BY}$ in the base year BY of the U.S. jobs/energy-unit estimates.

IJM_I = Induced jobs multiplier: the ratio of total jobs, including those induced in the broader economy, to the direct and indirect jobs in sector I

$J^*_{I,US,BY}$ = Jobs in sector I in the U.S. in the base year BY

$E^{\wedge}_{E_{TY},I,C,TY}$ = Adjustment factor accounting for the effect on jobs/energy unit of changes in total associated energy, evaluated at the total energy in the year TY (E_{TY})

$E^{\wedge}_{E'_{TY},I,C,TY}$ = Adjustment factor accounting for the effect on jobs/energy unit of changes in total associated energy, evaluated at the energy *not* foregone (i.e., still remaining) in the WWS scenario in the year TY (E'_{TY})

$ESOLfr_{I,TY}$ = Of the total energy-sector output in the BAU sector I in target year TY , the fraction that actually is foregone in the 100% WWS scenario

$E_{I,C,TY/BY}$ = Target-year/base-year ratio for the energy measure in sector I in country C

subscript I = Industry employment categories (see spreadsheet Delucchi et al., 2016)

subscript C = Countries in the analysis

TY = Target year (2050)

BY = Base year (varies)

KTOE = Thousand tons of oil-equivalent

Simplifying assumptions

Our method assumes that each country manufactures and maintains the amount of energy equipment that satisfies its own energy production or consumption; that is, we do not attempt to estimate manufacture of energy equipment for export. In reality there is a great deal of international trade in energy equipment: for example, China accounts for about 70% of total global production of solar PV modules (IRENA, 2015b). Without doing a more detailed analysis of international trade, we cannot say whether our simplifying assumption biases our estimates of net changes in jobs.

A minor simplification is that we evaluate the energy-output adjustment factor, $E^{\wedge}_{E,I,C,TY}$, at two points, E_{TY} and E'_{TY} , rather than as the average over the range up to those two points.

Energy use for the power-plant-construction sector

As mentioned above, the relevant energy-use in the power-plant-construction (*ppc*) sector, $E_{I-ppc,C,TY}$, is the amount of generating capacity newly installed in the target year. Assuming for simplicity that the system is in steady-state in the target year (capacity additions = capacity retirements), then the generating capacity newly installed in the target year is the amount that replaces capacity at the end of its life in the target year, which in steady state is equal to the total target-year generating capacity divided by the capacity-weighted average lifetime of power plants. The capacity-weighted average lifetime is estimated on the basis of EIA/EIO-projected year-*TY* capacity by plant type and our estimates of lifetime by plant type.

The total generating capacity in the target year is equal to the total in the base year multiplied by the factor increase in total capacity between the target year and the base year. The factor increase for each country is assumed to equal the projected factor increase for the region of which it is a part.

The total base-year generating capacity is estimated by dividing total electricity output in country *C* by the electricity-system wide capacity factor for country *C* in the base year. The capacity factor for each country is assumed to equal the capacity factor for the region of which it is a part. The capacity factor for each region is calculated on the basis of EIA's *IEO* estimates of generation and capacity by region (EIA, 2016a).

Formally,

$$E_{I-ppc,C,TY} = \frac{El_{cap-total,C,BY} \cdot El_{cap-total,C,TY/BY}}{L_{cap-ave,C,TY}}$$
$$El_{cap-total,C,BY} = \frac{El_{gen-total,C,BY} \cdot 1000 \cdot K_{GWh/KTOE}}{8760 \cdot CF_{total,C,BY}}$$

$$El_{cap-total,C,TY/BY} = El_{cap-total,R:C \in R,TY/BY}$$

$$CF_{total,C,BY} = CF_{total,R:C \in R,BY}$$

$$CF_{total,R,BY} = \frac{El_{gen-total,R,BY}}{El_{cap-total,BY} \cdot 8760}$$

$$L_{cap-ave,C,TY} = \sum_G CAPFr_{G,R:C \in R,TY} \cdot L_{G-ave}$$

where

$E_{I-ppc,C,TY}$ = Energy associated with new power-plant construction in country C in year TY
(MW of newly built generating capacity)

$El_{cap-total,C,BY}$ = Total electricity-generating capacity in country C in year BY (MW)

$El_{cap-total,C,TY/BY}$ = The ratio of total generating capacity in year TY to capacity in BY , in country C

$L_{cap-ave,C}$ = The capacity-weighted average lifetime of power plants in country C in year TY

$CAPFr_{G,R:C \in R,TY}$ = Generating-technology G share of total installed capacity in region R (containing country C) in year TY (calculated from EIA's *IEO* projections [EIA, 2016a] of capacity by general generating technology class)

L_{G-ave} = The average lifetime of EIA *IEO* technology G (based on our estimated lifetimes for the similar technology classes in our detailed cost analysis)

$El_{cap-total,R:C \in R,TY/BY}$ = The ratio of total generating capacity in year TY to capacity in BY , in region R containing country C (EIA, 2016a)

$El_{total,C,BY}$ = Total electricity generation output in country C in base year BY (KTOE) (IEA, 2015c)

1000 = MWh/GWh

$K_{GWh/KTOE}$ = GWh per KTOE (11.63) (IEA, 2015c)

8760 = Hours/year

$CF_{El_{TOT},C,BY}$ = Capacity factor for total electricity generation in country C in base year BY

$CF_{El_{TOT},R:C \in R,BY}$ = Capacity factor for total electricity generation in region R containing country C in base year BY

$El_{gen-total,R,BY}$ = Total electricity generation in EIA-*IEO* region R in year BY (GWh) (EIA, 2016a)

G = Generating technologies in the EIA's *IEO* (coal, natural gas, liquids, nuclear, hydropower, geothermal, wind, solar, and other renewables)

Energy use in the petroleum-refinery-construction sector

We assume simply that the amount of refinery output that is replaced or majorly upgraded ever year is

$$\frac{1}{L_{I-refinery}} \cdot E_{I-refinery}$$

where $L_{I-refinery}$ is the average lifetime of a refinery before replacement or major upgrade (we assume 50 years) and $E_{I-refinery}$ is the total annual energy output of refineries.

GDP per capita adjustment

The GDP per capita adjustment, $GDPC_{C,TY}^{\wedge}$, is estimated as a function of GDP per capita for country C relative to that for the U. S. The adjustment exponent, or elasticity, is itself a function of the relative GDP per capita:

$$GDPC_{C,TY}^{\wedge} = GDPC'_{C,TY} \cdot \gamma_{JOBS1} \cdot GDPC'_{C,TY} \cdot \gamma_{JOBS2}$$

$$GDPC'_{C,TY} = \frac{GDPC_{C,TY}}{GDPC_{US,BY_{J/E}}}$$

where

$GDPC'_{C,TY}$ = GDP per capita of country C in TY relative to that of the U.S. in a base year

$GDPC_{C,TY}$ = GDP per capita of country C in TY (see discussion of GDP per capita elsewhere)

$GDPC_{US,BY_{J/E}}$ = GDP per capita of the U. S. in the base year BY of the estimates of jobs/energy unit (see Appendix S1)

$\gamma_{JOBS1}, \gamma_{JOBS2}$ = Exponents relating changes in GDP per capital to changes in jobs per energy unit

Energy/jobs adjustment

Finally, the adjustment factor accounting for the effect on jobs/energy unit of changes in total associated energy, $E^{\wedge}_{I,C,TY}$, is estimated from previously defined parameters as

$$E^{\wedge}_{I,C,TY} = \left(\frac{E_{C,I,TY}}{E_{I,US,BY}} \right)^{\partial}$$

where

∂ = Exponent relating changes in total energy to changes in jobs/energy unit

Parameter values

For detailed data categories and inputs, see the accompanying spreadsheet (Delucchi et al., 2016).

Jobs in the U.S. in the base year. Data on jobs by industry sector, except for the sectors *uranium mining, fossil generation, non-utilities, nuclear and biomass generation, power-sector construction, and petroleum-refinery construction* are from the Bureau of Labor Statistics (BLS), Current Employment Statistics (CES) (U.S. Bureau of Labor Statistics, 2016). BLS CES data are for the year 2012, which is the same year as the data on associated energy, from IEA (see below).

Jobs in *uranium mining* are from the EIA's *Domestic Uranium Production Report* (EIA, 2016b). EIA uranium employment estimates are the average for 2007 to 2014; we chose the average rather than the year 2012 because of large year-to-year variability.

For the sectors *fossil generation, non-utilities, nuclear and biomass generation, and power-sector construction*, we calculate jobs/energy unit differently, as discussed below.

Associated energy, base year

Energy data are from the IEA *World Energy Balances* (IEA, 2015c), except as noted here. *Fossil generation, utilities* are IEA-reported generation data (IEA reports in KTOE; we convert to GWh) for coal, oil, and NG generation by "main activity producers" (presumably utilities). *Fossil generation, non-utilities* data are the difference between total coal, oil, and NG generation and utility fossil generation. *Uranium mining* data are tonnes reported by the World Nuclear Association (WNA), the average for 2007 to 2014 (WNA, 2016). These WNA estimates agree to within a few percent with the estimates by the EIA (the source of our employment data).

For the power-plant construction sector, energy use is MW of capacity newly built in the target year. As shown above, capacity is calculated on the basis of total generation (IEA, 2015c), the capacity factor for total generation (based on EIA's *IEO*; EIA, 2016a) and the capacity-weighted average lifetime.

For the petroleum-refinery construction sector, energy use is refinery output in the target year, in KTOE. Now, as discussed below, to estimate petroleum-refining construction jobs, we use NREL's *JEDI* petroleum-refinery model, which estimates jobs per [barrels per calendar day capacity (BPCD)]. We convert BPCD to KTEO using EIA data (EIA, 2016h) on BPCD capacity in the U.S. in 2012, along with our estimate of KTOE output from refineries in the U. S. in 2012.

Ratio of energy use in TY to BY

As discussed in the section "Energy use in a 100%-WWS world vs. BAU," we estimate this ratio on the basis of EIA's *IEO* projections by region extrapolated past 2040, applied to individual countries.

Jobs per energy unit

This is equal to employment divided by energy production, except as noted here. Jobs/energy unit for *Fossil generation, non-utilities* is assumed to be the same as estimated for *Fossil generation, utilities*. Jobs/energy unit for *Nuclear and biomass generation, total* is assumed to be the same as for *Nuclear and other electric power generation, utilities*. Jobs/energy unit for *Bioenergy except for electricity* is our assumption based in part on the NREL's *JEDI* (Jobs and Economic Development Impact) model, which indicates a value of 1.8 jobs/KTOE for the operation of ethanol fuel plants (NREL, 2013; see the discussion of *JEDI* in the major section on job creation in the 100% WWS scenario). This value for *Bioenergy* is meant to include production of the feedstock as well as any processing and transportation. Jobs/energy unit for *Power-sector construction* is based on NREL's *JEDI* model estimates for various renewable-energy technologies and includes jobs induced in the broader economy (units here are full-time person-years per MW of capacity). Jobs/energy unit for *Petroleum-refinery construction* is from NREL's *JEDI* petroleum-refining model and includes jobs induced in the broader economy. (See the discussion of *JEDI* in the major section on jobs created in the 100% WWS scenario.)

Note that *JEDI* estimates of operations jobs/GWh for WWS technologies are generally slightly higher than job/GWh estimates based on BLS-CES data for all utility generation and for nuclear and renewable generation.

GDP per capita

See Appendix S1.

Fraction of energy-sector output foregone in the WWS scenario

For *Fossil fuel production and associated services, except petroleum refining*, this is the fraction of total fossil-fuel use that will be replaced in a 100% WWS scenario in the target year, which we estimate as all fossil-fuels used for *energy* purposes plus a small portion of non-energy use of fossil fuels (see the discussion of jobs estimated in the industrial sector in the BAU in Section S3.2). For *Petroleum refineries* (for both operation and construction jobs), we assume that, in effect, only half of the non-energy fossil-fuel use is processed at petroleum refineries. We assumed that all energy-sector output in the sector *Asphalt, paving, etc.* are retained (not foregone, or “lost”) in WWS scenario. We assume that most output and jobs in the sector *Gasoline stations with convenience stores* either are related to the convenience store, or else have a public-charging-station equivalent in the WWS scenario, and hence are not “lost.” We assume that half of the output (jobs) in the sector *Other gasoline stations* have a public-charging equivalent in the WWS scenario, and hence are not “lost.” We assume that all existing energy output in the sector *Electric power transmission and distribution* will be retained in the WWS scenario. For the sector *Auto oil shops and other auto repair*, we use estimates of relative maintenance and repair (m & r) costs for EVs (Delucchi et al., 2000) to estimate the fraction of m & r activities and jobs *not* needed for electric vehicles (e.g., for oil changes, pollution control, and engine coolant m & r). For the sector *Rail transportation, Water transportation, Truck transportation*, the fraction of energy-sector output foregone is equal to ton-miles moving coal or petroleum products divided by total ton-miles moved (U. S. Bureau of Transportation Statistics and U. S. Census Bureau, 2015), multiplied by 0.95 to account for non-energy uses of fossil fuels.

Multipliers for omitted pertinent jobs in base data

This multiplier accounts for jobs in the relevant sector that are not included in our base data. For the sector *Uranium mining*, this is the ratio of total world demand for uranium to total reported uranium production (WNA, 2016). For the sector *Power sector construction*, we assume that the IEA's estimates of total generation, from which we calculate the base-year total generating capacity, capture all relevant installed capacity, which means that the multiplier is 1.0.

In all other cases, we assume that our employment estimates capture all of the important jobs in the sector.

Multiplier for induced jobs

We use this multiplier to make sure that our estimates of jobs lost in the BAU scenario are consistent with our estimates of jobs in the WWS scenario.

To estimate construction and operations jobs in the WWS scenario, we use NREL's *JEDI* models (NREL, 2013) (see the next section). As discussed below, *JEDI* reports jobs in three categories: direct, indirect, and induced; for the WWS scenario, we include all three. Therefore, to ensure consistency, the estimates of jobs lost in the BAU scenario should include direct + indirect + jobs induced in the broader economy.

The first question is whether our base BLS CES data on BAU jobs in each sector include direct, direct+indirect, or direct+indirect+induced as defined by *JEDI*. It is clear that our base data include at least direct jobs, and do not include induced jobs. A comparison of our estimate of operations jobs for the petroleum-refinery sector (0.088 jobs/KTOE) with *JEDI* estimates (0.085 direct+indirect jobs/KTOE) suggests that our estimates also include what *JEDI* calls "indirect" jobs. Therefore, we assume that our estimates of BAU jobs in each sector *I* include direct *and* indirect jobs but not induced jobs as defined for *JEDI*. Therefore, for our estimates of BAU jobs to be consistent with our *JEDI*-based estimates of WWS jobs, we need to account for induced jobs in the BAU.

To estimate a general multiplier for induced jobs, we ran the *JEDI* models and calculated the ratio of total jobs (including induced jobs) to direct+indirect jobs. The results are shown in Table S43. For operations jobs lost in the sectors *petroleum refining*, *electric power generation*, and *electric power transmission*, we use the induced-job multiplier for the corresponding sector in Table S43. We assume that the multiplier for *electric power distribution* is the same as that for *electric power transmission*. For all of the other BAU operations-job-loss sectors (i.e., those not covered explicitly in Table S43), we assume that the induced-job multiplier is 1.25, which is an approximate average of the values in Table S43. Note that we do not apply the induced-job multiplier to BAU construction jobs for power plants or petroleum refineries because for these, as discussed elsewhere, we use *JEDI* estimates of total jobs including induced jobs.

Table S43. The induced-job multiplier from NREL’s *JEDI* models.

Project	Multiplier for induced jobs	
	Construction	Operation
Residential PV	1.27	1.12
Commercial PV	1.29	1.21
Utility PV	1.29	1.20
CSP trough plant	1.41	1.20
Offshore wind farm	1.55	1.35
Onshore wind farm	1.29	1.29
Conventional hydro plants	1.26	1.22
Geothermal plants	1.19	1.25
Marine and hydrokinetic wave plants	1.58	1.28
Coal power plant	1.40	1.31
Natural gas combined-cycle plant	1.27	1.13
Petroleum refinery	1.36	1.33
Transmission line, 345 kV AC, 644 km	1.22	1.22

Note: the multiplier for induced jobs is equal to total jobs estimated by *JEDI* (including jobs induced in the broader economy) divided by direct (on-site) and indirect (supply-chain) jobs.

Elasticity of jobs/energy w.r.t. changes in energy

As energy production increases, jobs/energy-unit presumably will decrease slightly because of economies of scale and efficiencies in the use of labor. We assume a value of -0.08.

Elasticity of jobs/energy w.r.t. changes in GDP/capita

Assuming that labor is used more intensively in poorer countries, then as GDP/capita increases, Jobs/energy-unit will decrease slightly because of substitution of capital for labor. Now, as shown above, the adjustment factor is equal to the GDP/capita ratio raised to an overall exponent, where the overall exponent is a lower exponent multiplied by the GDP/capita ratio raised to an upper exponent.

Note that here we estimate the effect of changes in GDP per capita with respect to the base year of the estimates of jobs/energy unit in the U. S. Table S44 shows how the overall adjustment factor $GDPC'_{C,TY}^{\wedge}$ varies with different values of $\gamma_{JOBS1}, \gamma_{JOBS2}$, and $GDPC'_{C,TY}$:

Table S44. Variation in $GDPC'_{C,TY}^{\wedge}$ with different values of $\gamma_{JOBS1}, \gamma_{JOBS2}$, and $GDPC'_{C,TY}$.

		$GDPC'_{C,TY}$													
γ_{JOBS2}	γ_{JOBS1}	3.50	2.75	2.00	1.50	1.20	0.80	0.50	0.40	0.25	0.20	0.15	0.10	0.05	0.02
-0.28	-0.30	0.77	0.80	0.84	0.90	0.95	1.07	1.29	1.43	1.85	2.13	2.63	3.73	8.00	33.4
-0.26	-0.30	0.76	0.79	0.84	0.90	0.95	1.07	1.28	1.42	1.82	2.08	2.54	3.51	7.09	25.7
-0.24	-0.30	0.76	0.79	0.84	0.90	0.95	1.07	1.28	1.41	1.79	2.03	2.45	3.32	6.32	20.1
-0.23	-0.30	0.75	0.79	0.84	0.90	0.95	1.07	1.28	1.40	1.77	2.01	2.41	3.23	5.99	17.9
-0.22	-0.30	0.75	0.78	0.84	0.89	0.95	1.07	1.27	1.40	1.76	1.99	2.37	3.15	5.68	16.0
-0.21	-0.30	0.75	0.78	0.84	0.89	0.95	1.07	1.27	1.40	1.74	1.97	2.33	3.07	5.40	14.4
-0.20	-0.30	0.75	0.78	0.83	0.89	0.95	1.07	1.27	1.39	1.73	1.95	2.30	2.99	5.14	13.0
-0.33	-0.25	0.81	0.83	0.87	0.92	0.96	1.06	1.24	1.36	1.73	1.98	2.43	3.42	7.48	35.0

-0.30	-0.25	0.81	0.83	0.87	0.91	0.96	1.06	1.24	1.35	1.69	1.92	2.31	3.15	6.29	23.6
-0.28	-0.25	0.80	0.83	0.87	0.91	0.96	1.06	1.23	1.34	1.67	1.88	2.24	2.99	5.66	18.6
-0.26	-0.25	0.80	0.82	0.87	0.91	0.96	1.06	1.23	1.34	1.64	1.84	2.17	2.85	5.11	14.9
-0.25	-0.25	0.80	0.82	0.86	0.91	0.96	1.06	1.23	1.33	1.63	1.83	2.14	2.78	4.87	13.5
-0.23	-0.25	0.79	0.82	0.86	0.91	0.96	1.06	1.23	1.33	1.61	1.79	2.08	2.66	4.44	11.1
-0.22	-0.25	0.79	0.82	0.86	0.91	0.96	1.06	1.22	1.32	1.60	1.77	2.05	2.60	4.25	10.1
-0.38	-0.20	0.86	0.87	0.90	0.93	0.97	1.05	1.20	1.30	1.60	1.81	2.18	3.02	6.49	31.8
-0.36	-0.20	0.85	0.87	0.90	0.93	0.97	1.05	1.19	1.29	1.58	1.78	2.12	2.87	5.82	24.5
-0.34	-0.20	0.85	0.87	0.90	0.93	0.97	1.05	1.19	1.28	1.56	1.74	2.06	2.74	5.25	19.3
-0.32	-0.20	0.85	0.86	0.89	0.93	0.97	1.05	1.19	1.28	1.54	1.71	2.01	2.62	4.77	15.4
-0.30	-0.20	0.84	0.86	0.89	0.93	0.97	1.05	1.19	1.27	1.52	1.68	1.95	2.51	4.36	12.6
-0.29	-0.20	0.84	0.86	0.89	0.93	0.97	1.05	1.18	1.27	1.51	1.67	1.93	2.45	4.17	11.4
-0.28	-0.20	0.84	0.86	0.89	0.93	0.97	1.05	1.18	1.27	1.50	1.66	1.91	2.40	4.00	10.4
-0.42	-0.17	0.88	0.89	0.92	0.94	0.97	1.04	1.17	1.26	1.52	1.71	2.05	2.80	6.00	31.2
-0.40	-0.17	0.88	0.89	0.91	0.94	0.97	1.04	1.17	1.25	1.51	1.68	1.99	2.67	5.41	24.0
-0.38	-0.17	0.88	0.89	0.91	0.94	0.97	1.04	1.17	1.25	1.49	1.66	1.94	2.56	4.90	18.9
-0.37	-0.17	0.87	0.89	0.91	0.94	0.97	1.04	1.16	1.24	1.48	1.64	1.92	2.50	4.68	16.9
-0.36	-0.17	0.87	0.89	0.91	0.94	0.97	1.04	1.16	1.24	1.47	1.63	1.89	2.45	4.47	15.2
-0.35	-0.17	0.87	0.89	0.91	0.94	0.97	1.04	1.16	1.24	1.47	1.62	1.87	2.40	4.28	13.7
-0.34	-0.17	0.87	0.89	0.91	0.94	0.97	1.04	1.16	1.24	1.46	1.60	1.85	2.35	4.10	12.4
-0.47	-0.14	0.91	0.92	0.93	0.95	0.98	1.04	1.14	1.22	1.45	1.62	1.91	2.59	5.55	31.3
-0.44	-0.14	0.90	0.91	0.93	0.95	0.98	1.04	1.14	1.21	1.43	1.58	1.84	2.43	4.79	21.4
-0.42	-0.14	0.90	0.91	0.93	0.95	0.98	1.03	1.14	1.21	1.42	1.56	1.80	2.33	4.38	17.0
-0.40	-0.14	0.90	0.91	0.93	0.95	0.98	1.03	1.14	1.20	1.40	1.54	1.76	2.25	4.02	13.7
-0.38	-0.14	0.90	0.91	0.93	0.95	0.98	1.03	1.13	1.20	1.39	1.51	1.73	2.17	3.70	11.3
-0.37	-0.14	0.90	0.91	0.93	0.95	0.98	1.03	1.13	1.20	1.38	1.50	1.71	2.13	3.56	10.3
-0.36	-0.14	0.89	0.91	0.93	0.95	0.98	1.03	1.13	1.20	1.38	1.50	1.69	2.09	3.43	9.4
-0.57	-0.10	0.94	0.94	0.95	0.97	0.98	1.03	1.11	1.17	1.36	1.50	1.75	2.35	5.22	38.0
-0.55	-0.10	0.94	0.94	0.95	0.97	0.98	1.03	1.11	1.16	1.35	1.48	1.71	2.26	4.74	28.9
-0.52	-0.10	0.94	0.94	0.95	0.97	0.98	1.03	1.10	1.16	1.33	1.45	1.66	2.14	4.15	19.9
-0.50	-0.10	0.94	0.94	0.95	0.97	0.98	1.03	1.10	1.16	1.32	1.43	1.63	2.07	3.82	15.9
-0.48	-0.10	0.93	0.94	0.95	0.97	0.98	1.03	1.10	1.15	1.31	1.42	1.60	2.00	3.53	12.9
-0.46	-0.10	0.93	0.94	0.95	0.97	0.98	1.03	1.10	1.15	1.30	1.40	1.57	1.94	3.28	10.6
-0.45	-0.10	0.93	0.94	0.95	0.97	0.98	1.02	1.10	1.15	1.30	1.39	1.56	1.91	3.17	9.7
-0.75	-0.05	0.98	0.98	0.98	0.99	0.99	1.01	1.06	1.10	1.22	1.31	1.48	1.91	4.12	39.6

-0.73	-0.05	0.98	0.98	0.98	0.99	0.99	1.01	1.06	1.09	1.21	1.30	1.46	1.86	3.80	30.0
-0.71	-0.05	0.97	0.98	0.98	0.98	0.99	1.01	1.06	1.09	1.20	1.29	1.44	1.80	3.51	23.2
-0.70	-0.05	0.97	0.98	0.98	0.98	0.99	1.01	1.06	1.09	1.20	1.28	1.43	1.78	3.39	20.6
-0.69	-0.05	0.97	0.98	0.98	0.98	0.99	1.01	1.06	1.09	1.20	1.28	1.42	1.76	3.27	18.3
-0.67	-0.05	0.97	0.97	0.98	0.98	0.99	1.01	1.06	1.09	1.19	1.27	1.40	1.71	3.05	14.7
-0.65	-0.05	0.97	0.97	0.98	0.98	0.99	1.01	1.06	1.09	1.19	1.26	1.38	1.67	2.86	12.0

The combination of $\gamma_{JOBS1} = -0.25$ and $\gamma_{JOBS2} = -0.25$, shaded reddish in Table S44, gives what we think are the most reasonable values of $GDP_{C,TY}^{\wedge}$.

It is possible that our method underestimates job losses in the BAU in some countries with a very large pool of relatively low paid laborers, such as China. For example, IRENA (2016b) reports an estimate that the fossil-fuel sector in China supports around 8 million jobs, more than double our estimate. However, to the extent that the reasons for this underestimation pertain also to our estimate of jobs *created* in the WWS scenario, we will have underestimated jobs created as well. In support of this, we note that according to IRENA (2015b), in 2014 China employed about 1.3 million people to manufacture 34 GW of solar PV systems – about 38 jobs per MW. This is roughly double the JEDI estimate that we use (excluding, for this comparison, induced jobs).

If there is constant underestimation factor in both scenarios, then we have underestimated *net* jobs created, and hence have underestimated the benefits of the WWS scenario.

Comparison with other estimates

As mentioned above, our estimate of operations jobs in the petroleum-refinery sector is very close to the *JEDI* model estimate of direct+indirect operations jobs for a petroleum refinery. In addition, the BLS-CES estimate of 24,700 operations jobs in the sector *Electric bulk power transmission and control* in 2012 is within the range of 16,400 to 31,200 direct+indirect operations jobs based on *JEDI* model estimates of 0.082 direct+indirect operations jobs per mile of high-voltage AC line and 200,000 miles (Weeks, 2010) to 380,000 miles (Harris Williams & Co., 2014; they give a figure of 450,000 for all of North America) of high-voltage transmission line in the U. S.

IRENA (2016b) uses the econometric model E3ME to estimate the differences in total employment between a reference global energy scenario and two global scenarios with higher penetration of renewable energy, REmap and REmapE. The reference scenario is based on existing legislation in official country plans. In both high-renewable scenarios the global share of renewables in 2030 is double the 2010 share (reaching 36% of total final energy consumption); in the REmapE scenario, greater emphasis is placed on electrification of heating and transport (IRENA, 2016b, p. 18). IRENA (2016b) finds that the REmapE scenario has about 1 million fewer fossil-fuel and nuclear-industry jobs but about 9 million more renewable-energy jobs than does the reference scenario, for a net gain of over 8 million jobs. This is very broadly consistent, given the difference in scenarios, with our

estimate of about 24.3 million net new permanent, full-time jobs, mainly in construction, in a 100% WWS scenario.

Changes in earnings due to changes in jobs

Changes in earnings are the product of changes in the number of jobs and the relevant wage rate. Here we distinguish between operations jobs and construction jobs as follows:

$$ER_{BAU,C,TY} = J_{T_{operations},C,TY} \cdot W_{operations,C,TY} + J_{T_{construction},C,TY} \cdot W_{construction,C,ave-TY}$$

where

$J_{T_{operations},C,TY}$ = Total number of BAU operations jobs foregone in country C in year TY
(discussed above)

$J_{T_{construction},C,TY}$ = Total number of BAU construction jobs foregone in country C in year TY
(discussed above)

$W_{operations,C,TY}$ = Wages for operations jobs in country C in year TY (discussed below)

$W_{construction,C,TY}$ = Wages for construction jobs in country C in year TY (discussed below)

Wage rate

We estimate wages in country C relative to wages in the U. S., assuming that relative wages are a function of the GDP/capita in country C relative to the GDP/capita in the U. S. Dropping the subscripts for “construction” and “operation” for succinctness of exposition:

$$\frac{W_{C,TY}}{W_{US,TY}} = \left(\frac{GDPC_{C,TY}}{GDPC_{US,TY}} \right)^{\gamma_{WAGE-INT}}$$

$$GDPC'_{C,TY} \equiv \frac{GDPC_{C,TY}}{GDPC_{US,TY}}$$

$$W_{C,TY} = W_{US,TY} \cdot GDPC'_{C,TY}^{\gamma_{WAGE-INT}}$$

where

$W_{C,TY}$ = The real wage rate in country C in the year TY

$W_{US,TY}$ = The real wage rate in the U.S. in the year TY (discussed below)

$GDPC_{C,TY}$ = GDP/capita in country C in year TY (see discussion of GDP/capita elsewhere)

$GDPC_{US,TY}$ = GDP/capita in the U.S. in year TY (see discussion of GDP/capita elsewhere)

$\gamma_{WAGE-INT}$ = Exponent determining how the GDP/capita in country C relative to that in the U. S. affects the wage rate in country C relative to the rate in the U. S. (discussed below)

$GDPC'_{C,TY}$ = The real GDP/capita ratio for country C w.r.t to the U.S.

The real wage rate in the U. S. in TY is a function of the wage rate in a base year BY and changes in the real U. S. GDP/capita from BY to TY :

$$W_{US,TY} = W_{US,BY} \cdot GDPC'_{US,TY/BY}^{\gamma_{WAGE-US}}$$

where

$W_{US,BY}$ = The annual wage rate in the U. S. in the base year BY (we assume \$70,000/year in base year 2012, for construction jobs and operations jobs)

$GDPC'_{US,TY/BY}$ = The ratio of real U. S. GDP/capita in year TY to that in year BY (see discussion of GDP/capita elsewhere)

$\gamma_{WAGE-US}$ = Exponent determining how changes in U. S. GDP /capita affect the wage rate in the U. S.; we assume that changes in the real wage rate are nearly proportional to changes in GDP/capita ($\gamma_{WAGE-US} = 0.95$)

The exponent ($\gamma_{WAGE-INT}$) that determines how the GDP/capita in country C relative to that in the U. S. affects the wage rate in country C relative to the rate in the U. S. is itself a nonlinear function of the relative GDP/capita. We assume that the lower the GDP/capita, the more sensitive the wage rate is to the relative GDP/capita; hence, the lower the GDP/capita, the higher the value of the $\gamma_{WAGE-INT}$. Formally,

$$\gamma_{WAGE-INT} = \gamma_{WAGE1} \cdot GDPC'_{C,TY}^{\gamma_{WAGE2}}$$

where

γ_{WAGE1} , γ_{WAGE2} = Parameters that determine the value of $\gamma_{WAGE-INT}$; we assume $\gamma_{WAGE1} = 0.80$ and $\gamma_{WAGE2} = 0.10$.

Table S45 provides a summary among 139 countries of job losses in the oil, gas, coal, nuclear, and bioenergy industries. Job loss is calculated as the product of jobs per unit energy in each employment category and total energy use. Total energy use is the product of energy use in 2012 from IEA World Energy Balances, by country, and the ratio of energy use in the target year to energy use in 2012 (from IEO projections by region, extrapolated past 2040, and mapped to individual countries). Jobs per unit energy are calculated as the product of jobs per unit energy unit in the U.S. in 2012, the fraction of conventional-fuel jobs lost due to converting to WWS (Table S45), a multiplier for jobs associated with the jobs lost but not counted elsewhere, and country-specific adjustment factors accounting for the relationship between jobs per unit energy and GDP per capita and total energy use. Calculations are detailed in Delucchi et al. (2016).

The fraction of fossil-fuel jobs lost in each job sector (Table S45) accounts for the retention of some jobs for non-energy uses of fossil fuels (e.g., some petroleum products will still be

used as lubricants, asphalt, petrochemical feedstock, and petroleum coke) and transportation of goods other than fossil fuels.

Job losses include construction jobs lost from not building future fossil, nuclear, and bio-power plants because WWS plants are built instead. Job losses from not replacing existing conventional plants are not treated to be consistent with the fact that jobs created by replacing WWS plants with other WWS plants are not treated.

The shift to WWS is estimated to result in the loss of ~27.7 million jobs in the current fossil fuel, biofuel, and nuclear industries in the 139 countries. The job loss represents ~1% of the total workforce in the 139 countries.

Table S45. Estimated 139-country job losses due to eliminating energy generation and use from the fossil fuel and nuclear sectors. Also shown is the percent of total jobs in the sector that are lost. Not all fossil-fuel jobs are lost due to non-energy uses of petroleum, such as lubricants, asphalt, petrochemical feedstock, and petroleum coke. For transportation sectors, the jobs lost are those due to transporting fossil fuels; the jobs not lost are those for transporting other goods.

Energy sector	Jobs lost in sector	Percent of jobs in sector that are lost
Oil and gas extraction	2,783,000	89
Coal mining	969,000	96
Uranium mining	99,400	100
Support for oil and gas	4,179,000	89
Oil and gas pipeline construction	1,890,000	89
Mining & oil/gas machinery	1,348,000	89
Petroleum refining	689,000	94
Asphalt paving and roofing materials	0	0
Gas stations with stores	1,719,000	30
Other gas stations	407,000	50
Fossil electric power generation utilities	1,021,000	100
Fossil electric power generation non-utilities	184,000	100
Nuclear and other power generation	1,299,000	100
Natural gas distribution	1,306,000	100
Auto oil change shops/other repair	57,300	10
Rail transportation of fossil fuels	634,000	52
Water transportation of fossil fuels	264,600	23
Truck transportation of fossil fuels	836,000	8
Bioenergy except electricity	6,524,000	100
Total current jobs lost	26,209,000	
^h Jobs lost from not growing fossil fuels	1,535,000	
All jobs lost	27,744,000	
^l Total labor force	2.87 billion	
Jobs lost as percent of labor force	0.97%	

^aSee this section and Delucchi et al. (2016) for detailed calculations and referencing.

^bJobs lost from not growing fossil fuels are additional refinery and electric power construction and operation jobs that would have accrued by 2050 if BAU instead of WWS continued.

^cThe total labor force in each country is obtained from World Bank (2015a).

S9.3. Net Change in Permanent, Full-Time Jobs by Country due to 100% WWS

Subtracting the number of jobs lost across the 139 countries from the number of jobs created gives a net of ~24.3 million permanent, full-time jobs created due to WWS. Although all countries together are expected to gain jobs, some countries, particularly those that currently extract significant fossil fuels (e.g., Algeria, Angola, Iraq, Kuwait, Libya, Qatar, and Saudi Arabia) may experience net job loss in the energy production sector. However, such job loss in many of those countries can potentially be made up in the manufacture and service of storage technologies, hydrogen technologies, electric vehicles, electric heating and cooling appliances, and industrial heating equipment, although such job creation numbers were not determined here.

The direct and indirect earnings from producing WWS electricity amount to ~\$1.86 trillion/yr during construction and ~\$2.06 trillion/yr during operation. The annual earnings lost from the fossil-fuel industries total ~\$2.06 trillion/yr giving a net gain in annual earnings of ~\$1.86 trillion/yr.

Section S10. Timeline for Transitioning and Impacts on Global Temperatures

Figure 2 of the main text shows the mean proposed timeline for the complete transformation of the energy infrastructures of the 139 countries considered here. The timeline assumes 100% WWS by 2050, with 80% WWS by 2030. To meet this timeline, rapid transitions are needed in each technology sector. Whereas, much new infrastructure can be installed upon retirement of existing infrastructure or devices, other transitions will require aggressive policies (Section S11) to meet the timeline. Below is a list of proposed transformation timelines for individual sectors.

Development of super grids and smart grids: As soon as possible, countries should develop long-term power-transmission-and-distribution systems to provide “smart” management of energy demand and supply at all scales, from local to international (e.g., Smith et al., 2013; Blarke and Jenkins, 2013; Elliott, 2013).

Power plants: by 2020, no more construction of new coal, nuclear, natural gas, or biomass fired power plants; all new power plants built are WWS.

Heating, drying, and cooking in the residential and commercial sectors: by 2020, all new devices and machines are powered by electricity.

Large-scale waterborne freight transport: by 2020-2025, all new ships are electrified and/or use electrolytic hydrogen, all new port operations are electrified, and port retro-electrification is well underway. This should be feasible for relatively large ships and ports because large ports are centralized and few ships are built each year. Policies may be needed to incentivize the early retirement of ships that do not naturally retire before 2050.

Rail and bus transport: by 2025, all new trains and buses are electrified. This requires changing the supporting energy-delivery infrastructure and the manufacture method of transportation equipment. However, relatively few producers of buses and trains exist, and the supporting energy infrastructure is concentrated in cities.

Off-road transport, small-scale marine: by 2025 to 2030, all new production is electrified.

Heavy-duty truck transport: by 2025 to 2030, all new heavy-duty trucks and buses are BEVs or BEV-HFC hybrids.

Light-duty on-road transport: by 2025-2030, all new light-duty onroad vehicles are BEVs.

Short-haul aircraft: by 2035, all new small, short-range aircraft are BEVs or BEV-HFC hybrids.

Long-haul aircraft: by 2040, all remaining new aircraft are BEV-HFC hybrids.

Whereas, much new WWS infrastructure can be installed upon natural retirement of BAU infrastructure, new policies (e.g., Section S11) are needed to force remaining existing infrastructure to retire early to allow the complete conversion to WWS. Because the annual air-pollution and climate-impact benefits (avoided costs), as quantified here, resulting from closing BAU plants early far exceed the annualized remaining *net* asset value of such plants (the difference between the annualized capital cost and the annualized salvage or re-use value), and because net jobs increase upon replacing BAU plants, shuttering them early results in large net benefits to society.

During the transition, conventional fuels and existing WWS technologies are needed to produce the remaining WWS infrastructure. However, much of the conventional energy would be used in any case to produce conventional power plants and automobiles if the plans proposed here were not implemented. Further, as the fraction of WWS energy increases, conventional energy generation will decrease, ultimately to zero, at which point all new WWS devices will be produced with existing WWS. In sum, the creation of WWS infrastructure may result in a temporary increase in emissions before they are ultimately reduced to zero.

Impacts on global temperatures:

The WWS roadmaps proposed here will eliminate energy-related emissions of carbon dioxide (CO₂), black carbon (BC), and methane (CH₄), the first through third leading causes of global warming, respectively. They will also reduce tropospheric ozone (O₃) precursors, carbon monoxide (CO), and nitrous oxide (N₂O). Ozone, CO, and N₂O are all greenhouse gases.

The global surface temperature change due to greenhouse gases is thought to be linearly proportional to cumulative carbon emissions, regardless of the timing of those emissions (e.g., Allen et al., 2009; Matthews et al., 2009; Meinhausen et al., 2009).

Currently, global greenhouse gas emissions are increasing with a low-mitigation business-as-usual trajectory. If this trajectory continues, global temperatures are expected to rise 2 °C above those in 1870 by 2035-2060 and 4.5 +/-1.2 °C by 2100 (IPCC, 2014).

Friedlingstein et al. (2014) estimate that, for the globally-averaged temperature change since 1870 to increase by less than 2 °C with a 67% probability, cumulative emissions since 1870 must be kept below 3200 (2900-3600) Gt-CO₂. This accounts for non-CO₂ forcing agents in the temperature response and being reduced proportionately with CO₂. The cumulative emission limit to keep warming below 2°C with a 50% probability is 3500 (3100-3900) Gt-CO₂. Matthews (2016) estimated (by scaling the 2 °C numbers by 1.5°C/2°C) that the corresponding limits to keeping temperatures under 1.5°C are 2400 Gt-CO₂ (67% probability) and 2625 Gt-CO₂ (50% probability).

As of the end of 2015, ~2050 Gt-CO₂ from fossil-fuel combustion, cement manufacturing, and land use change had already been emitted cumulatively since 1870 (Le Quere et al., 2015; Matthews, 2016), suggesting no more than 350-575 Gt-CO₂ can be emitted for a 67-50% probability of keeping warming since 1870 under 1.5°C, and 1150-1450 Gt-CO₂ can be emitted for a 67-50% probability of keeping warming under 2°C.

In 2014, global CO₂ emissions from fossil-fuel burning and cement production were ~35.9 Gt-CO₂ and those from land use change were. ~4.0 Gt-CO₂, for a total of 39.9 Gt-CO₂ (Le Quere et al., 2015). Assuming the same emissions in 2015 but a linear 80% decrease in emissions between 2016 and 2030 and the remaining 20% decrease by 2050 results in an additional cumulative 419 Gt-C emitted to the atmosphere, in the range of the maximum allowable to keep warming under 1.5°C. This calculation assumes that the energy required to obtain materials (including raw materials such as minerals and ores) for and manufacture WWS equipment, vehicles, and plants is the same as in the BAU scenario. Although the manufacturing energy intensity of some WWS technologies can be higher than that of some BAU technologies (in total kJ of manufacturing [including mining] energy required per total kJ of output over the lifetime of the technology), the WWS scenario requires less total output capacity than does the BAU, because energy demand in the WWS scenario is ~42.5% less than in the BAU scenario worldwide (Table 1). We believe that on balance any difference in manufacturing energy between the BAU and the WWS scenario is likely to be very small, and hence our assumption of no difference is reasonable. However, in order to meet an 80% WWS by 2030 goal, some BAU power plants, for example, will need to be phased out early. This may result in more energy needed thus CO₂ emissions for infrastructure manufacturing in the short run but not necessarily in the long run in the WWS case. In any case, as the WWS penetration approaches 100%, lifecycle emissions converge to zero, whereas they don't in the BAU case.

The calculation here suggests that aggressive policies that strive to reduce CO₂ and other global warming agents (greenhouse gases and dark particles) emissions by 80% by 2030 and 100% by 2050 can limit warming to 1.5 °C with a probability of between 50% and 67%. This requires emission reductions not only in the energy sector but also in sectors involving land-use change, agricultural emissions, and halocarbon emissions. In this respect, we note that our energy plan, which does not rely on bioenergy, makes it possible to maximize the

environmental benefits of restoring and rehabilitating degraded land, which otherwise might be used for bioenergy production.

Section S11. Recommended First Steps and Possible Policies

The policy pathways necessary to transform the 139 countries treated here to 100% WWS will differ by country, depending largely on the willingness of the government and people in each country to affect rapid change. This study does not advocate specific policy measures for any country. Instead, it provides a set of policy options that each country can consider. The list is by no means complete. Within each section, the policy options are listed roughly in order of proposed priority.

S11.1. Energy Efficiency Measures

- Expand clean, renewable energy standards and energy efficiency standards.
- Incentivize conversion from natural gas water and air heaters to electric heat pumps (air and ground-source) and rooftop solar thermal hot water pre-heaters.
- Promote, though municipal financing, incentives, and rebates for implementing energy efficiency measures in buildings and other infrastructure. Efficiency measures include, but are not limited to, using LED lighting; evaporative cooling; ductless heating and air conditioning; adding energy-storing materials to walls and floors to modulate temperature changes; water-cooled heat exchanging; night ventilation cooling; combined space and water heating; improved data center design; improved air flow management; advanced lighting controls; variable refrigerant flow; improved wall, floor, ceiling, and pipe insulation; double- and triple-paned windows; and passive solar heating. Additional measures include sealing windows, doors, and fireplaces; and monitoring/auditing building energy use to identify wasted energy.
- Revise building codes to incorporate “green building standards” based on best practices for building design, construction, and energy use.
- Incentivize landlord investment in energy efficiency. Allow owners of multi-family buildings to take a property tax exemption for energy efficiency improvements in their buildings that provide benefits to their tenants.
- Create energy performance rating systems with minimum performance requirements to assess energy efficiency levels and pinpoint areas of improvement.
- Create a green building tax credit program for the corporate sector.

S11.2. Energy Supply Measures

- Increase Renewable Portfolio Standards (RPSs).
- Extend or create state WWS production tax credits.

- Streamline the permit approval process for large-scale WWS power generators and high-capacity transmission lines. Work with local and regional governments to manage zoning and permitting issues within existing planning efforts or pre-approve sites to reduce the cost and uncertainty of projects and expedite their physical build-out.
- Streamline the small-scale solar and wind installation permitting process. Create common codes, fee structures, and filing procedures across a country.
- Lock in fossil fuel and nuclear power plants to retire under enforceable commitments. Implement taxes on emissions by current utilities to encourage their phase-out. Invest in job retraining.
- Incentivize clean-energy backup emergency power systems rather than diesel/gasoline generators at both the household and community levels.
- Incentivize home or community energy storage (through garage electric battery systems, for example) that accompanies rooftop solar to mitigate problems associated with grid power losses.

S11.3. Utility Planning and Incentive Structures

- Incentivize community seasonal heat storage underground using the Drake Landing solar community as an example.
- Incentive the development of utility-scale grid electric power storage, such as in CSP, pumped hydropower, and more efficient hydropower.
- Require utilities to use demand response grid management to reduce the need for short-term energy backup on the grid.
- Incentivize the use of excess WWS electricity to produce hydrogen to help manage the grid.
- Develop programs to use EV batteries, after the end of their useful life in vehicles, for local, short-term storage and balancing.
- Implement virtual net metering (VNM) for small-scale energy systems.

S11.4. Transportation

- Promote more public transit by increasing its availability and providing compensation to commuters for not purchasing parking passes.
- Increase safe biking and walking infrastructure, such as dedicated bike lanes, sidewalks, crosswalks, timed walk signals, etc.

- Adopt legislation mandating BEVs for short- and medium distance government transportation and use incentives and rebates to encourage the transition of commercial and personal vehicles to BEVS.
- Use incentives or mandates to stimulate the growth of fleets of electric and/or hydrogen fuel cell/electric hybrid buses starting with a few and gradually growing the fleets. Additionally, incentivize electric and hydrogen fuel cell ferries, riverboats, and other local shipping.
- Adopt zero-emission standards for all new on-road and off-road vehicles, with 100% of new production required to be zero-emission by 2030.
- Ease the permitting process for installing electric charging stations in public parking lots, hotels, suburban metro stations, on streets, and in residential and commercial garages.
- Set up time-of-use electricity rates to encourage charging at night.
- Incentivize the electrification of freight rail and shift freight from trucks to rail.

S11.5. Industrial Processes

- Provide financial incentives for industry to convert to electricity and electrolytic hydrogen for high temperature and manufacturing processes.
- Provide financial incentives to encourage industries to use WWS electric power generation for on-site electric power (private) generation.

Section 12. Summary

Roadmaps are presented for converting the energy systems for all purposes (electricity, transportation, heating/cooling, industry, and agriculture/forestry/fishing) of 139 countries into clean and sustainable ones powered by wind, water, and sunlight (WWS).

For each country, the study estimates 2050 BAU power demand from recent-year data, assumes each load sector is electrified with primarily existing technologies, assumes that the electricity will be provided with WWS technologies, then proposes a mix of WWS generators within each country that can match the estimated 2050 all-sector power demand.

A major conclusion is that the 2050 conversion from BAU combustion to WWS electricity for all purposes reduces 139-country-averaged end-use load by ~42.5%, with 23.0% because of the higher work:energy ratio of WWS electricity over combustion 12.6% because WWS requires no mining, transporting, or processing of fuels, and 6.9% because WWS end-use efficiency exceeds BAU's.

Remaining all-purpose annually averaged end-use 2050 load over the 139 countries is proposed to be met with ~1.6 million new onshore 5-MW wind turbines (providing 23.5% of 139-country power for all purposes), 935,000 off-shore 5-MW wind turbines (13.6%),

251,000 50-MW utility-scale solar-PV power plants (21.4%), 21,500 100-MW utility-scale CSP power plants with storage (9.7%), 1.84 billion 5-kW residential rooftop PV systems (14.9%), 75.0 million 100-kW commercial/government rooftop systems (11.6%), 840 100-MW geothermal plants (0.67%), 410,000 0.75-MW wave devices (0.58%), 30,000 1-MW tidal turbines (0.06%), and 0 new hydropower plants. The capacity factor of existing hydropower plants will increase slightly so that hydropower supplies 4.0% of all-purpose power. Another estimated 12,900 100-MW CSP plants with storage and 84,500 50-MW solar thermal collectors for heat generation and storage will be needed to help stabilize the grid. This is just one possible mix of generators.

The additional footprint on land for WWS devices is equivalent to about 0.22% of the 139-country land area, mostly for utility scale PV. This does not account for land gained from eliminating the current energy infrastructure. An additional on-land spacing area of about 0.92% for the 139 countries is required for onshore wind, but this area can be used for multiple purposes, such as open space, agricultural land, or grazing land.

The 2013 LCOE for hydropower, onshore wind, utility-scale solar, and solar thermal for heat is already similar to or less than the LCOE for natural gas combined-cycle power plants. Rooftop PV, offshore wind, tidal, and wave presently have higher LCOEs. However, by 2050 the LCOE for all WWS technologies is expected to drop, most significantly for offshore wind, tidal, wave, rooftop PV, CSP, and utility PV, whereas conventional fuel costs are expected to rise.

The 139-country roadmaps are anticipated to create ~25.4 million new permanent, full-time construction jobs and ~26.6 million new permanent, full-time operation jobs for the energy facilities alone, the combination of which would outweigh by ~24.3 million the ~27.7 million jobs lost in the conventional energy sector.

The 139-country roadmaps will eliminate ~4.6 (1.3-8.0) million premature air pollution mortalities per year today and ~3.5 (0.84-7.4) million/yr in 2050, avoiding ~\$23 (\$4.1-\$69) trillion/yr in 2050 air-pollution damage costs (2013 USD).

Converting will further eliminate ~\$28.5 (16.1-60.7) trillion/year in 2050 global warming costs (2013 USD) due to 139-country greenhouse-gas and particle emissions.

These plans will result in the average person in 2050 saving ~\$85/yr in fuel costs compared with conventional fuels, ~2,600/yr (12.7 ¢/kWh-BAU-all-energy) in air-pollution damage costs, and ~\$3,200/yr (15.8 ¢/kWh-BAU-all-energy) in climate costs (2013 USD).

Many uncertainties in the analysis here are captured in broad ranges of energy, health, and climate costs given. However, these ranges may miss costs due to limits on supplies caused by wars or political/social opposition to the roadmaps. As such, the estimates should be reviewed periodically.

The timeline for conversion is proposed as follows: 80% of all energy to be WWS by 2030 and 100% by 2050. As of the end of 2015, only 4.26% of the installed capacity needed had

been installed among the 139 countries examined. Because the annual air-pollution and climate-impact avoided costs quantified here resulting from closing BAU plants early far exceed the annualized remaining net asset value of such plants, and because net jobs increase upon replacing BAU plants, closing them early results in large net benefits to society.

The major benefits of a conversion are the near-elimination of air pollution mortality and morbidity and global warming, net job creation, energy-price stability, reduced international conflict over energy because each country will largely be energy self-sufficient, increased access to distributed energy by up to 4 billion people worldwide who currently collect their own energy and burn it (2.7 billion people) or who have no access to energy (1.3 billion people), and reduced risks of large-scale system disruptions through power outage or terrorism because much of the world power supply will be decentralized. Finally, the aggressive worldwide conversion to WWS proposed here will avoid exploding levels of CO₂, thus potentially avoid 1.5 °C of net global warming since 1870.

The study finds that the conversion to WWS is technically and economically feasible. The main barriers are still social and political.

Appendices

Appendix S1. Future Scenario of GDP per capita

Background

The Gross Domestic Product (GDP) per capita is an important factor in many estimates in our analysis, including estimates of energy use, the estimation of the potential for rooftop photovoltaics, the value of statistical life, jobs in the BAU scenario, and more.

We estimate GDP per capita in real U.S. dollars, converted from each country's currency on the basis of Purchasing Power Parity (PPP). The PPP-based conversion to U.S. dollars expresses how much of a country's currency is needed to buy the amount of a given basket of goods that one dollar buys in the U.S. There are a number of theoretical and practical difficulties in constructing PPP indices, mainly because international variations in consumption patterns and in the quality of nominally similar goods and services make it difficult to construct a reference basket of goods (Deaton and Heston, 2010). Nonetheless, PPP-based conversions are better than market exchange rates because they are meant to hold consumption (and hence, partly at least, utility) constant. GDP-per-capita estimates based on PPP have much less inter-country variation than do estimates based on market exchange rates.

Historical estimates of GDP per capita

For most countries, we use the World Bank's World Development Indicators of GDP per capita, in PPP-based constant year-2011 international dollars, for the period 1990 to 2015 (World Bank, 2016c.) For countries for which the World Bank does not have estimates, we estimate the year-2011 GDP per capita as follows:

Argentina and Myanmar: year-2011 current-dollar PPP-based estimate from the International Monetary Fund (IMF, 2015). We use year 2011 because the IMF uses current international dollars, and the World Bank uses constant 2011 international dollars. Note that the IMF estimates generally are similar to the World Bank estimates.

Syria: year-2010 current-dollar estimate from the IMF, converted to year-2011 by multiplying by the ratio of the year-2010 to year-2009 GDP price deflator for Syria, from the same IMF source.

Chinese Taipei (Taiwan): year-2011 current-dollar estimate from the IMF.

Gibraltar (year 2008) and North Korea (year 2013): PPP-based estimates from the CIA *World Factbook* (CIA, 2016b), scaled to year-2011 dollars assuming a GDP price-deflator change of 3%/year.

Netherland Antilles: year-2007 PPP-based estimate from Wikipedia (2016a), scaled to year-2011 dollars assuming a GDP price deflator change of 3%/year.

For all of those countries except *Chinese Taipei (Taiwan)*, we estimate GDP per capita for other years in the period 2005 to 2014 by scaling the country-specific values by the ratio of regional values estimated in the EIA's *IEO*, as discussed next. For *Chinese Taipei (Taiwan)*, we use current-dollar estimates from the IMF, for the period 2005 to 2014, and convert to year-2011 dollars with the GDP price deflator index in the IMF. For Taiwan we use IMF estimates through 2014 rather than use IMF data for 2011 and then scale to other years using EIA *IEO* regional projections because we feel the EIA *IEO* regional projections are too high for Taiwan specifically.

To fill in gaps in the World Bank data for the period 1990 to 2004 (i.e., prior to 2005, which is the earliest year of the EIA *IEO* regional projections), we use a ten-year moving linear back-extrapolation, except when that extrapolation results in unreasonably low values: for Bosnia and Herzegovina 1990 to 1993 (we use the 1994 value); Myanmar 1990 to 1996 (we use the 1997 value); Syria 1990 to 2004 (we use the 2005 value), Kosovo 1990 to 1992 (we use the 1993 value); and Taiwan 1990 to 1999 (we use the 2000 value).

Projections

The EIA's *IEO* projects PPP-based GDP per capita for 16 regions of the world through the year 2040 (EIA, 2016a). We extend these projections to the year 2075 using a 10-year moving linear extrapolation. We project future GDP per capita for each country on the basis of the projected change in GDP per capita for the region of which the country is a part. We apply an exponent that accounts for the likelihood that countries with a GDP per capita below the regional GDP per capita will have a growth rate slightly above the regional growth rate, and vice versa. Formally,

Assume

$$\frac{GDPC_{C,Y}}{GDPC_{R:C \in R,Y}} = \left(\frac{GDPC_{C,Y-1}}{GDPC_{R:C \in R,Y-1}} \right)^\varphi$$

Then,

$$GDPC_{C,Y} = GDPC_{C,Y-1}^\varphi \cdot \frac{GDPC_{R:C \in R,Y}}{GDPC_{R:C \in R,Y-1}^\varphi}$$

where

$GDPC_{C,Y}$ = GDP per capita in country C in year Y (PPP-based constant U.S. dollars) (first $Y-1$ are year-2014 estimates from the World Bank, as discussed above)

$GDPC_{R:C \in R,Y}$ = GDP per capita in region R including country C in year Y (PPP-based constant U.S. dollars; estimates from the EIA's *IEO* as described above)

φ = Exponent that slightly increases the rate of change in GDP per capita for countries below the regional GDP per capita, and vice versa (less than 1.000; we assume 0.994)

Note that although the exponent is close to 1.000, it is applied each year, and hence its effect is compounded over time, so that, for example, after 40 years the adjustment is 0.786.

Appendix S2. Annual social discount rate

In Jacobson et al. (2015a), we review literature on the social discount rate (SDR). Key findings from that review are

- The U.S. Office of Management and Budget (OMB) (2003) states that “if your rule will have important intergenerational benefits or costs you might consider a further sensitivity analysis using a lower but positive discount rate,” and suggests a range of 1-3%.
- Moore et al. (2004) review the accepted methods for estimating the SDR and conclude that “no matter which method one chooses, the estimates for the SDR vary between 1.5 and 4.5 percent for intragenerational projects, and between 0 and 3.5 percent for projects with intergenerational impacts” (p. 809).
- The National Center for Environmental Economics (2014) indicates (without explicitly recommending) that a reasonable range is 2% to 5%.

On the basis of this review, Jacobson et al. (2015a) chose a LCHB SDR value of 1% and a HCLB value of 4.5%, even though a couple of the studies reviewed supported choosing a lower upper end. Recently, however, Drupp et al. (2015) surveyed 197 experts and find that 92% are comfortable with an SDR between 1% and 3%. This upper value of 3% is

consistent with the values from OMB (2003) and Moore et al. (2004). Therefore, for this analysis we assume SDR values of 1% (LCHB) and 3% (HCLB).

Appendix S3. Urban population share

The World Bank Development Indicators provide the urban fraction of the population from 1960 to 2014 (World Bank, 2015b). We fill in data gaps using our judgment). To estimate the urban fraction from 2015 to 2075, we use a dampened 6-year moving linear extrapolation:

$$URB\%_{C,Y>2014} = \min \left[100\%, URB\%_{C,Y-1} \cdot \left(\frac{URB\%_{C,Y} : trend(6yr)}{URB\%_{C,Y-1}} \right)^{\beta^{\alpha(Y-Y_{base})}} \right]$$

where

$URB\%_{C,Y}$ = The urban population share in country C in year Y

$trend(6yr)$ = The 6-year moving linear extrapolation

α = Fraction of year difference counted (we assume 0.35)

Y_{base} = A base year (2010)

β = The dampening base exponent (0.984)

This formulation, in which the dampening exponent decreases over time, serves to increasingly flatten the trend line over time, so that by 2075 there is relatively little year-to-year change. For example, with these assumptions, the urban population share increases by 10.5% from 2020 to 2050, but increases by only 1% from 2050 to 2075 (average of individual country changes).

Population

Historical and estimated future population at five-year intervals from 1985 through 2050 were obtained (Wikipedia, 2016b). We linearly interpolate between the intervals, through 2050. We extend from 2050 to 2075 using a dampened 10-year moving linear extrapolation:

$$P_{C,Y>2050} = P_{C,Y-1} \cdot \left(\frac{P_{C,Y} : trend(10yr)}{P_{C,Y-1}} \right)^\eta$$

where

$P_{C,Y}$ = Population in country C in year Y

$Trend(10yr)$ = The 10-year moving linear extrapolation

η = The dampening exponent (discussed below)

The dampening exponent is introduced because most projections show a declining rate of growth over time. For example, projections in Wikipedia (2016e) indicate that the decadal

average growth rate declines 20-30% every decade. A value of 0.965 for the dampening exponent reproduces the long-term projections in Wikipedia.

References

- ABB. *HVDC cable transmissions* (ABB Asea Brown Boveri Ltd, accessed 21 August 2016a); <https://library.e.abb.com/public/d4863a9b0f77b74ec1257b0c00552758/HVDC%20Cable%20Transmission.pdf>
- ABB. *HVDC: technology for energy efficiency and grid reliability* (ABB Asea Brown Boveri Ltd, accessed 21 August 2016b); [http://www02.abb.com/global/abbzh/abbzh250.nsf/0/27c2fdbd96a879a4c12575ee00487a77/\\$file/HVDC+-+efficiency+and+reliability.pdf](http://www02.abb.com/global/abbzh/abbzh250.nsf/0/27c2fdbd96a879a4c12575ee00487a77/$file/HVDC+-+efficiency+and+reliability.pdf)
- Ackerman, F., and Stanton, E.A. Climate Risks and Carbon Prices: Revising the Social Cost of Carbon. *Economics* 2012-10 (2012). <http://www.economics-ejournal.org/economics/journalarticles/2012-10>.
- Ackermann, T. Transmission systems for offshore wind farms. *IEEE Power Eng. Rev.* **22**, 23-27 (2002).
- Allen, M. R. *et al.* Warming caused by cumulative carbon emissions towards the trillionth tonne. *Nature* **458**, 1163–1166 (2009).
- Anaya, K. L. and Pollitt, M. G. Integrating distributed generation: Regulation and trends in three leading countries. *Energy Policy* **85**, 475-486 (2015).
- Anenberg, S. C. *et al.* Global air quality and health co-benefits of mitigating near-term climate change through methane and black carbon emission controls. *Environ. Health Perspect.* **120**, 831-839 (2012).
- Anthoff, D. C. Hepburn, and R. S. J. Tol, “Equity weighting and the marginal damage costs of climate change,” *Ecological Economics* **68**: 836-849 (2009).
- Antoff, D., Rose, S. Tol, R.S.J., and Waldhoff, S. Regional and Sectoral Estimates of the Social Cost of Carbon: An Application of Fund. *Economics*, No. 2011-18 (2011). <http://www.economics-ejournal.org/economics/discussionpapers/2011-18>.
- Aravinthan, V. and Jewell, W. Controlled electric vehicle charging for mitigating impacts on distribution assets. *IEEE Trans. Smart Grid* **6**, 999-1009 (2015).
- Arent, D. *et al.* *Improved offshore wind resource assessment in global climate stabilization scenarios* Report NREL/TP-6A20-55049 (National Renewable Energy Laboratory, 2010).
- Arinaga, R. A. and Cheung, K. F. Atlas of global wave energy from 10 years of reanalysis and hindcast data. *Renewable Energy* **39**, 49-64 (2012).
- Atlantis Resources Ltd. *Quantified global resource of 25GW* (2014); <http://atlantisresourcesltd.com/marine-power/global-resources.html>
- Babarit, A. *et al.* Numerical benchmarking study of a selection of wave energy converters. *Renewable Energy* **41**, 44-63 (2012).
- Bahrman, M. P. and Johnson, B. K. The ABCs of HDVC transmission technologies. *IEEE Power Energy Mag.* **5**, 32-44 (2007).
- Barnes, M. and Beddard, A. Voltage source converter HVDC links – the state of the art and issues going forward. *Energy Procedia* **24**, 108-122 (2012).
- Bedard R. *et al.* *North American Ocean Energy Status – March 2007* (Electric Power Research Institute, 2007).
- Blarke, M. B. and Jenkins, B. M. SuperGrid or SmartGrid: Competing Strategies for large-scale integration of intermittent renewables? *Energy Policy* **58**, 381-390 (2013).
- Bresesti, P., Kling, W. L., Hendriks, R. L., and Vailati, R. HDVC connection of offshore wind farms to the transmission system. *IEEE Trans. Energy Convers.* **22**, 37-43 (2007).
- Brown, R. E. *Electric Power Distribution Reliability*, Second edition (CRC press, Taylor and Francis Group, 2009).
- Bumby, S. *et al.* Life cycle assessment of overhead and underground primary power distribution. *Environ. Sci. Technol.* **44**, 5587-5593 (2010).
- Buonocore, J. J. *et al.* Health and climate benefits of different energy efficiency and renewable energy choices. *Nat. Clim. Change* **6**, 100-105 (2016).
- Burke, M. Hsiang, S. M., and Miguel, E. Global non-linear effect of temperature on economic production. *Nature*, doi:10.1038/nature15725 (2015).
- CAISO (California Independent System Operator) *2015 Summer Loads & Resources Assessment* (CAISO, prepared by Infrastructure Development, 2015).

- Carballo, R. and Iglesias, G. A methodology to determine the performance of wave energy converters at a particular location. *Energy Convers. Manage.* **61**, 8-18 (2012).
- CIA (Central Intelligence Agency) *The World Factbook*, Coastline (CIA, accessed 29 August 2016a); <https://www.cia.gov/library/publications/the-world-factbook/fields/2060.html>
- CIA (Central Intelligence Agency) *The World Factbook*, GDP – per capita (PPP) (CIA, accessed 30 August 2016b); <https://www.cia.gov/library/publications/the-world-factbook/rankorder/2004rank.html>
- Cipcigan, L. M. and Taylor, P. C. Investigation of the reverse power flow requirements of high penetrations of small-scale embedded generation. *IET Renewable Power Gener.* **1**, 160-166 (2007).
- Clack, C. T. M., Xie, Y., and MacDonald, A. E. Linear programming techniques for developing an optimal electrical system including high-voltage direct-current transmission and storage. *Int. J. Electr. Power Energy Syst.* **68**, 103-114 (2015).
- Clean Line Energy Partners. *Stepping up to the Challenge* (2010); http://www.cleanlineenergy.com/sites/cleanline/media/resources/Clean_Line_Corporate_Brochure.pdf
- Clean Line Energy Partners. *Projects* (accessed 20 September 2015); <http://www.cleanlineenergy.com/projects>
- Cohen, M. A., Kauzmann, P. A., and Callaway, D. S. *Economic Effects of Distributed PV Generation on California's Distribution System* EI@Hass WP 260 (Energy Institute at Haas, University of California, Berkeley, 2015).
- CSP Plaza. *Global CSP installed capacity increased to 4940 MW by the end of 2015* (2016, accessed 21 August 2016); <http://en.cspplaza.com/global-csp-installed-capacity-increased-to-4940-mw-by-the-end-of-2015.html>
- Davis, S. C., Diegel, S. W., and Bundy, R. G. *Transportation Energy Data Book*, edition 34, ORNL-6991 (Center for Transportation Analysis, Oak Ridge National Laboratory, 2015).
- Deaton, A. and Heston, A. Understanding PPPs and PPP-based national accounts. *Am. Econ. J Macroecon.* **2**, 1-35 (2010).
- Delucchi, M. A., Burke, A., Lipman, T., and Marshall, M. *Electric and Gasoline Vehicle Lifecycle Cost and Energy-Use Model* Report to the California Air Resources Board UCD-ITS-RR-99-4 (Institute of Transportation Studies, University of California, Davis, 2000); <https://its.ucdavis.edu/research/publications/>.
- Delucchi, M. A. *et al. A Lifecycle Emissions Model (LEM): Lifecycle Emissions from Transportation Fuels, Motor Vehicles, Transportation Modes, Electricity Use, Heating and Cooking Fuels, and Materials* Main report and 13 appendices UCD-ITS-RR-03-17 (Institute of Transportation Studies, University of California, Davis, 2003).
- Delucchi, M. A., Jacobson, M. Z., Bauer, Z. A. F., Goodman, S., and Chapman, W. *Spreadsheets for 139-country 100% wind, water, and solar roadmaps* (2016, accessed 18 April 2016); <http://web.stanford.edu/group/efmh/jacobson/Articles/I/WWS-50-USState-plans.html>
- Denholm P., and Margolis, R.M. Land-use requirements and the per-capita footprint for photovoltaic generation in the United States. *Energy Policy* **36**, 3531-3543 (2008).
- Despotovic M. and Nedic, V. Comparison of optimum tilt angles of solar collectors determined on yearly, seasonal, and monthly levels. *Energy Conversion and Management* **97**, 121-131 (2015).
- Dodge, D. and Thompson, D. *Shining a light on solar energy myths* (Pembina Institute, 2016, accessed 10 February 2016); <http://www.pembina.org/blog/shining-a-light-on-solar-energy-myths>
- DOE (Department of Energy, U.S.) *The Potential Benefits of Distributed Generation and Rate-Related Issues That May Impede Their Expansion* Report Pursuant to Section 1817 of the Energy Policy Act of 2005 (U.S. DOE, 2007).
- DOE (Department of Energy, U.S.) *An Assessment of Energy Potential at Non-Powered Dams in the United States* (U.S. DOE, 2012).
- Drupp, M., Freeman, M., Groom, B., and Nesje, F. *Discounting disentangled: an expert survey on the determinants of the long-term social discount rate* The Centre for Climate Change Economics and Policy Working Paper No. 195 and Grantham Research Institute on Climate Change and the Environment Working Paper No. 172 (CCCEP and Grantham Research Institute, 2015).
- Dulac, J. *Global Land Transport Infrastructure Requirements* (International Energy Agency, 2013).
- EIA (Energy Information Administration, U.S.) *Table A8: Electricity supply, disposition, prices, and emissions in Annual Energy Outlook 2010* DOE/EIA-0383(2010) (U.S. Department of Energy, 2010), <http://www.eia.gov/forecasts/aeo/data/browser/#/?id=8-AEO2010>
- EIA (Energy Information Administration, U.S.) *Transportation Model of the World Energy Projection System Plus: Model Documentation 2011* DOE/EIA-M072(2011) (U.S. Department of Energy, 2011a).

EIA (Energy Information Administration, U.S.) *World Energy Projection System Plus Model Documentation 2011: World Industrial Model* DOE/EIA-m079(2011) (U.S. Department of Energy, 2011b).

EIA (Energy Information Administration, U.S.) *2009 RECS survey data, Housing characteristic tables in Residential Energy Consumption Survey (RECS)* (U.S. Department of Energy, 2013a, accessed 21 August 2016); <http://www.eia.gov/consumption/residential/data/2009/>

EIA (Energy Information Administration, U.S.) *Table 9.1 Enclosing floorspace and number of established buildings, 2010* in *Manufacturing Energy Consumption Survey (MECS)* (U.S. Department of Energy, 2013b).

EIA (Energy Information Administration, U.S.) *International Energy Outlook 2014* DOE/EIA-0484(2014) (U.S. Department of Energy, 2015).

EIA (Energy Information Administration, U.S.) *International Energy Outlook 2016* DOE/EIA-0484(2016) (U.S. Department of Energy, 2016a); [http://www.eia.gov/forecasts/ieo/pdf/0484\(2016\).pdf](http://www.eia.gov/forecasts/ieo/pdf/0484(2016).pdf), <https://www.eia.gov/forecasts/ieo/>, http://www.eia.gov/forecasts/ieo/ieo_tables.cfm.

EIA (Energy Information Administration, U.S.) *2015 Domestic Uranium Production Report* (U.S. Department of Energy, 2016b, accessed 23 October, 2016)

EIA (Energy Information Administration, U.S.) Data transmittal via e-mail (Thaddeus.Huetteman@eia.gov) (Electricity Analysis Team, Office of Electricity, Coal, Nuclear, and Renewables Analysis, 2016c, accessed 27 January 2016).

EIA (Energy Information Administration, U.S.) *Table B7. Building size, floorspace, 2012* in *Commercial Buildings Energy Consumption Survey (CBECS)* (U.S. Department of Energy, 2016d, accessed 21 August 2016); <http://www.eia.gov/consumption/commercial/data/2012/bc/cfm/b7.cfm>

EIA (Energy Information Administration, U.S.) *Table B10. Number of floors, number of buildings and floorspace, 2012* in *Commercial Buildings Energy Consumption Survey (CBECS)* (U.S. Department of Energy, 2016e, accessed 29 August 2016); <http://www.eia.gov/consumption/commercial/data/2012/bc/cfm/b10.cfm>

EIA (Energy Information Administration, U.S.) *About the Commercial Buildings Energy Consumption Survey in Commercial Buildings Energy Consumption Survey (CBECS)* (U.S. Department of Energy, 2016f, accessed 29 August 2016); <https://www.eia.gov/consumption/commercial/about.cfm>

EIA (Energy Information Administration, U.S.) *Electricity in Annual Energy Review* (U.S. Department of Energy, 2016g, accessed 30 August 2016); <http://www.eia.gov/totalenergy/data/annual/index.cfm#electricity>

EIA (Energy Information Administration, U.S.) *Petroleum & Other Liquids, Number and capacity of petroleum refineries* (U.S. Department of Energy, 2016h, accessed 30 August 2016); http://www.eia.gov/dnav/pet/pet_pnp_cap1_dcu_nus_a.htm

Ela, E., Milligan, M., and Kirby, B. *Operating Reserves and Variable Generation* NREL/TP-5500-51978 (National Renewable Energy Laboratory, 2011).

Elliott, D. Emergence of European supergrids – Essay on strategy issues. *Energy Strategy Rev.* **1**, 171-173 (2013).

Elliston, B., Riesz, J, and MacGill, I. What cost for more renewables? The incremental cost of renewable generation – An Australian national electricity market case study. *Renewable Energy* **95**: 127-139 (2016).

Enevoldssen, P., and Sovacool, B.K. Examining the social acceptance of wind energy: Practical guidelines for onshore wind project development in France. *Renewable & Sustainable Energy Reviews* **53**, 178-184 (2016).

Enevoldsen, P., and Valentine, S.V. Do onshore and offshore wind farm development patterns differ? *Energy for Sustainable Development* **35**, 41-51 (2016).

Entranze. *Average floor area per capita* (Entranze and the Intelligent Energy Europe Program of the European Union, 2015, accessed 8 September 2015); <http://www.entranze.enerdata.eu/average-floor-area-per-capita.html>

Entranze. *Building sector and energy demand in target countries* (Entranze and the Intelligent Energy Europe Program of the European Union, 2016, accessed 29 August 2016); <http://www.entranze.eu/pub/pub-data>

EOEA (European Ocean Energy Association) *Oceans of Energy, European Ocean Energy Roadmap 2010-2050* (2010).

EPIA (European Photovoltaic Industry Association) *Global Market Outlook for Photovoltaics 2014-2020* (2014).

EPRI (Electric Power Research Institute) *Estimating the Costs and Benefits of the Smart Grid Technical Report 1022591* (2011).

EWEA (European Wind Energy Association) *Wind in power, 2015 European statistics* (2016).

- Falcão, A. F., de O. Wave energy utilization: A review of technologies. *Renewable Sustainable Energy Rev.* **14**, 899-918 (2010).
- FERC (Federal Energy Regulatory Commission) *Market Oversight glossary* (2016, accessed 30 August 2016); <http://www.ferc.gov/market-oversight/guide/glossary.asp>
- Flourentzou, N. VSC-based HVDC power transmission systems: an overview. *IEEE Trans. Power Electron.* **24**, 592-602 (2009).
- Folley, M. and Whittaker, T. J. T. Analysis of nearshore wave energy resource. *Renewable Energy* **34**, 1709-1715 (2009).
- Forouzanfar, M. H. *et al.* Global, regional, and national comparative risk assessment of 79 behavioral, environmental and occupational, and metabolic risks or clusters of risks in 188 countries, 1990-2013: a systematic analysis for the Global Burden of Disease Study 2013. *Lancet* **386**, 2287-323 (2015).
- Friedlingstein, P. *et al.* Persistent growth of CO₂ emissions and implications for reaching climate targets. *Nature Geoscience* **7**, 709–715 (2014).
- Fu, R., Chung, C., Lowder, T., Feldman, D., Ardani, K., and Margolis, R. *U.S. Solar Photovoltaic System Cost Benchmark: Q1 2016*, NREL/TP-6A20-66523, National Renewable Energy Laboratory, Golden, Colorado, September (2016). <http://www.nrel.gov/docs/fy16osti/66532.pdf>.
- GCP (Global Carbon Project) *Global Carbon Budget 2014 spreadsheet, Territorial Emissions* (Carbon Dioxide Information Analysis Center, accessed 12 August 2015); <http://cdiac.ornl.gov/GCP/>
- Global Data. *High-Voltage Direct Current (HVDC) Converter Stations – Global Market Size, Average Pricing and Equipment Market Share to 2020* Sample report GDPE1058MAR (2013).
- Green, D., “The spatial distribution of extreme climate events, another climate inequity for the world’s most vulnerable people,” *Environmental Research Letters* **11**, 091002 (2016).
- Grikas, M. Personal communication by e-mail (SolarReserve, 18 April 2016).
- Gunn, K. and Stock-Williams, C. Quantifying the global wave power resource. *Renewable Energy* **44**, 296-304 (2012).
- GWEC (Global Wind Energy Council) *Global Wind Report, Annual Market Update 2014* (2015).
- GWEC (Global Wind Energy Council) *Global Wind Statistics 2015* (2016).
- Hammitt, J. K. and Robinson, L. A. The income elasticity of the value per statistical life: transferring estimates between high and low income populations. *J. Cost-Benefit Anal.* **2**, 1-29 (2011).
- Handoyo, E.A., Ichsan, D., and Prabowo, The optimal tilt angle of a solar collector. *Energy Procedia* **32**, 166-175 (2013).
- Harrington, L. J., D. J. Frame, E. M. Fischer, M. Joshi, and C. D. Jones, “Poorest countries experience earlier anthropogenic emergence of daily temperature extremes,” *Environmental Research Letters* **11**, 055007 (2016).
- Harris Williams & Co. *Transmission & Distribution Infrastructure Summer 2014 white paper* (2014).
- Hassaine, L., Olias, E., Quintero, J., and Haddadi, M. Digital power factor control and reactive power regulation for grid-connected photovoltaic inverter. *Renewable Energy* **34**, 315-321 (2009).
- Hirth, L., Ueckerdt, F., and Edenhofer, O. Integration costs revisited – an economic framework for wind and solar. *Renewable Energy* **74**, 925-939 (2015).
- Hoff, T. E. and Wenger, H. J. Distributed generation: an alternative to electric utility investments in system capacity. *Energy Policy* **24**, 137-147 (1996).
- Howarth, R.B., Gerst, M.D., and Borsuk, M.E. Risk Mitigation and the Social Cost of Carbon. *Global Environmental Change* **24**, 123-131 (2014).
- Hu, Z. and Li, F. Cost-benefit analysis of active distribution network management, Part I: Annual benefit analysis. *IEEE Trans. Smart Grid* **3**, 1067-1074 (2012a).
- Hu, Z. and Li, F. Cost-benefit analysis of active distribution network management, Part II: Investment reduction analysis. *IEEE Trans. Smart Grid* **3**, 1075-1081 (2012b).
- ICC (International Code Council) Building Services and Systems, Chapter 6 in *2015 International Fire Code* (2016).
- IEA (International Energy Agency) *Energy Balances of Non-OECD Countries 2015 Revised Edition, Database Documentation* (2015a).
- IEA (International Energy Agency) *Energy Balances of Non-OECD Countries 2015* (OECD and IEA, 2015b); <http://dx.doi.org/10.1787/19962843-en>
- IEA (International Energy Agency) *IEA World Energy Statistics and Balances* (OECD, 2015c, accessed 21 August 2016); <http://dx.doi.org/10.1787/enestats-data-en>
- IEA (International Energy Agency) *2015 Key World Energy Statistics* (OECD and IEA, 2015d).

- IEA (International Energy Agency) *2015 Snapshot of Global Photovoltaic Markets* Report IEA PVPS T1-29:2016 (IEA-PVPS, 2016).
- IHA (International Hydropower Association) *2016 Hydropower status report* (2016).
- IMF (International Monetary Fund) *World Economic Outlook Database* (2015, accessed 30 August 2016); <http://www.imf.org/external/pubs/ft/weo/2015/02/weodata/index.aspx>
- Interagency Working Group on Social Cost of Greenhouse Gases, *Technical Support Document – Technical Update of the Social Cost of Carbon for Regulatory Impact Analysis Under Executive Order 12866*, United States Government, August (2016; accessed January 2017). <https://www.epa.gov/climatechange/social-cost-carbon-technical-documentation>.
- International Electrotechnical Commission. *Efficient electrical energy transmission and distribution* (2007).
- IPCC (Intergovernmental Panel on Climate Change). *Climate Change 2014-Impacts, Adaptation and Vulnerability: Regional Aspects*, Cambridge Univ. Press, New York (2014).
- IRENA (International Renewable Energy Agency) *Renewable Power Generation Costs in 2014* (2015a).
- IRENA (International Renewable Energy Agency) *Renewable Energy and Jobs, Annual Review 2015* (2015b).
- IRENA (International Renewable Energy Agency) *The Age of Renewable Power, Designing National Roadmaps for a Successful Transition* (2015c).
- IRENA (International Renewable Energy Agency) *Renewable Energy Integration in Power Grids*, IEA-ETSAP and IRENA Technology Brief E15 (IEA-ETSAP and IRENA, 2015d).
- IRENA (International Renewable Energy Agency) *Smart Grids and Renewables, A Cost-Benefit Analysis Guide for Developing Countries* (2015e).
- IRENA (International Renewable Energy Agency) *Renewable Capacity Statistics 2016* (2016a).
- IRENA (International Renewable Energy Agency) *Renewable Energy Benefits: Measuring the Economics* (2016b).
- Jacobson, M.Z., Y.J. Kaufmann, Y. Rudich, Examining feedbacks of aerosols to urban climate with a model that treats 3-D clouds with aerosol inclusions, *J. Geophys. Res.*, **112**, D24205, doi:10.1029/2007JD008922, (2007).
- Jacobson, M. Z. Review of solutions to global warming, air pollution, and energy security. *Energy Environ. Sci.* **2**, 148-173 (2009).
- Jacobson, M. Z. Enhancement of local air pollution by urban CO₂ domes. *Environ. Sci. Technol.* **44**, 2497-2502 (2010a).
- Jacobson, M. Z. Short-term effects of controlling fossil-fuel soot, biofuel soot and gases, and methane on climate, Arctic ice, and air pollution health. *J. Geophys. Res.* **115**, D14209 (2010b).
- Jacobson, M. Z. and Delucchi, M. A. Providing all global energy with wind, water, and solar power, Part I: Technologies, energy resources, quantities and areas of infrastructure, and materials. *Energy Policy* **39**, 1154-1169 (2011).
- Jacobson, M. Z. *et al.* Examining the feasibility of converting New York State's all-purpose energy infrastructure to one using wind, water, and sunlight. *Energy Policy* **57**, 585-601 (2013).
- Jacobson, M. Z. *et al.* A roadmap for repowering California for all purposes with wind, water, and sunlight. *Energy* **73**, 875-889 (2014).
- Jacobson, M. Z. *et al.* 100% clean and renewable wind, water, sunlight (WWS) all-sector energy roadmaps for the 50 United States. *Energy Environ. Sci.* **8**, 2093-2117 (2015a).
- Jacobson, M. Z., Delucchi, M. A., Cameron, M. A., and Frew, B. A. A low-cost solution to the grid reliability problem with 100% penetration of intermittent wind, water, and solar for all purposes. *Proc. Nat. Acad. Sci.* **112**, 15060-15065 (2015b).
- Jacobson, M.Z., Delucchi, M.A., Cameron, M.A., and Mathiesen, B.V. Maintaining grid reliability at low cost among 139 countries within 20 world regions with 100% intermittent wind, water, and solar power for all purposes, in review (2017).
- Johnson, L., and Hope, C. The social cost of carbon in U.S. regulatory impact analyses: and introduction and critique. *Journal of Environmental Studies and Sciences* **2**, 205-221(2012).
- JPL (Jet Propulsion Laboratory) *Dataset Discovery*, Processed by D. Whitt and M. Dvorak (2010, accessed 23 February 2012); <http://podaac.jpl.nasa.gov/datasetlist?ids=Platform&values=QUIKSCAT>
- Kalcon, G., Adam, G. P., Anaya-Lra, O., Burt, G., and Lo, K. L. Analytical efficiency evaluation of two and three level VSC-HVDC transmission links. *Int. J. Electr. Power Energy Syst.* **44**, 1-6 (2013).
- Kisacikoglu, M. C., Ozpineci, B., and Tolbert, L. M. EV/PHEV bidirectional charger assessment for V2G reactive power operation. *IEEE Trans. Power Electron.* **28**, 5717-5727 (2013).

- Kisacikoglu, M. C., Kesler, M., and Tolbert, L. M. Single-phase on-board bidirectional PEV charger for V2G reactive power operation. *IEEE Trans. Smart Grid* **6**, 767-775 (2015).
- Kjørholt, Å. M. H. *HVDC Transmission Using a Bipolar Configuration Composed of an LCC and MMC: Operating Characteristics of Skagerrak 3 and Skagerrak 4*. Master's thesis, Norwegian University of Science and Technology, Trondheim (2014).
- Knapp, K. E., Martin, J., Price, S., and Gordon, F. M. *Costing Methodology for Electric Distribution System Planning* Prepared for The Energy Foundation by Energy & Environmental Economics, Inc. and Pacific Energy Associates (2000).
- Koomey, J. and Hultman, N. E. A reactor-level analysis of busbar costs for US nuclear plants, 1970-2005. *Energy Policy* **35**, 5630-5642 (2007).
- Lazard. *Lazard's Levelized Cost of Energy Analysis* Version 8.0 (2014).
- Lazard. *Lazard's Levelized Cost of Energy Analysis* Version 9.0 (2015).
- Lepeule, J., Laden, F., Dockery, D., and Schwartz, J. Chronic exposure to fine particles and mortality: An extended follow-up of the Harvard six cities study from 1974 to 2009. *Environ. Health Perspect.* **120**, 965-970 (2012).
- LeQuere, C. et al. Global carbon budget 2014. *Earth Syst. Sci. Data* **7**, 47-85 (2015).
- Liang, J. and Feng, C. M. Advanced AC and DC technologies to connect offshore windfarms into electricity transmission and distribution networks, Chapter 13 in *Eco-Friendly Innovations in Electricity Transmission and Distribution Networks* (ed. Bessède, J.-L.) 263-290 (Woodhead Publishing, 2015).
- Liang, D., Taylor, P., Wang, L., Miller, D., and Thornley, V. Coordinated voltage and power flow control in distribution network, Paper 0711, *22nd International Conference on Electricity Distribution (CIRED)*, 2015).
- Lindhjem, H. and Navrud, S. Reliability of Meta-analytic benefit transfers of international value of statistical life estimates: tests and illustrations, Chapter 19 in *Benefit Transfer of Environmental and Resource Values* (eds. Johnston, R. J. et al.) 441-464 (Springer, 2015).
- Linowes, L. *Wind Benefit Inflation: JEDI (NREL) Model Needs Reality Check* (MasterResource, 12 December 2012); <http://www.masterresource.org/2012/12/wind-benefit-inflation-jedi-nrel-2/>
- López, I., Andreu, J., Ceballos, S., de Alegría, I. M., and Kortabarria, I. Review of wave energy technologies and the necessary power equipment. *Renewable Sustainable Energy Rev.* **27**, 413-434 (2013).
- MacDonald, A. E. et al. Future cost-competitive electricity systems and their impact on US CO₂ emissions. *Nat. Clim. Change* **6**, 526-531 (2016).
- Maï, T. et al. *Resource Planning Model: An Integrated Resource Planning and Dispatch Tool for Regional Electric Systems* NREL/TP-6A20-56723 (NREL, 2013).
- Marine Renewables Canada. *Marine Renewable Energy in Canada and the Global Context* (2013).
- Matthews, H.D., Gillett, N.P. Stott, P.A., and Zickfeld, K. The proportionality of global warming to cumulative carbon emissions. *Nature* **459**, 829-832 (2009).
- Matthews, H.D. *Montreal's emissions targets for 1.5 °C and 2°C global warming* (2016, accessed 22 September 2016), http://ocpm.qc.ca/sites/ocpm.qc.ca/files/pdf/P80/7.2.19_damon_matthews.pdf
- McCormick, M. E. and Ertekin, R. C. Renewable sea power: Waves, Tides, and Thermals-new research funding seeks to put them to work for us. *Mechanical Engineering*, May, 36-39 (American Society of Mechanical Engineers International, 2009).
- Meinshausen, M. et al. Greenhouse-gas emission targets for limiting global warming to 2°C. *Nature* **458**, 1158-1162 (2009).
- Melius, J., Margolis, R., and Ong, S. *Estimating Rooftop Suitability for PV: A Review of Methods, Patents, and Validation Techniques* NREL/TP-6A20-60593 (NREL, 2013).
- Milligan, C., Kopp, A., Dahdah, S., and Montufar, J. Value of statistical life in road safety: a benefit transfer function with risk-analysis guidance based on developing country data. *Accid. Anal. Prev.* **71**, 236-247 (2014).
- Milligan, M. et al. Alternatives no more: wind and solar power are mainstays of a clean, reliable, affordable grid. *IEEE Power Energy Mag.* **13**, 78-87 (2015).
- Moore, M. A., Boardman, A. E., Vining, A. R., Weimer, D. L., and Greenberg, D. H. Just give me a number! Practical values for the social discount rate. *J. Policy Anal. Manage.* **23**, 789-812 (2004).
- Moore, F.C. and Diaz, D.B. Temperature impacts on economic growth warrant stringent mitigation policy. *Nature Climate Change*, DOI: 10.1038/NCLIMATE2481 (2015).
- National Center for Environmental Economics. *Guidelines for Preparing Economic Analyses* (U.S. Environmental Protection Agency, 2014).

Natural Earth. *Coastline* (2016, accessed 21 August 2016); <http://www.naturalearthdata.com/downloads/50m-physical-vectors/50m-coastline>

Negra, N. B., Todorovic, J., and Ackermann, T. Loss evaluation of HVAC and HVDC transmission solutions for large offshore wind farms. *Electr. Power Syst. Res.* **76**, 916-927 (2006).

Northern Alberta Institute of Technology. *Solar Photovoltaic Reference Array Report* (2015).

NREL (National Renewable Energy Laboratory) *Global RE Opportunity Tool* (2012a, accessed 9 September 2015); http://maps.nrel.gov/global_re_opportunity

NREL (National Renewable Energy Laboratory) *SunShot Vision Study* DOE/GO-102012-3037 (U.S. Department of Energy, 2012b).

NREL (National Renewable Energy Laboratory) *Wind Resources by Class and Country at 50 m* 617e7181-f161-4c24-8b7c-8876bd356b7a (U.S. Department of Energy Opendata, 2012c, accessed 11 June 2015); <http://en.openei.org/datasets/dataset/wind-resources-by-class-and-country-at-50m>

NREL (National Renewable Energy Laboratory) *Jobs and Economic Development Impact Models (JEDI)* (2013, accessed 27 October 2013); <http://www.nrel.gov/analysis/jedi/download.html>, <http://www.nrel.gov/analysis/jedi/results.html>

N'Tsoukpoe, K. E. *et al.* Integrated design and construction of a micro-central tower power plant. *Energy Sustainable Dev.* **31**, 1-13 (2016).

Ocean Energy Systems (OES). *An International Vision for Ocean Energy* (OES – an IEA Technology Initiative, 2011).

Ocean Energy Systems (OES) *2014 Annual Report* (OES – an IEA Technology Initiative, 2014).

Ocean Energy Systems (OES) *International Levelised Cost of Energy for Ocean Energy Technologies* (OES – an IEA Technology Initiative, 2015).

Office of Management and Budget. *Regulatory Analysis Circular A-4* (The White House, 2003); http://www.whitehouse.gov/omb/circulars_a004_a-4

Papaefthymiou, G. and Dragoon, K. Towards 100% renewable energy systems: Uncapping power system flexibility. *Energy Policy* **92**, 69-82 (2016).

Paris, L. *et al.* Present limits of very long distance transmission systems, *CIGRE: International Conference on Large High-Voltage Electric Systems* (CIGRE, 1984).

Pezeshki, H., Wolfs, P. J., and Ledwich, G. Impact of high PV penetration on distribution transformer insulation life. *IEEE Trans. Power Delivery* **29**, 1212-1220 (2014).

Pickard, W. F. The limits of HVDC transmission. *Energy Policy* **61**, 292-300 (2013).

Pindyck, R.S. Climate Change Policy: What Do the Models Tell Us? *Journal of Economic Literature* **51**, 860-872 (2013).

Pope, C. A. III *et al.* Lung cancer, cardiopulmonary mortality, and long-term exposure to fine particulate air pollution. *J. Am. Med. Assoc.* **287**, 1132-1141 (2002).

Powercor Australia, Jemena, and Australian Energy Market Operator. *Joint Consultation Paper: Western Metropolitan Melbourne Transmission Connection and Subtransmission Capacity* (Jemena, 2012).

Reguero, B. G. *et al.* Evaluation of global wave energy resource, *Oceans 2011 IEEE - Spain* (IEEE, 2011).

REserviceS. *Capabilities and costs for ancillary services provision by wind power plants* Deliverable D 3.1 (2013a).

REserviceS. *Ancillary services by solar PV – capabilities and costs* Deliverable D 4.1 (2013b).

REserviceS. *Economic grid support services by wind and solar PV* Final publication of the REserviceS project (2014).

Revesz, R.L., Howard, P.H., Arrow, K., Goulder, L.H., Kopp, R.E., Livermore, M.A., Oppenheimer, M. and Sterner, T. Global warming: Improve economic models of climate change. *Nature* **508**, 173-175 (2014).

Sebi, C., Lapillonne, B., and Routin, G. *Entranze, Guideline on the databases and web-tool* D6.14 of WP6 from Entranze Project (Entranze and the Intelligent Energy Europe Programme of the European Union, 2013).

Shindell, D. *et al.* Simultaneously mitigating near-term climate change and improving human health and food security. *Science* **335**, 183-189 (2012).

Shirasawa, K., Tokunaga, K., Iwashita, H., and Shintake, T. Experimental verification of a floating ocean-current turbine with a single rotor for use in Kuoshio currents. *Renewable Energy* **91**, 189-195 (2016).

Smith, J. C. *et al.* Transmission planning for wind energy in the United States and Europe: status and prospects. *WIREs Energy Environ.* **2**, 1-13 (2013).

- So, R., Casey, S., Kanner, S., Simmons, A., and Brekken, T. PTO-SIM: Development of a power take off modeling tool for ocean wave energy conversion, 2015 *Proc. IEEE Power & Energy Soc. Gen. Meeting* (IEEE PES, 2015).
- Stanciu, C. and Stanciu, D. Optimum tilt angle for flat plate collectors all over the world – a declination dependence formula and comparisons of three solar radiation models. *Energy Conversion and Management* **81**, 133-143 (2014).
- Stern, N. The Structure of Economic Modeling of the Potential Impacts of Climate Change: Grafting Gross Underestimation of Risk onto Already Narrow Science Models. *Journal of Economic Literature* **51**, 838-859 (2013).
- SolarReserve. *Crescent Dunes* (2016, accessed 28 August 2016); <http://www.solarreserve.com/en/global-projects/csp/crescent-dunes>
- SunPower. *SunPower® E-Series Residential Solar Panels SPR-E20-327 504860 Rev E /LTR_US* (2016).
- Ten Hoeve, J.E., M.Z. Jacobson, and L. Remer, Comparing results from a physical model with satellite and in situ observations to determine whether biomass burning aerosols over the Amazon brighten or burn off clouds, *J. Geophys. Res.*, *117*, D08203, doi:10.1029/2011JD016856 (2012).
- Tol, R.S.J. International Inequity Aversion and the Social Cost of Carbon. *Climate Change Economics* **1**, 21-32 (2010).
- Turitsyn, K., Sulc, P., Backhaus, S., and Chertkov, M. Local control of reactive power by distributed photovoltaic generators, *First IEEE International Conference on Smart Grid Communications (SmartGridComm)* 79-84 (IEEE, 2010).
- Ueckerdt, F., Hirth, L., Luderer, G., and Edenhofer, O. System LCOE: What are the costs of variable renewables? *Energy* **63**, 61-75 (2013).
- University of British Columbia. *Poor air quality kills 5.5 million worldwide annually* (ScienceDaily, 12 February 2016); <https://www.sciencedaily.com/releases/2016/02/160212140912.htm>
- U. S. Bureau of Labor Statistics. *Current Employment Statistics (CES)* (2016, accessed 29 August 2016); <http://www.bls.gov/ces/home.htm>
- U. S. Bureau of Transportation Statistics. *Table 1-11: Number of U.S. aircraft, vehicles, vessels, and other conveyances* in National Transportation Statistics (U.S. Department of Transportation, 2016).
- U. S. Bureau of Transportation Statistics and U.S. Census Bureau. *2012 Commodity Flow Survey EC12TCF-US* (U.S. Department of Transportation, 2015).
- U. S. Census Bureau. *Table 1: Monthly population estimates for the United States: April 1, 2010 to December 1, 2016, Civilian population NA-EST2015-01* (U.S. Census Bureau, Population Division, 2015).
- Van den Bergh, J. C. J. M. and Botzen W. J. W. Monetary valuation of the social cost of CO2 emissions: A critical survey. *Ecological Economics* **114**, 33-468 (2015).
- Van den Bergh, J. C. J. M. and Botzen W. J. W. A lower bound the social cost of carbon emissions. *Nature Climate Change* **4**, 253-258 (2014).
- Wang, W. and Bessède, J.-L. Life cycle assessment of equipment for electricity transmission and distribution networks, Chapter 6 in *Eco-Friendly Innovations in Electricity Transmission and Distribution Networks* (ed. Bessède, J.-L.) 123-133 (Woodhead Publishing, 2015).
- Weckx, S. and Driesen, J. Load balancing with EV chargers and PV inverters in unbalanced distribution grids. *IEEE Trans. Sustainable Energy* **6**, 635-643 (2015).
- Weeks, J. *U.S. electrical grid undergoes massive transition to connect to renewables* (Scientific American, 28 April 2010); <http://www.scientificamerican.com/article/what-is-the-smart-grid/>
- WHO (World Health Organization) *7 million premature deaths annually linked to air pollution* (2014a, accessed 15 June 2015); <http://www.who.int/mediacentre/news/releases/2014/air-pollution/en/>
- WHO (World Health Organization) *Global Health Observatory Data Repository* (2014b, accessed 2 July 2015); <http://apps.who.int/gho/data/node.main.156>
- Wikipedia. *Economy of the Netherlands Antilles* (2016a, accessed 21 August 2016); https://en.wikipedia.org/wiki/Economy_of_the_Netherlands_Antilles
- Wikipedia. *List of countries by past and future population* (2016b, accessed 21 August 2016); http://en.wikipedia.org/wiki/List_of_countries_by_past_and_future_population
- Wikipedia. *List of HVDC projects* (2016c, accessed 21 August 2016); https://en.wikipedia.org/wiki/List_of_HVDC_projects
- Wikipedia. *List of sovereign states and dependencies by area* (2016d, accessed 21 August 2016); https://en.wikipedia.org/wiki/List_of_sovereign_states_and_dependencies_by_area

- Wikipedia. *World population estimates* (2016e, accessed 21 August 2016); https://en.wikipedia.org/wiki/World_population_estimates
- Wilkerson, J. T. *et al.* Analysis of emission data from global commercial aviation: 2004 and 2006. *Atmos. Chem. Phys.* **10**, 6391-6408 (2010).
- Willis, H. L. *Power Distribution Planning Reference Book, Second Edition, Revised and Expanded* (Marcel Dekker, Inc., 2004).
- Willrich, M. *Electricity Transmission Policy for America: Enabling a Smart Grid, End-to-End* MIT-IPC-Energy Innovation Working Paper 09-003 (Massachusetts Institute of Technology Industrial Performance Center, 2009).
- WNA (World Nuclear Association) *World uranium mining production* (2016, accessed 30 August 2016); <http://www.world-nuclear.org/information-library/nuclear-fuel-cycle/mining-of-uranium/world-uranium-mining-production.aspx>
- Woo, C.-K., Lloyd-Zannetti, D., Orans, R., Horii, B., and Heffner, G. Marginal capacity costs of electricity distribution and demand for distributed generation. *The Energy Journal* **16**, 111-130 (1995).
- World Bank. *World Bank climate change 2013* (2013, accessed 22 October, 2016); <https://knoema.com/WBCC2013/world-bank-climate-change-2013?tsId=1062330>
- World Bank. *Passenger cars (Per 1000 people)* (2014, accessed Fall 2014); <http://data.worldbank.org/indicator/IS.VEH.PCAR.P3>
- World Bank. *Labor force, total* (2015a, accessed 17 June 2015); <http://data.worldbank.org/indicator/SL.TLF.TOTL.IN/countries>
- World Bank. *Urban population (% of total)* (2015b, accessed 8 September 2015); <http://data.worldbank.org/indicator/SP.URB.TOTL.IN.ZS>
- World Bank. *Electricity production from hydroelectric sources* (2016a, accessed 21 August 2016); <http://data.worldbank.org/indicator/EG.ELC.HYRO.ZS>
- World Bank. *Land area (sq. km)* (2016b, accessed 29 August 2016); <http://data.worldbank.org/indicator/AG.LND.TOTL.K2>
- World Bank. *GDP per capita, PPP (current international \$)* (2016c, accessed 29 August 2016); <http://data.worldbank.org/indicator/NY.GDP.PCAP.PP.CD>
- World Bank. *GDP per capita, PPP (constant 2011 international \$)* (2016d, accessed 29 August 2016); <http://data.worldbank.org/indicator/NY.GDP.PCAP.PP.KD>
- Xu, B., Li, P., and Chan, C. Application of phase change materials for thermal energy storage in concentrated solar thermal power plants: A review to recent developments. *Applied Energy* **160**, 286-307 (2015).
- Yemm, R., Pizer, D., Retzler, C., and Henderson, R. Pelamis: Experience from concept to connection. *Phil. Trans. R. Soc. A* **370**, 365-380 (2012).
- Zhou, L., Li, F., Gu, C., Hu, Z., and Le Blond, S. Cost/benefit assessment of a smart distribution system with intelligent electric vehicle charging. *IEEE Trans. Smart Grid* **5**, 839-847 (2014).